



WEAR	<b>NORMAL</b>
CONTAMINATION	<b>NORMAL</b>
FLUID CONDITION	<b>NORMAL</b>

Machine Id  
**PRS**  
Component  
**Port Genset**  
Fluid  
**CHEVRON URSA SUPER PLUS 40 (6 GAL)**

**RECOMMENDATION**

Resample at the next service interval to monitor.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		<b>MW06101482</b>	MW06048282	MW06017186
Sample Date		Client Info		<b>26 Feb 2024</b>	01 Jan 2024	23 Nov 2023
Machine Age	hrs	Client Info		<b>22379</b>	21697	21281
Oil Age	hrs	Client Info		<b>682</b>	416	370
Filter Age	hrs	Client Info		<b>0</b>	0	0
Oil Changed		Client Info		<b>N/A</b>	N/A	N/A
Filter Changed		Client Info		<b>N/A</b>	N/A	N/A
Sample Status				<b>NORMAL</b>	NORMAL	NORMAL

**WEAR**

All component wear rates are normal.

Iron	ppm	ASTM D5185m	>50	<b>23</b>	8	6
Chromium	ppm	ASTM D5185m	>4	<b>&lt;1</b>	<1	<1
Nickel	ppm	ASTM D5185m	>2	<b>1</b>	0	<1
Titanium	ppm	ASTM D5185m		<b>1</b>	1	4
Silver	ppm	ASTM D5185m	>5	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m	>12	<b>2</b>	1	2
Lead	ppm	ASTM D5185m	>17	<b>&lt;1</b>	0	0
Copper	ppm	ASTM D5185m	>70	<b>2</b>	1	<1
Tin	ppm	ASTM D5185m	>15	<b>1</b>	<1	<1
Vanadium	ppm	ASTM D5185m		<b>&lt;1</b>	0	0
White Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE

**CONTAMINATION**







There is no indication of any contamination in the oil.

Silicon	ppm	ASTM D5185m	>25	<b>7</b>	4	4
Potassium	ppm	ASTM D5185m	>20	<b>12</b>	1	2
Fuel		WC Method	>4.0	<b>&lt;1.0</b>	<1.0	<1.0
Water		WC Method	>0.1	<b>NEG</b>	NEG	NEG
Glycol		WC Method		<b>NEG</b>	NEG	NEG
Soot %	%	*ASTM D7844		<b>1.2</b>	0.3	0.2
Nitration	Abs/cm	*ASTM D7624	>20	<b>7.7</b>	7.1	7.4
Sulfation	Abs/.1mm	*ASTM D7415	>30	<b>22.2</b>	18.9	18.5
Silt	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Debris	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Appearance	scalar	*Visual	NORML	<b>NORML</b>	NORML	NORML
Odor	scalar	*Visual	NORML	<b>NORML</b>	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	<b>NEG</b>	NEG	NEG

**FLUID CONDITION**

The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

Sodium	ppm	ASTM D5185m		<b>4</b>	<1	<1
Boron	ppm	ASTM D5185m		<b>159</b>	99	88
Barium	ppm	ASTM D5185m		<b>1</b>	0	0
Molybdenum	ppm	ASTM D5185m		<b>42</b>	38	59
Manganese	ppm	ASTM D5185m		<b>&lt;1</b>	<1	<1
Magnesium	ppm	ASTM D5185m		<b>195</b>	272	735
Calcium	ppm	ASTM D5185m		<b>2217</b>	2132	1269
Phosphorus	ppm	ASTM D5185m	1000	<b>802</b>	807	797
Zinc	ppm	ASTM D5185m	1090	<b>1020</b>	1180	1086
Sulfur	ppm	ASTM D5185m		<b>3120</b>	3250	3405
Oxidation	Abs/.1mm	*ASTM D7414	>25	<b>14.2</b>	12.8	13.8
Base Number (BN)	mg KOH/g	ASTM D2896	7.4	<b>6.1</b>	5.9	7.8
Visc @ 100°C	cSt	ASTM D445	14.7	<b>14.6</b>	12.8	14.3

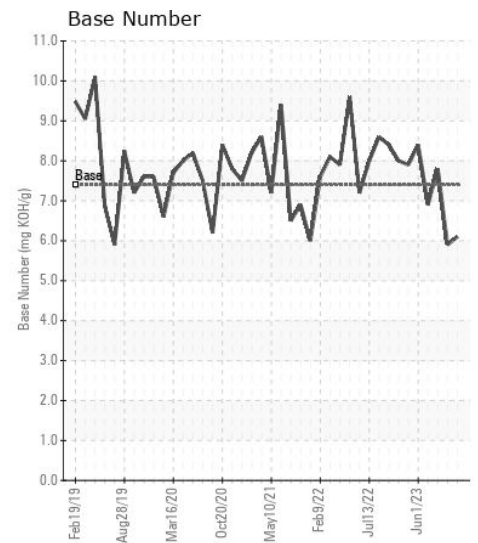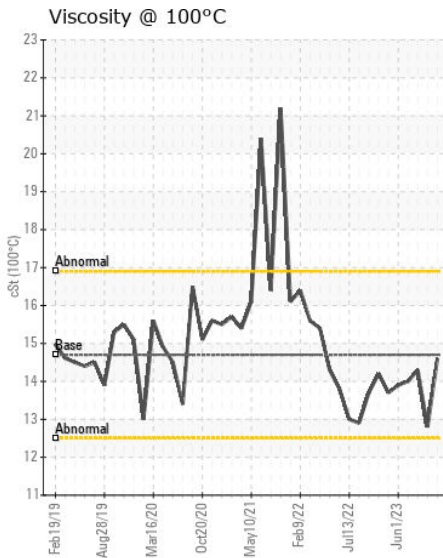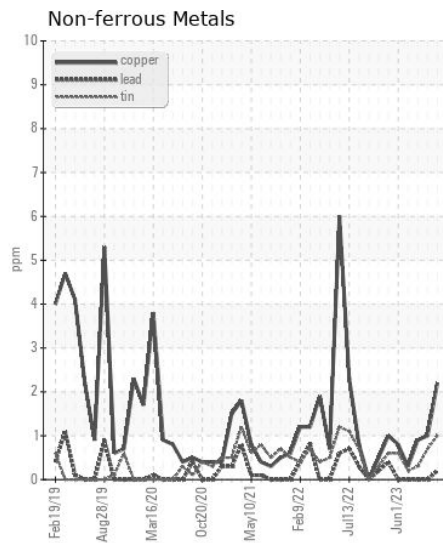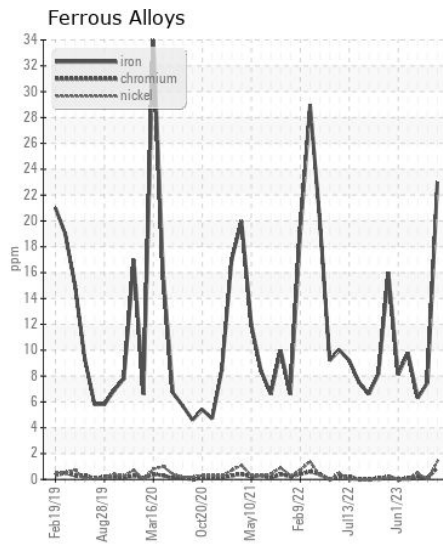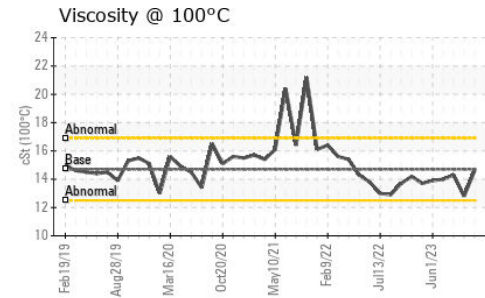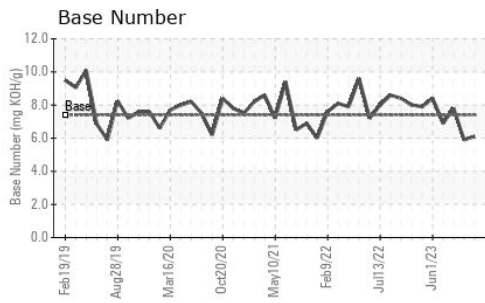

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513

**Sample No.** : MW06101482

**Lab Number** : 06101482

**Unique Number** : 10899712

**Test Package** : MAR 2

**Received** : 27 Feb 2024

**Tested** : 28 Feb 2024

**Diagnosed** : 28 Feb 2024 - Wes Davis

**ILLINOIS MARINE TOWING**

PO BOX 391

LEMONT, IL

US 60439

Contact: RHETT DANIEL

rdaniel@imtowing.com

T: (630)280-4926

F: (630)739-2041

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)