



**PERFORMANCE  
UNDER  
PRESSURE**

**OIL ANALYSIS REPORT**

WEAR	<b>NORMAL</b>
CONTAMINATION	<b>NORMAL</b>
FLUID CONDITION	<b>NORMAL</b>

Machine Id  
**TOL5\_U2120\_TOL5\_U2120\_M2120**  
Component  
**Non-Drive End Bearing**  
Fluid  
**ROYAL PURPLE SYNFILM GT 32 (--- QTS)**

**RECOMMENDATION**

Resample at the next service interval to monitor.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		<b>RP0025897</b>	RP0034026	RP0026207
Sample Date		Client Info		<b>21 Feb 2024</b>	16 Nov 2023	25 Sep 2023
Machine Age	mths	Client Info		<b>5</b>	5	5
Oil Age	mths	Client Info		<b>5</b>	5	5
Filter Age	mths	Client Info		<b>0</b>	0	0
Oil Changed		Client Info		<b>N/A</b>	N/A	N/A
Filter Changed		Client Info		<b>N/A</b>	N/A	N/A
Sample Status				<b>NORMAL</b>	NORMAL	NORMAL

**WEAR**

All component wear rates are normal.

Iron	ppm	ASTM D5185m	>20	<b>0</b>	0	0
Chromium	ppm	ASTM D5185m	>20	<b>&lt;1</b>	0	0
Nickel	ppm	ASTM D5185m	>20	<b>0</b>	<1	<1
Titanium	ppm	ASTM D5185m		<b>0</b>	0	0
Silver	ppm	ASTM D5185m		<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m	>20	<b>0</b>	<1	<1
Lead	ppm	ASTM D5185m	>20	<b>&lt;1</b>	<1	<1
Copper	ppm	ASTM D5185m	>20	<b>&lt;1</b>	<1	<1
Tin	ppm	ASTM D5185m	>20	<b>0</b>	<1	<1
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	0
White Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE

**CONTAMINATION**








The water content is negligible. There is no indication of any contamination in the oil.

Silicon	ppm	ASTM D5185m	>15	<b>&lt;1</b>	1	<1
Potassium	ppm	ASTM D5185m	>20	<b>0</b>	<1	0
Water	%	ASTM D6304	>2	<b>0.007</b>	0.013	0.026
ppm Water	ppm	ASTM D6304		<b>72</b>	130	260.5
Silt	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Debris	scalar	*Visual	NONE	<b>NONE</b>	NONE	LIGHT
Sand/Dirt	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Appearance	scalar	*Visual	NORML	<b>NORML</b>	NORML	NORML
Odor	scalar	*Visual	NORML	<b>NORML</b>	NORML	NORML
Emulsified Water	scalar	*Visual	>2	<b>NEG</b>	NEG	NEG

**FLUID CONDITION**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

Sodium	ppm	ASTM D5185m		<b>0</b>	2	1
Boron	ppm	ASTM D5185m		<b>0</b>	0	0
Barium	ppm	ASTM D5185m		<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m		<b>0</b>	0	0
Manganese	ppm	ASTM D5185m		<b>&lt;1</b>	0	0
Magnesium	ppm	ASTM D5185m		<b>84</b>	83	72
Calcium	ppm	ASTM D5185m		<b>5</b>	4	4
Phosphorus	ppm	ASTM D5185m		<b>0</b>	4	1
Zinc	ppm	ASTM D5185m		<b>14</b>	3	16
Acid Number (AN)	mg KOH/g	ASTM D8045		<b>0.406</b>	0.375	0.41
Visc @ 40°C	cSt	ASTM D445	32	<b>37.3</b>	32.0	32.2

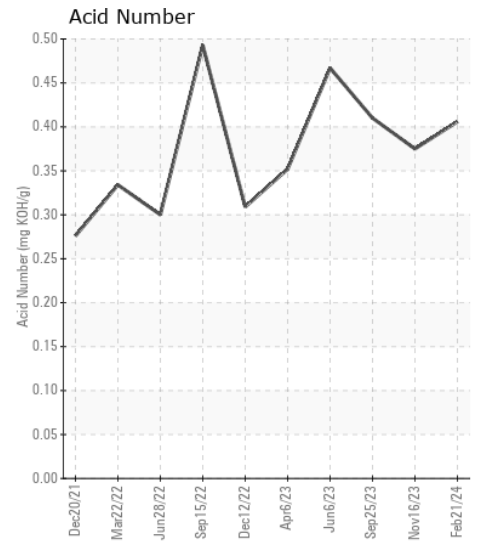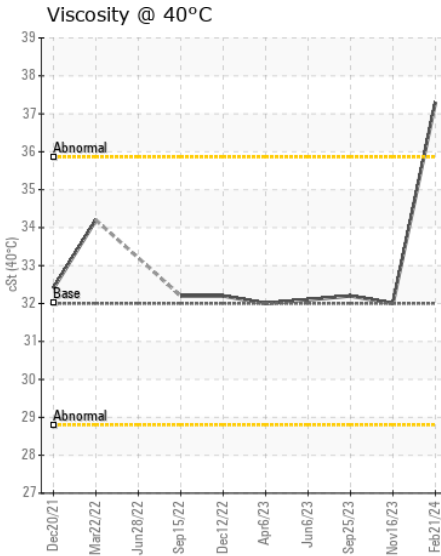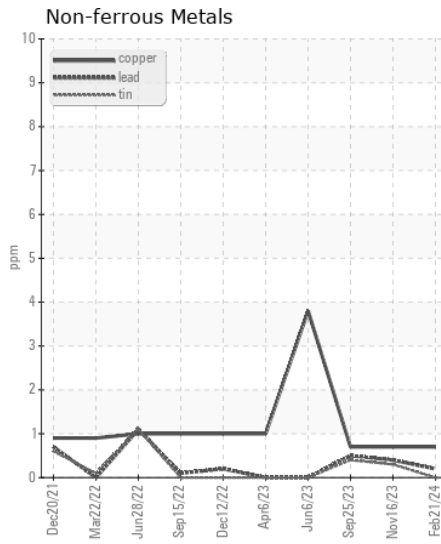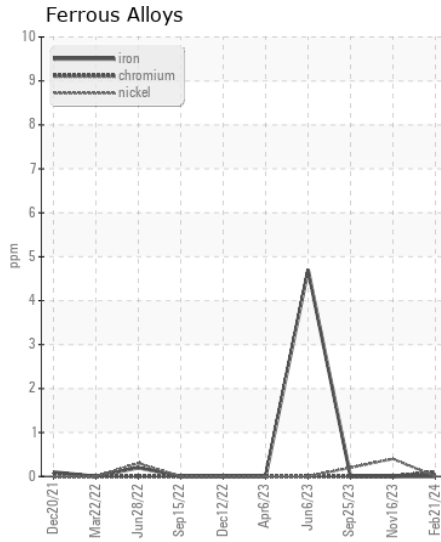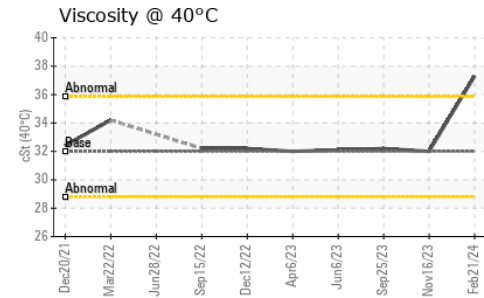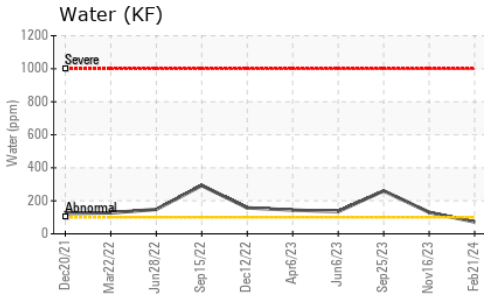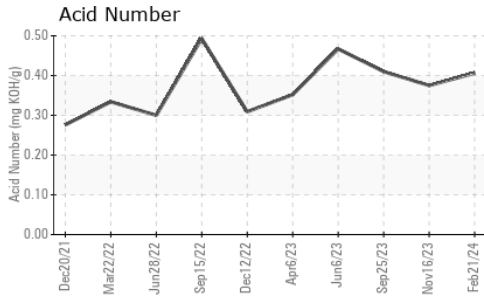

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : RP0025897  
**Lab Number** : 06101689  
**Unique Number** : 10899919  
**Test Package** : PLANT  
**Received** : 27 Feb 2024  
**Tested** : 29 Feb 2024  
**Diagnosed** : 29 Feb 2024 - Don Baldrige

**ENERGY TRANSFER - TOLEDO**  
 2549 BROWN ROAD  
 OREGON, OH  
 US 43616  
 Contact: DARREN GRANT

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: (419)389-7403

F: