



PERFORMANCE
UNDER
PRESSURE

OIL ANALYSIS REPORT

WEAR	NORMAL
CONTAMINATION	NORMAL
FLUID CONDITION	NORMAL

Machine Id
TOLE_U8 TOLE_U8_P8
Component
Non-Drive End Pump
Fluid
ROYAL PURPLE SYNFILM GT 32 (2 QTS)

RECOMMENDATION

Resample at the next service interval to monitor.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		RP0025903	RP0025466	RP0026211
Sample Date		Client Info		21 Feb 2024	16 Nov 2023	25 Sep 2023
Machine Age	hrs	Client Info		0	0	0
Oil Age	hrs	Client Info		0	0	0
Filter Age	hrs	Client Info		0	0	0
Oil Changed		Client Info		N/A	N/A	N/A
Filter Changed		Client Info		N/A	N/A	N/A
Sample Status				NORMAL	NORMAL	ABNORMAL

WEAR

All component wear rates are normal.

Iron	ppm	ASTM D5185m	>90	0	<1	0
Chromium	ppm	ASTM D5185m	>5	<1	0	0
Nickel	ppm	ASTM D5185m	>5	0	<1	<1
Titanium	ppm	ASTM D5185m	>3	0	0	0
Silver	ppm	ASTM D5185m	>3	0	<1	0
Aluminum	ppm	ASTM D5185m	>7	0	<1	<1
Lead	ppm	ASTM D5185m	>12	0	<1	<1
Copper	ppm	ASTM D5185m	>30	2	2	2
Tin	ppm	ASTM D5185m	>9	0	<1	<1
Vanadium	ppm	ASTM D5185m		0	0	0
White Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE

CONTAMINATION








The water content is negligible. There is no indication of any contamination in the oil.

Silicon	ppm	ASTM D5185m	>60	2	4	3
Potassium	ppm	ASTM D5185m	>20	0	<1	0
Water	%	ASTM D6304	>.1	0.014	0.013	▲ 0.231
ppm Water	ppm	ASTM D6304	>1000	144	133	▲ 2310
Silt	scalar	*Visual	NONE	NONE	NONE	▲ MODER
Debris	scalar	*Visual	NONE	LIGHT	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	● HAZY
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>.1	NEG	NEG	0.2%

FLUID CONDITION

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

Sodium	ppm	ASTM D5185m		0	<1	<1
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m		0	0	0
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		<1	<1	<1
Magnesium	ppm	ASTM D5185m		37	33	26
Calcium	ppm	ASTM D5185m		2	1	3
Phosphorus	ppm	ASTM D5185m		4	4	3
Zinc	ppm	ASTM D5185m		6	0	11
Acid Number (AN)	mg KOH/g	ASTM D8045		0.359	0.356	0.359
Visc @ 40°C	cSt	ASTM D445	32	32.6	32.7	32.7

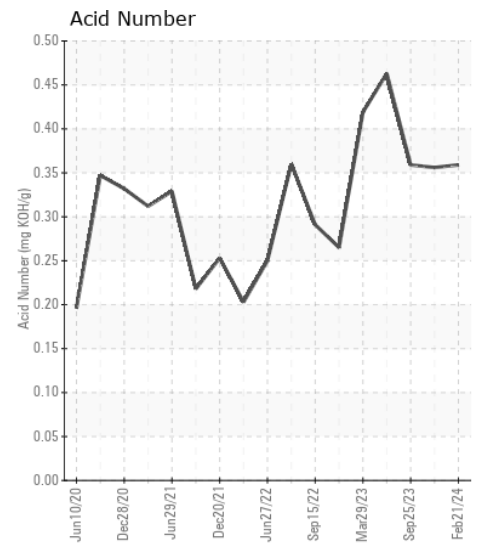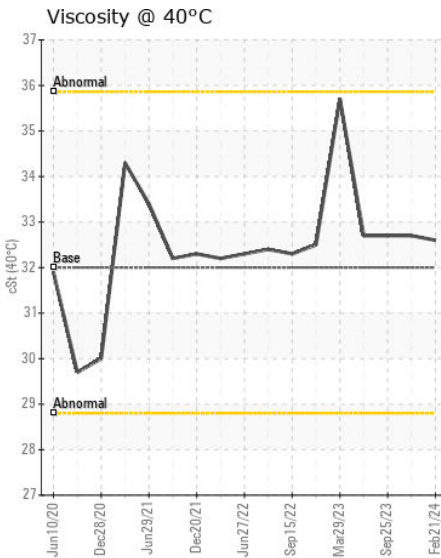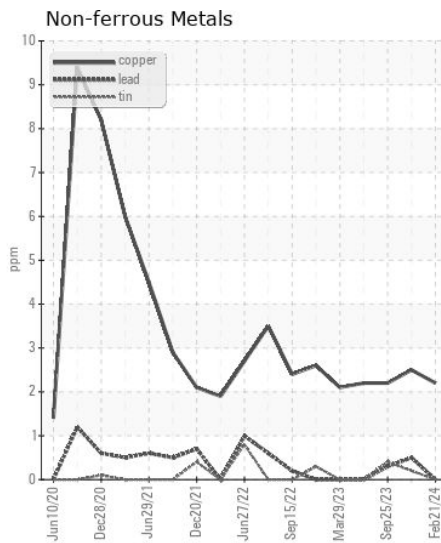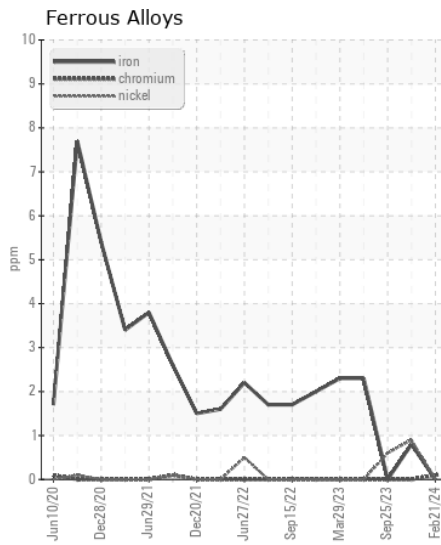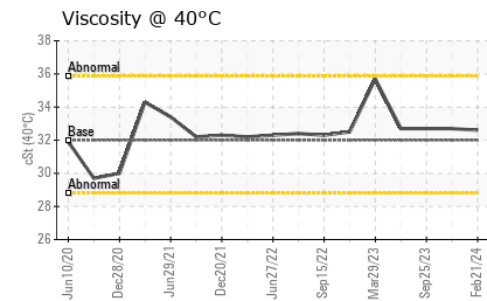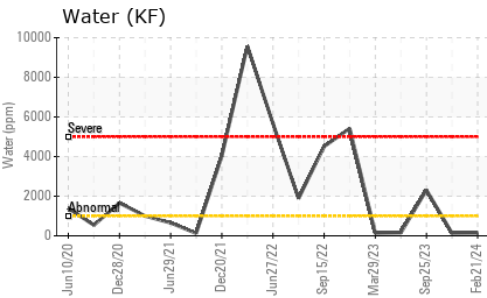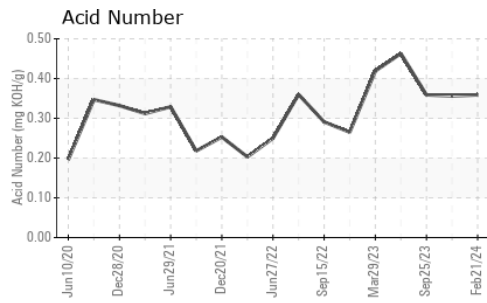

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : RP0025903
Lab Number : 06101698
Unique Number : 10899928
Test Package : PLANT
Received : 27 Feb 2024
Tested : 29 Feb 2024
Diagnosed : 29 Feb 2024 - Don Baldrige

ENERGY TRANSFER - TOLEDO
 2549 BROWN ROAD
 OREGON, OH
 US 43616
 Contact: DARREN GRANT

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: (419)389-7403

F: