



**PERFORMANCE
UNDER
PRESSURE**

OIL ANALYSIS REPORT

| | |
|-----------------|---------------|
| WEAR | NORMAL |
| CONTAMINATION | NORMAL |
| FLUID CONDITION | NORMAL |

Machine Id
TOLE_U8 TOLE_U8_M8
Component
Non-Drive End Bearing
Fluid
ROYAL PURPLE SYNFILM GT 32 (4 QTS)

RECOMMENDATION

Resample at the next service interval to monitor.

| Test | UOM | Method | Limit/Abn | Current | History1 | History2 |
|----------------|-----|-------------|-----------|--------------------|-------------|-------------|
| Sample Number | | Client Info | | RP0025892 | RP0025474 | RP0034008 |
| Sample Date | | Client Info | | 21 Feb 2024 | 16 Nov 2023 | 25 Sep 2023 |
| Machine Age | hrs | Client Info | | 0 | 0 | 0 |
| Oil Age | hrs | Client Info | | 0 | 0 | 0 |
| Filter Age | hrs | Client Info | | 0 | 0 | 0 |
| Oil Changed | | Client Info | | N/A | N/A | N/A |
| Filter Changed | | Client Info | | N/A | N/A | N/A |
| Sample Status | | | | NORMAL | NORMAL | NORMAL |

WEAR

All component wear rates are normal.

| | | | | | | |
|--------------|--------|-------------|------|--------------|------|------|
| Iron | ppm | ASTM D5185m | >20 | 0 | 0 | <1 |
| Chromium | ppm | ASTM D5185m | >20 | 0 | 0 | 0 |
| Nickel | ppm | ASTM D5185m | >20 | 0 | <1 | 0 |
| Titanium | ppm | ASTM D5185m | | 0 | 0 | 0 |
| Silver | ppm | ASTM D5185m | | 0 | 0 | 0 |
| Aluminum | ppm | ASTM D5185m | >20 | <1 | <1 | 0 |
| Lead | ppm | ASTM D5185m | >20 | 5 | 7 | 7 |
| Copper | ppm | ASTM D5185m | >20 | 4 | 4 | 4 |
| Tin | ppm | ASTM D5185m | >20 | 0 | 0 | <1 |
| Vanadium | ppm | ASTM D5185m | | 0 | 0 | 0 |
| White Metal | scalar | *Visual | NONE | NONE | NONE | NONE |
| Yellow Metal | scalar | *Visual | NONE | NONE | NONE | NONE |

CONTAMINATION








The water content is negligible. There is no indication of any contamination in the oil.

| | | | | | | |
|------------------|--------|-------------|-------|--------------|-------|-------|
| Silicon | ppm | ASTM D5185m | >15 | <1 | <1 | <1 |
| Potassium | ppm | ASTM D5185m | >20 | <1 | 1 | 1 |
| Water | % | ASTM D6304 | >2 | 0.006 | 0.008 | 0.023 |
| ppm Water | ppm | ASTM D6304 | | 69 | 88 | 235.1 |
| Silt | scalar | *Visual | NONE | NONE | NONE | NONE |
| Debris | scalar | *Visual | NONE | NONE | NONE | NONE |
| Sand/Dirt | scalar | *Visual | NONE | NONE | NONE | NONE |
| Appearance | scalar | *Visual | NORML | NORML | NORML | NORML |
| Odor | scalar | *Visual | NORML | NORML | NORML | NORML |
| Emulsified Water | scalar | *Visual | >2 | NEG | NEG | NEG |

FLUID CONDITION

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

| | | | | | | |
|------------------|----------|-------------|----|--------------|-------|------|
| Sodium | ppm | ASTM D5185m | | <1 | 2 | 0 |
| Boron | ppm | ASTM D5185m | | 0 | 0 | 0 |
| Barium | ppm | ASTM D5185m | | 1 | 0 | 0 |
| Molybdenum | ppm | ASTM D5185m | | 0 | 0 | 0 |
| Manganese | ppm | ASTM D5185m | | 0 | 0 | 0 |
| Magnesium | ppm | ASTM D5185m | | 57 | 51 | 47 |
| Calcium | ppm | ASTM D5185m | | 4 | <1 | 0 |
| Phosphorus | ppm | ASTM D5185m | | 7 | 4 | 6 |
| Zinc | ppm | ASTM D5185m | | 1 | 0 | 6 |
| Acid Number (AN) | mg KOH/g | ASTM D8045 | | 0.445 | 0.448 | 0.45 |
| Visc @ 40°C | cSt | ASTM D445 | 32 | 33.4 | 32.7 | 32.2 |

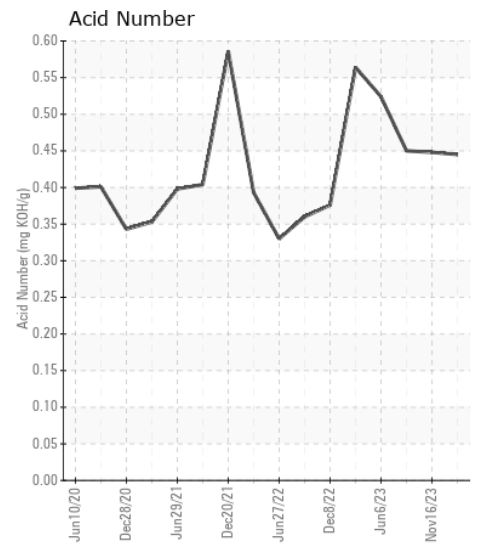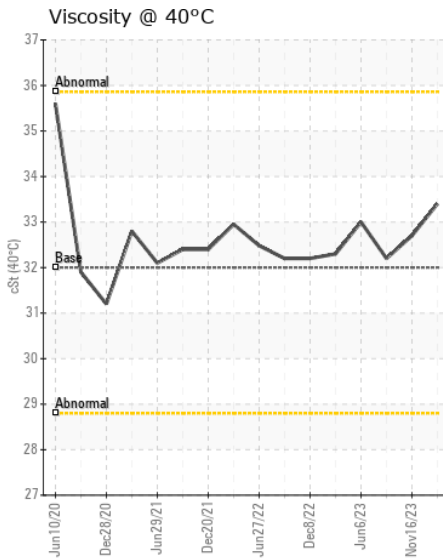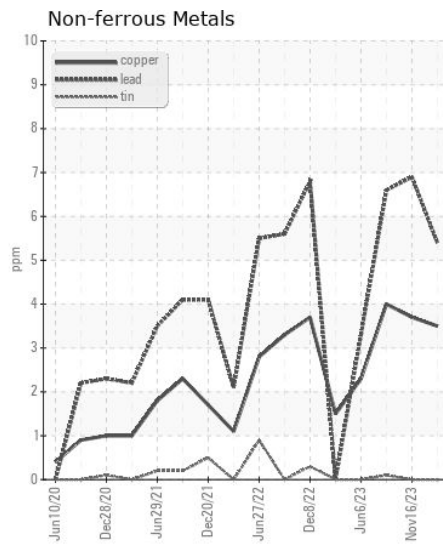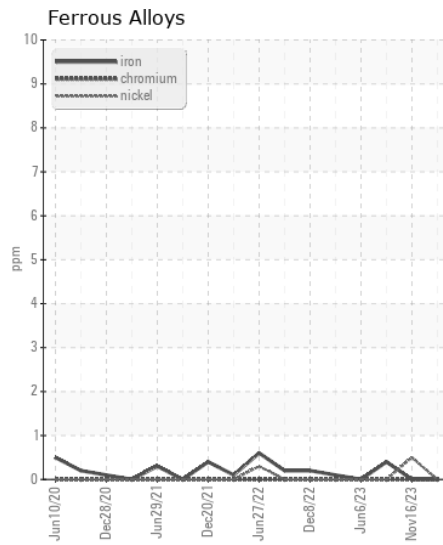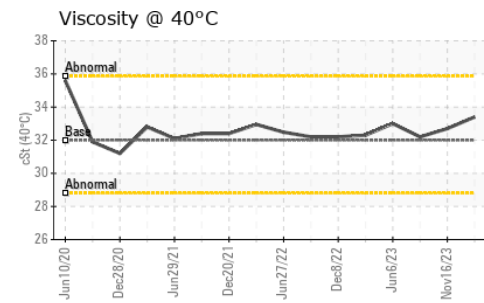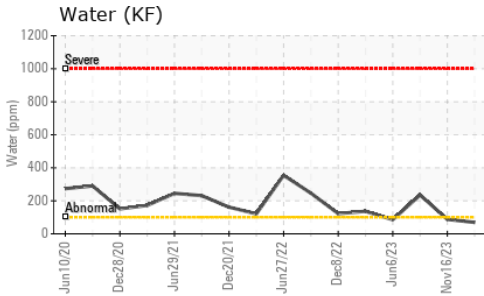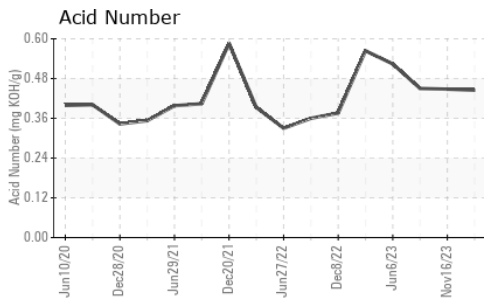

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : RP0025892
Lab Number : 06101701
Unique Number : 10899931
Test Package : PLANT
Received : 27 Feb 2024
Tested : 29 Feb 2024
Diagnosed : 29 Feb 2024 - Don Baldrige

ENERGY TRANSFER - TOLEDO
 2549 BROWN ROAD
 OREGON, OH
 US 43616
 Contact: DARREN GRANT

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: (419)389-7403

F: