



**PERFORMANCE
UNDER
PRESSURE**

OIL ANALYSIS REPORT

WEAR	NORMAL
CONTAMINATION	NORMAL
FLUID CONDITION	NORMAL

Machine Id
TOLE_U3 TOLE_U3_P3
Component
Non-Drive End Pump
Fluid
ROYAL PURPLE SYNFILM GT 32 (2 QTS)

RECOMMENDATION

Resample at the next service interval to monitor.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		RP0025888	RP0025415	RP0025136
Sample Date		Client Info		21 Feb 2024	29 Mar 2023	12 Dec 2022
Machine Age	hrs	Client Info		0	0	0
Oil Age	hrs	Client Info		0	0	0
Filter Age	hrs	Client Info		0	0	0
Oil Changed		Client Info		N/A	N/A	N/A
Filter Changed		Client Info		N/A	N/A	N/A
Sample Status				NORMAL	NORMAL	NORMAL

WEAR

All component wear rates are normal.

Iron	ppm	ASTM D5185m	>90	54	2	2
Chromium	ppm	ASTM D5185m	>5	<1	0	0
Nickel	ppm	ASTM D5185m	>5	0	0	0
Titanium	ppm	ASTM D5185m	>3	0	0	0
Silver	ppm	ASTM D5185m	>3	0	0	0
Aluminum	ppm	ASTM D5185m	>7	0	<1	0
Lead	ppm	ASTM D5185m	>12	5	11	12
Copper	ppm	ASTM D5185m	>30	17	16	18
Tin	ppm	ASTM D5185m	>9	0	2	2
Vanadium	ppm	ASTM D5185m		0	0	0
White Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE

CONTAMINATION








The water content is negligible. There is no indication of any contamination in the oil.

Silicon	ppm	ASTM D5185m	>60	10	3	3
Potassium	ppm	ASTM D5185m	>20	0	0	0
Water	%	ASTM D6304	>.1	0.005	0.012	0.009
ppm Water	ppm	ASTM D6304	>1000	57	127.6	98.3
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>.1	NEG	NEG	NEG

FLUID CONDITION

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

Sodium	ppm	ASTM D5185m		5	1	<1
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m		0	0	0
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		<1	<1	<1
Magnesium	ppm	ASTM D5185m		74	57	54
Calcium	ppm	ASTM D5185m		6	<1	0
Phosphorus	ppm	ASTM D5185m		2	4	28
Zinc	ppm	ASTM D5185m		0	5	4
Acid Number (AN)	mg KOH/g	ASTM D8045		0.41	0.405	0.29
Visc @ 40°C	cSt	ASTM D445	32	32.1	31.5	31.5

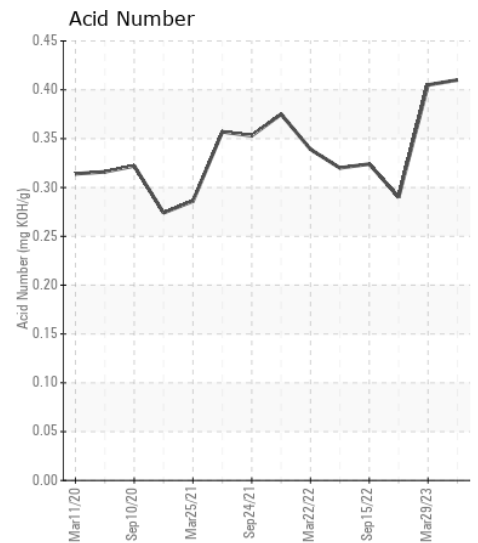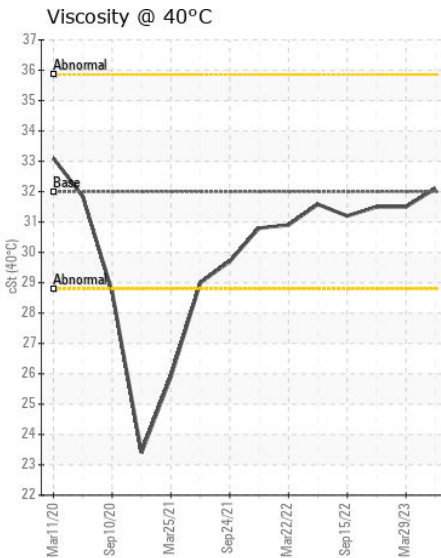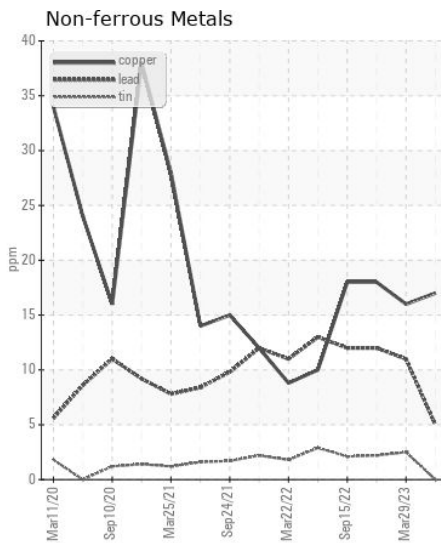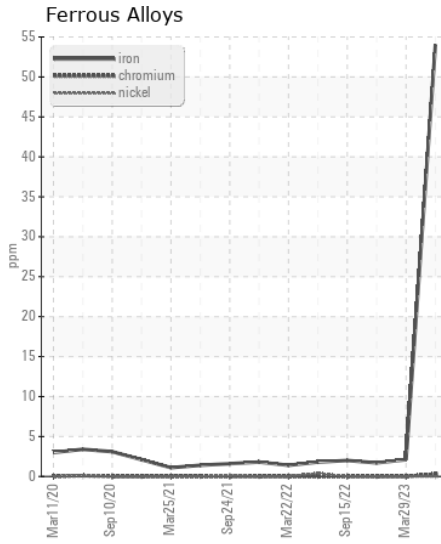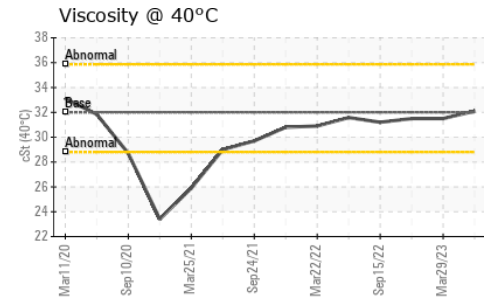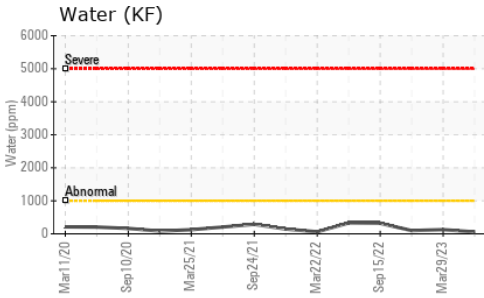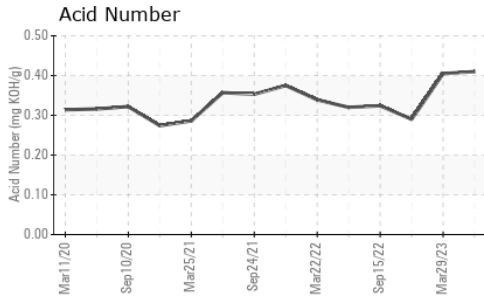

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : RP0025888
Lab Number : 06101718
Unique Number : 10899948
Test Package : PLANT
Received : 27 Feb 2024
Tested : 29 Feb 2024
Diagnosed : 29 Feb 2024 - Jonathan Hester

ENERGY TRANSFER - TOLEDO
 2549 BROWN ROAD
 OREGON, OH
 US 43616
 Contact: DARREN GRANT

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: (419)389-7403

F: