
**WEAR** CONTAMINATION **FLUID CONDITION** 

**NORMAL ABNORMAL NORMAL** 

## **MATTEI 10013465-2020**

Component Compressor

ROTOROIL 8000F2 (2 QTS)							
RECOMMENDATION	Test	UOM	Method	Limit/Abn	Current	History1	History2
No corrective action is recommended at this time. Resample at the next service interval to monitor.	Sample Number		Client Info		AN25409		
	Sample Date		Client Info		06 Feb 2024		
	Machine Age	hrs	Client Info		1955		
	Oil Age	hrs	Client Info		0		
	Filter Age	hrs	Client Info		0		
	Oil Changed		Client Info		Changed		
	Filter Changed		Client Info		N/A		
	Sample Status				ABNORMAL		
WEAR	Iron	ppm	ASTM D5185m	<u>~50</u>	14		
All component wear rates are normal.	Chromium	ppm	ASTM D5185m		0		
	Nickel	ppm	ASTM D5185m	>10	0		
	Titanium	ppm	ASTM D5185m		0		
	Silver	ppm	ASTM D5185m		0		
	Aluminum	ppm	ASTM D5185m	>25	<1		
	Lead	ppm	ASTM D5185m		<1		
	Copper	ppm	ASTM D5185m	>50	1		
	Tin	ppm	ASTM D5185m	>15	<1		
	Vanadium	ppm	ASTM D5185m		<1		
	White Metal	scalar	*Visual	NONE	NONE		
	Yellow Metal	scalar	*Visual	NONE	NONE		
CONTABBINATION			40714 0-10-				
CONTAMINATION  Elemental level of silicon (Si) above normal. The water content is negligible.	Silicon	ppm	ASTM D5185m		<u>▲</u> 34		
	Potassium	ppm	ASTM D5185m		<1		
	Water	%	ASTM D6304	>0.1	0.079		
	ppm Water Silt	ppm scalar	*Visual	NONE	792 NONE		
	Debris	scalar	*Visual	NONE	NONE		
	Sand/Dirt	scalar	*Visual	NONE	NONE		
	Appearance	scalar	*Visual	NORML	NORML		
	Odor	scalar	*Visual	NORML	NORML		
	Emulsified Water		*Visual	>0.1	NEG		
FLUID CONDITION	Sodium	ppm	ASTM D5185m		18		
The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.	Boron	ppm	ASTM D5185m		2		
	Barium	ppm	ASTM D5185m		0		
	Molybdenum	ppm	ASTM D5185m		0		
	Manganese	ppm	ASTM D5185m		0		
	Magnesium	ppm	ASTM D5185m		<1		
	Calcium	ppm	ASTM D5185m		2		
	Phosphorus Zinc	ppm	ASTM D5185m ASTM D5185m		879		
	Sulfur	ppm	ASTM D5185m		132 318		
	Acid Number (AN)	ppm mg KOH/g	ASTM D3163III	U 3	0.23		
	Visc @ 40°C	mg KOH/g	ASTM D8045 ASTM D445		0.23 87.5		
	VISC @ 40°C	USI	A3 1 W D443	00.0	07.0		

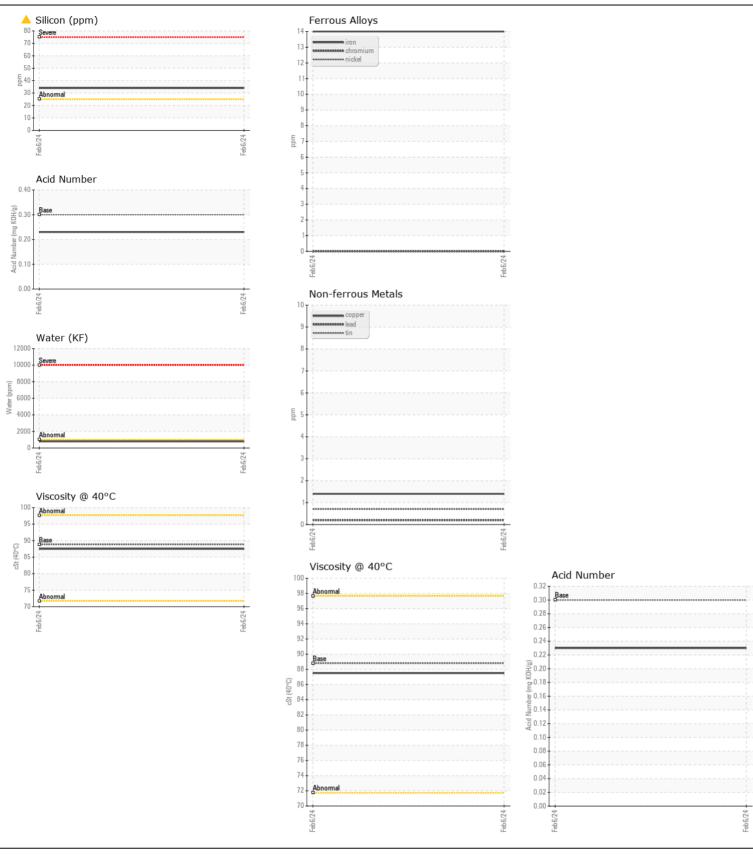





Certificate L2367

Laboratory Sample No.

: AN25409 Lab Number : 06103051 Unique Number: 10901281 Test Package : IND 2

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 Received : 28 Feb 2024 **Tested** :01 Mar 2024

> : 01 Mar 2024 - Jonathan Hester Diagnosed

MATTEI COMPRESSORS--OEM 9635 LIBERTY ROAD, SUITE E

RANDALLSTOWN, MD US 21133

> Contact: MARTY WARD jward@matteicomp.com

T: (410)521-7020 F: (410)521-7024

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)