



OIL ANALYSIS REPORT

WEAR	NORMAL
CONTAMINATION	ABNORMAL
FLUID CONDITION	NORMAL

Machine Id
MATTEI 2JWRPR-2016
 Component
Compressor
 Fluid
ROTOROIL 8000F2 (2 QTS)

RECOMMENDATION

No corrective action is recommended at this time. Resample at the next service interval to monitor.

WEAR

All component wear rates are normal.









CONTAMINATION

Elemental level of silicon (Si) above normal. There is a light concentration of water present in the oil.

FLUID CONDITION

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		AN25415	AN36991	---
Sample Date		Client Info		02 Feb 2024	16 Mar 2020	---
Machine Age	hrs	Client Info		5465	1639	---
Oil Age	hrs	Client Info		0	0	---
Filter Age	hrs	Client Info		0	0	---
Oil Changed		Client Info		Changed	Changed	---
Filter Changed		Client Info		N/A	N/A	---
Sample Status				ABNORMAL	ABNORMAL	---
Iron	ppm	ASTM D5185m	>50	8	18	---
Chromium	ppm	ASTM D5185m	>10	0	<1	---
Nickel	ppm	ASTM D5185m		<1	2	---
Titanium	ppm	ASTM D5185m		0	0	---
Silver	ppm	ASTM D5185m		0	0	---
Aluminum	ppm	ASTM D5185m	>25	<1	3	---
Lead	ppm	ASTM D5185m	>25	0	0	---
Copper	ppm	ASTM D5185m	>50	2	2	---
Tin	ppm	ASTM D5185m	>15	<1	<1	---
Vanadium	ppm	ASTM D5185m		<1	0	---
White Metal	scalar	*Visual	NONE	NONE	LIGHT	---
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	---
Silicon	ppm	ASTM D5185m	>25	▲ 37	▲ 110	---
Potassium	ppm	ASTM D5185m	>20	<1	3	---
Water	%	ASTM D6304	>0.1	▲ 0.179	0.108	---
ppm Water	ppm	ASTM D6304	>1000	▲ 1792	1087.1	---
Silt	scalar	*Visual	NONE	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG	---
Sodium	ppm	ASTM D5185m		4	20	---
Boron	ppm	ASTM D5185m		1	0	---
Barium	ppm	ASTM D5185m		0	<1	---
Molybdenum	ppm	ASTM D5185m		0	0	---
Manganese	ppm	ASTM D5185m		0	<1	---
Magnesium	ppm	ASTM D5185m		<1	2	---
Calcium	ppm	ASTM D5185m		1	2	---
Phosphorus	ppm	ASTM D5185m		906	1202	---
Zinc	ppm	ASTM D5185m		70	73	---
Sulfur	ppm	ASTM D5185m		209	67	---
Acid Number (AN)	mg KOH/g	ASTM D8045	0.3	0.15	0.167	---
Visc @ 40°C	cSt	ASTM D445	88.8	74.3	79.4	---

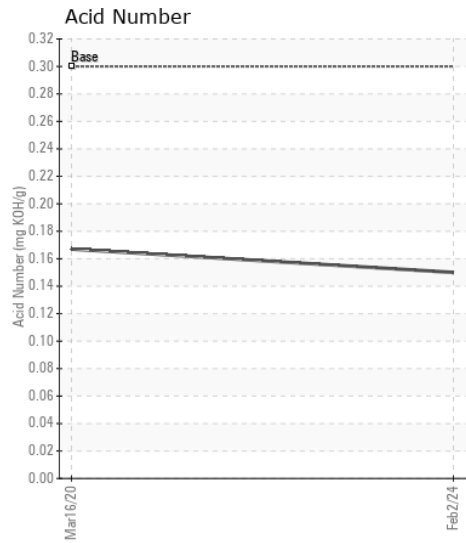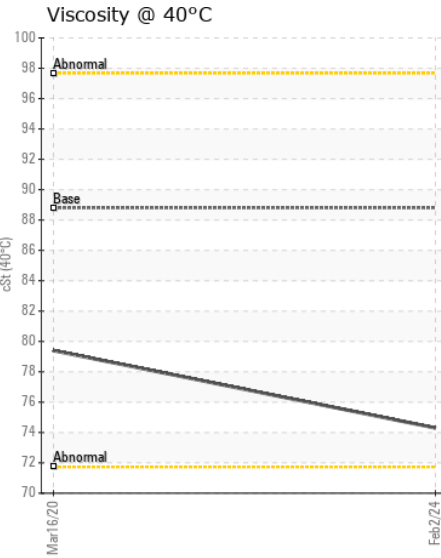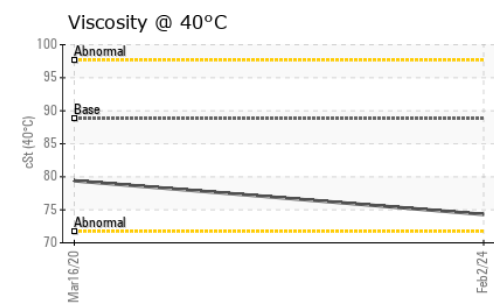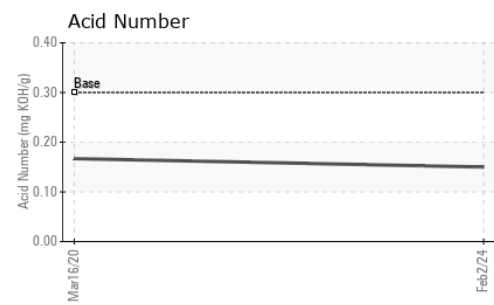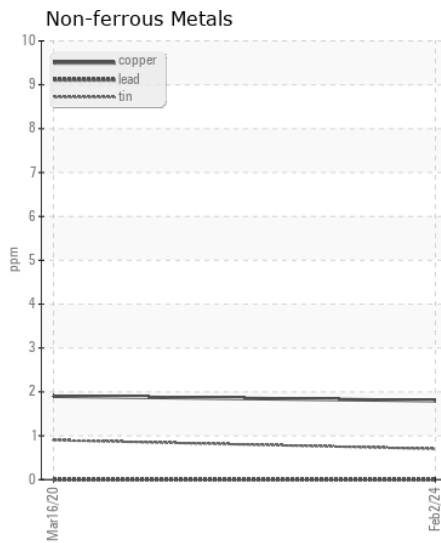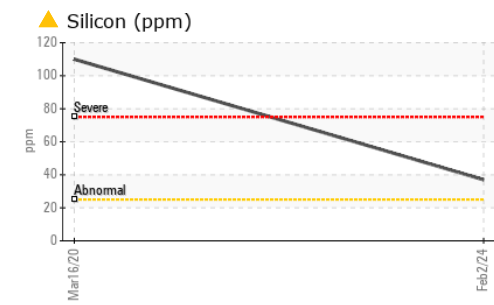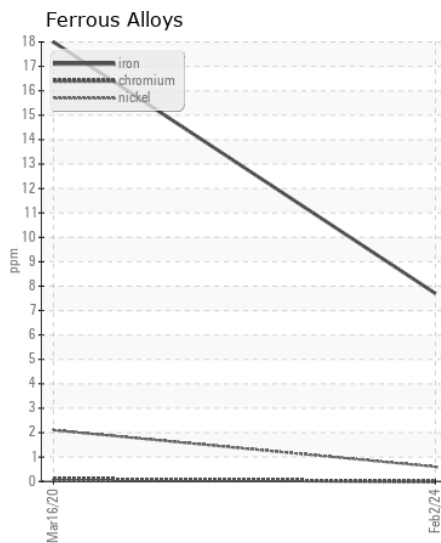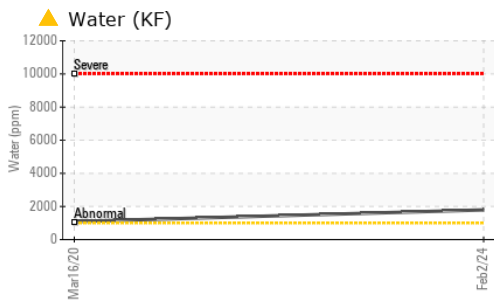

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : AN25415
Lab Number : 06103052
Unique Number : 10901282
Test Package : IND 2
Received : 28 Feb 2024
Tested : 01 Mar 2024
Diagnosed : 01 Mar 2024 - Jonathan Hester

MATTEI COMPRESSORS--OEM
 9635 LIBERTY ROAD, SUITE E
 RANDALLSTOWN, MD
 US 21133
 Contact: MARTY WARD
 jward@matteicomp.com
 T: (410)521-7020
 F: (410)521-7024

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)