

Machine Id MATTEI 10014072-2020 Component Compressor Fluid ROTOROIL 8000F2 (--- QTS)

RECOMMENDATION

No corrective action is recommended at this time. The oil change at the time of sampling has been noted. We recommend an early resample to monitor this condition.

WEAR

All component wear rates are normal.

CONTAMINATION

Elemental level of silicon (Si) above normal. The water content is negligible.

FLUID CONDITION

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

Г	est	UOM	Method	Limit/Abn	Current	History1	History2
	Sample Number	00111	Client Info	Ennerton	AN25411		
	Sample Date		Client Info		07 Feb 2024		
	And Age	hrs	Client Info		1585		
	Dil Age	hrs	Client Info		0		
	Filter Age	hrs	Client Info		0		
	Dil Changed		Client Info		Changed		
	ilter Changed		Client Info		N/A		
	Sample Status				ABNORMAL		
	:						
I	ron	ppm	ASTM D5185m	>50	6		
C	Chromium	ppm	ASTM D5185m	>10	0		
٢	lickel	ppm	ASTM D5185m		<1		
٦	Titanium	ppm	ASTM D5185m		0		
S	Silver	ppm	ASTM D5185m		0		
F	Aluminum	ppm	ASTM D5185m	>25	0		
L	ead	ppm	ASTM D5185m	>25	0		
C	Copper	ppm	ASTM D5185m	>50	<1		
٦	īn	ppm	ASTM D5185m	>15	<1		
١	/anadium	ppm	ASTM D5185m		<1		
۷	Vhite Metal	scalar	*Visual	NONE	NONE		
١	ellow Metal	scalar	*Visual	NONE	NONE		
·	Silicon		ASTM D5185m	>25	7 6		
	Potassium	ppm	ASTM D5185m	>20	0		
	Vater	ppm %	ASTM D3183	>2.0	0.069		
	opm Water		ASTM D6304	>1000	693		
	Silt	ppm scalar	*Visual	NONE	NONE		
	Debris	scalar	*Visual	NONE	LIGHT		
	Sand/Dirt	scalar	*Visual	NONE	NONE		
	Appearance	scalar	*Visual	NORML	NORML		
	Ddor	scalar	*Visual	NORML	NORML		
	Emulsified Water	scalar	*Visual	>0.1	NEG		
		304141	13001	20.1			
5	Sodium	ppm	ASTM D5185m		18		
E	Boron	ppm	ASTM D5185m		<1		
E	Barium	ppm	ASTM D5185m		0		
Ν	Nolybdenum	ppm	ASTM D5185m		0		
Ν	Nanganese	ppm	ASTM D5185m		0		
Ν	<i>A</i> agnesium	ppm	ASTM D5185m		<1		
C	Calcium	ppm	ASTM D5185m		2		
F	Phosphorus	ppm	ASTM D5185m		958		
Z	Zinc	ppm	ASTM D5185m		67		
5	Sulfur	ppm	ASTM D5185m		138		
A	cid Number (AN)	mg KOH/g	ASTM D8045	0.3	0.23		

FLUID CONDITION NORMAL

CONTAMINATION

WEAR

NORMAL

ABNORMAL


Visc @ 40°C

cSt

ASTM D445 88.8

Contact/Location: MARTY WARD - MATTEI

81.6

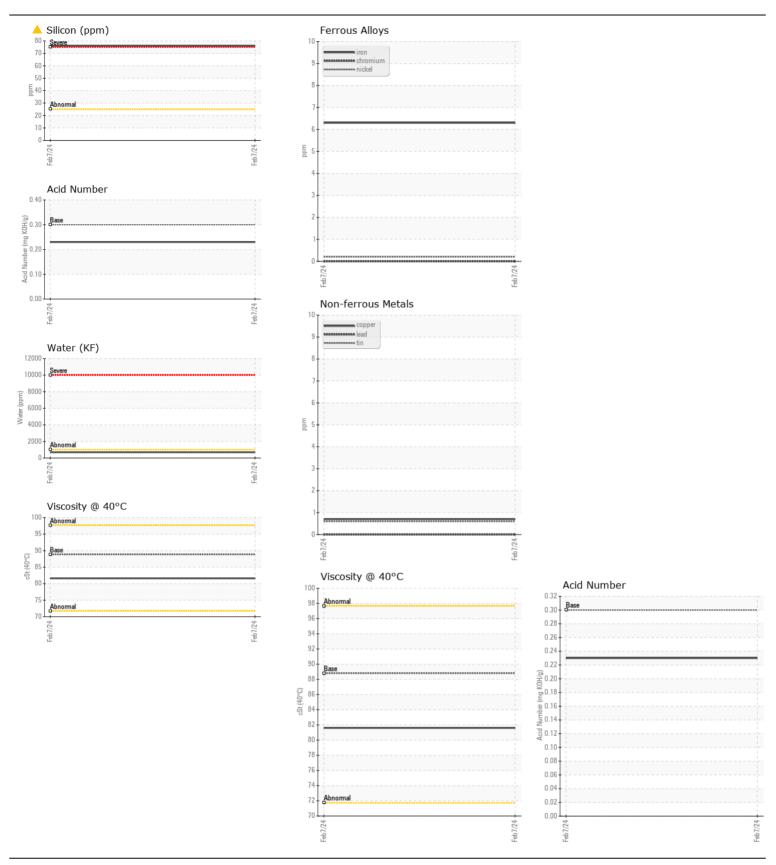

MATTEI COMPRESSORS--OEM Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513 Sample No. : AN25411 : 28 Feb 2024 9635 LIBERTY ROAD, SUITE E Received Lab Number : 06103060 :01 Mar 2024 RANDALLSTOWN, MD Tested : 01 Mar 2024 - Jonathan Hester US 21133 Unique Number : 10901290 Diagnosed Test Package : IND 2 Contact: MARTY WARD Certificate L2367 To discuss this sample report, contact Customer Service at 1-800-237-1369. jward@matteicomp.com * - Denotes test methods that are outside of the ISO 17025 scope of accreditation. T: (410)521-7020 F: (410)521-7024

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Contact/Location: MARTY WARD - MATTEI