



OIL ANALYSIS REPORT

WEAR	NORMAL
CONTAMINATION	NORMAL
FLUID CONDITION	NORMAL

Area
[PMIAS3286597]
 Machine Id
DQFAD A110182208 (S/N A110187208)
 Component
Diesel Engine
 Fluid
DIESEL ENGINE OIL SAE 15W40 (--- QTS)

RECOMMENDATION

Resample at the next service interval to monitor. Please specify the component make and model with your next sample.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		DC0033815	DC0027696	DC0018708
Sample Date		Client Info		15 Feb 2024	21 Feb 2023	11 Jan 2022
Machine Age	hrs	Client Info		309	299	285
Oil Age	hrs	Client Info		0	0	0
Filter Age	hrs	Client Info		0	0	0
Oil Changed		Client Info		Not Changd	Not Changd	Not Changd
Filter Changed		Client Info		Not Changd	Not Changd	Not Changd
Sample Status				NORMAL	NORMAL	NORMAL

WEAR

Metal levels are typical for a new component breaking in.

Iron	ppm	ASTM D5185m	>100	2	1	<1
Chromium	ppm	ASTM D5185m	>20	0	<1	<1
Nickel	ppm	ASTM D5185m	>4	0	0	0
Titanium	ppm	ASTM D5185m		0	0	<1
Silver	ppm	ASTM D5185m	>3	0	<1	0
Aluminum	ppm	ASTM D5185m	>20	<1	0	<1
Lead	ppm	ASTM D5185m	>40	<1	1	1
Copper	ppm	ASTM D5185m	>330	<1	1	3
Tin	ppm	ASTM D5185m	>15	<1	<1	0
Vanadium	ppm	ASTM D5185m		0	<1	0
White Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE

CONTAMINATION











There is no indication of any contamination in the oil.

Silicon	ppm	ASTM D5185m	>25	4	4	3
Potassium	ppm	ASTM D5185m	>20	1	3	2
Fuel		WC Method	>5	<1.0	<1.0	<1.0
Water		WC Method	>0.2	NEG	NEG	NEG
Glycol		WC Method		NEG	NEG	NEG
Soot %	%	*ASTM D7844	>3	0	0.1	0
Nitration	Abs/cm	*ASTM D7624	>20	5.0	5.4	5.8
Sulfation	Abs/.1mm	*ASTM D7415	>30	15.2	15.4	19.2
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE	MODER
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.2	NEG	NEG	0.2%

FLUID CONDITION

The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

Sodium	ppm	ASTM D5185m	>158	0	1	2
Boron	ppm	ASTM D5185m	250	8	5	5
Barium	ppm	ASTM D5185m	10	0	0	0
Molybdenum	ppm	ASTM D5185m	100	3	4	2
Manganese	ppm	ASTM D5185m		0	1	0
Magnesium	ppm	ASTM D5185m	450	62	66	38
Calcium	ppm	ASTM D5185m	3000	2389	2157	2029
Phosphorus	ppm	ASTM D5185m	1150	928	839	784
Zinc	ppm	ASTM D5185m	1350	1120	1019	984
Sulfur	ppm	ASTM D5185m	4250	4051	4059	3395
Oxidation	Abs/.1mm	*ASTM D7414	>25	9.2	8.9	13.6
Base Number (BN)	mg KOH/g	ASTM D2896	8.5	7.95	8.4	8.4
Visc @ 100°C	cSt	ASTM D445	14.4	13.7	13.6	14.4

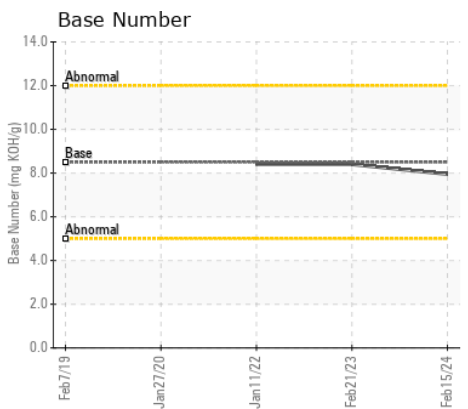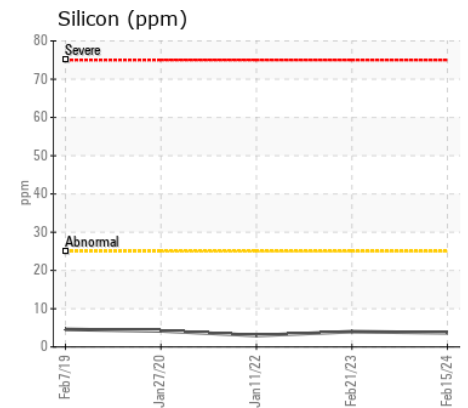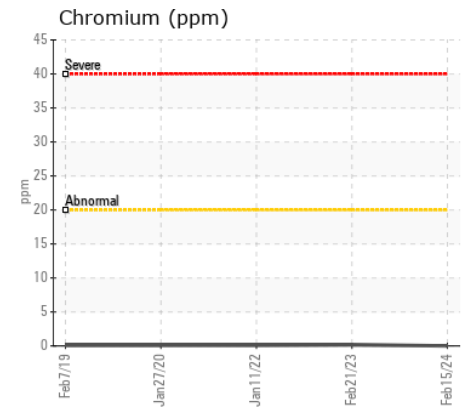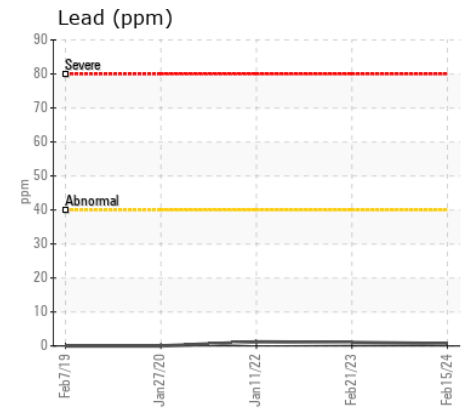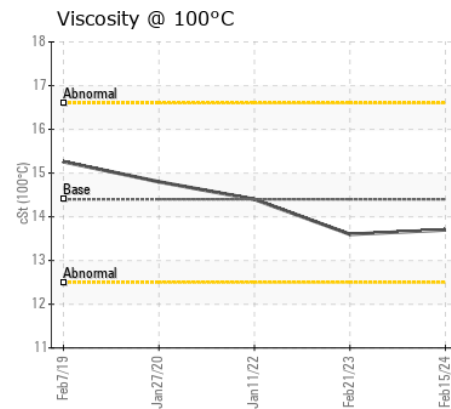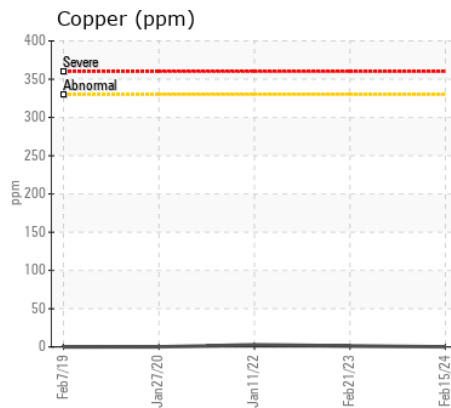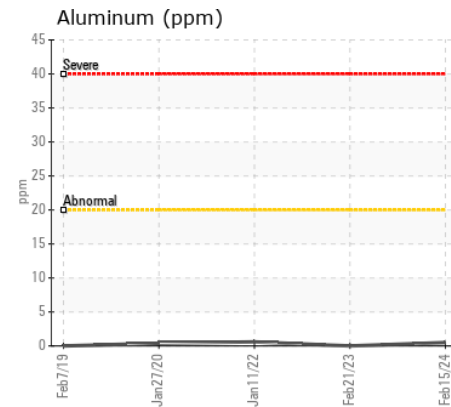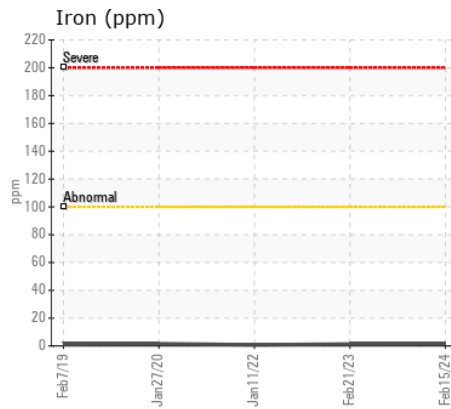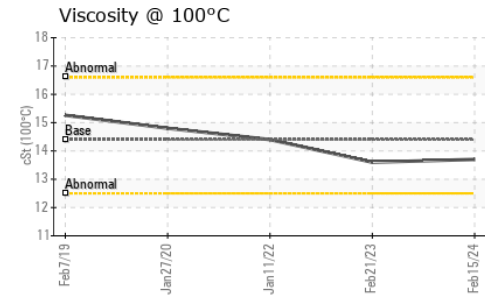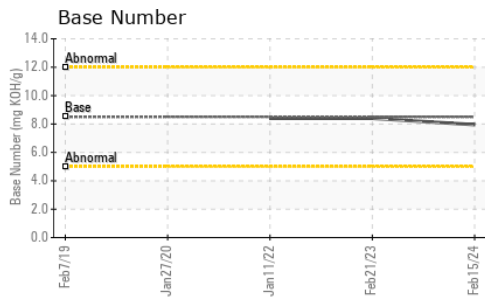

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : DC0033815
Lab Number : 06103189
Unique Number : 10901419
Test Package : MOB 2

Received : 28 Feb 2024
Tested : 29 Feb 2024
Diagnosed : 29 Feb 2024 - Wes Davis

KELLY GENERATOR & EQUIPMENT INC
 1955 DALE LN
 OWINGS, MD
 US 20736
 Contact: LESLIE SNURR
 LSNURR@KGE.COM
 T: (410)257-5225
 F: (410)257-5227

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)