

Machine Id 945016 Component Natural Gas Engine Fluid PETRO CANADA DURON GEO LD 15W40 (28 QTS)

PETRO CANADA DURON GEO LD 15W40 (28 C	(כוג						
RECOMMENDATION	Test	UOM	Method	Limit/Abn	Current	History1	History2
Resample at the next service interval to monitor.	Sample Number		Client Info		GFL0106765	GFL0084645	GFL008462
	Sample Date		Client Info		27 Feb 2024	06 Nov 2023	19 Oct 202
	Machine Age	hrs	Client Info		757	310	0
	Oil Age	hrs	Client Info		310	0	0
	Filter Age	hrs	Client Info		310	0	0
	Oil Changed		Client Info		Changed	Changed	Changed
	Filter Changed		Client Info		Changed	Changed	Changed
	Sample Status				NORMAL	NORMAL	NORMAL
WEAR	Iron	ppm	ASTM D5185m	>50	12	4	13
	Chromium	ppm	ASTM D5185m	>4	<1	0	<1
Metal levels are typical for a new component breaking in.	Nickel	ppm	ASTM D5185m	>2	0	0	0
	Titanium	ppm	ASTM D5185m		0	0	0
	Silver	ppm	ASTM D5185m	>3	0	0	0
	Aluminum	ppm	ASTM D5185m	>9	3	<1	2
	Lead	ppm	ASTM D5185m	>30	0	0	2
	Copper	ppm	ASTM D5185m	>35	13	2	15
	Tin	ppm	ASTM D5185m	>4	<1	0	0
	Vanadium	ppm	ASTM D5185m		0	0	0
	White Metal	scalar	*Visual	NONE	NONE	NONE	NONE
	Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE
CONTAMINATION	Silicon	ppm	ASTM D5185m	>+100	3	3	4
	Potassium	ppm	ASTM D5185m	>20	<1	1	2
There is no indication of any contamination in the oil.	Water		WC Method	>0.1	NEG	NEG	NEG
	Soot %	%	*ASTM D7844		0	0	0
	Nitration	Abs/cm	*ASTM D7624	>20	9.8	7.5	9.8
	Sulfation	Abs/.1mm	*ASTM D7415	>30	21.5	19.3	19.7
	Silt	scalar	*Visual	NONE	NONE	NONE	NONE
	Debris	scalar	*Visual	NONE	NONE	NONE	NONE
	Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
	Appearance	scalar	*Visual	NORML	NORML	NORML	NORM
	Odor	scalar	*Visual	NORML	NORML	NORML	NORM
	Emulsified Water	scalar	*Visual	>0.1	NEG	NEG	NEG
	Sodium	ppm	ASTM D5185m		7	4	8
	Boron		ASTM D5185m	50	11	30	7
The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.	Barium	ppm	ASTM D5185m		0	0	0
	Molybdenum	ppm	ASTM D5185m	50	52	48	50
	Manganese	ppm	ASTM D5185m	0	<1	0	<1
	Magnesium	ppm	ASTM D5185m	560	545	586	589
	Calcium	ppm	ASTM D5185m	1510	1594	1714	1452
	Phosphorus	ppm	ASTM D5185m		696	854	694
	Zinc	ppm	ASTM D5185m		946	1035	903
	Sulfur	ppm	ASTM D5185m		2363	2689	2194
	Oxidation	Abs/.1mm	*ASTM D7414	>25	17.9	16.7	17.8

Base Number (BN) mg KOH/g ASTM D2896 10.2

Visc @ 100°C cSt ASTM D445 15.1


14.7

8.1 5.4

14.9

4.6

14.7

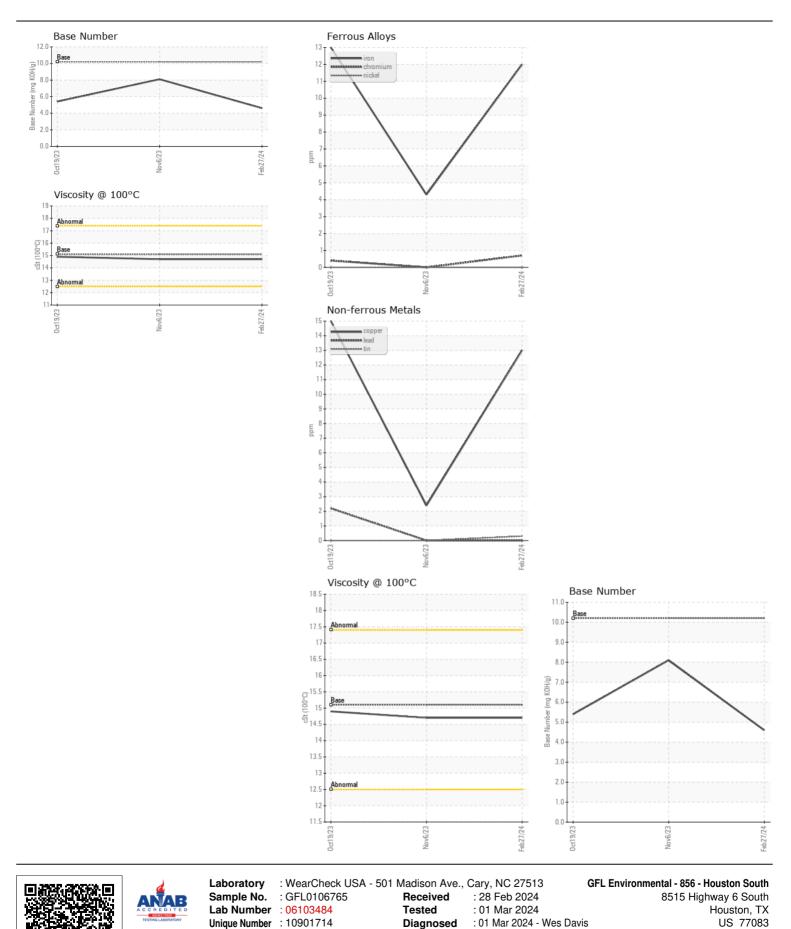

 Certificate L2367
 Test Package
 : FLEET

 To discuss this sample report, contact Customer Service at 1-800-237-1369.
 ;

 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 ;

 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Submitted By: Apolinar Zacarias Page 2 of 2

Contact: Jose Gonzalez

jgonzalez2@gflenv.com

Т:

F: