



WEAR	<b>NORMAL</b>
CONTAMINATION	<b>NORMAL</b>
FLUID CONDITION	<b>NORMAL</b>

Area  
**PALASYN 45**  
Machine Id  
**PALATEK 11K007 - MS LIGNITE**  
Component  
**Compressor**

### RECOMMENDATION

Resample at the next service interval to monitor.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		<b>UCS06104426</b>	UCS05403809	UCS04920141
Sample Date		Client Info		<b>20 Feb 2024</b>	02 Nov 2021	14 Feb 2020
Machine Age	hrs	Client Info		<b>0</b>	0	36652
Oil Age	hrs	Client Info		<b>0</b>	0	0
Filter Age	hrs	Client Info		<b>0</b>	0	0
Oil Changed		Client Info		<b>Not Changd</b>	Changed	N/A
Filter Changed		Client Info		<b>Changed</b>	Changed	Not Changed
Sample Status				<b>NORMAL</b>	ATTENTION	NORMAL

### WEAR

All component wear rates are normal.

Iron	ppm	ASTM D5185m	>50	<b>0</b>	0	0
Chromium	ppm	ASTM D5185m	>10	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m		<b>0</b>	0	0
Titanium	ppm	ASTM D5185m		<b>0</b>	0	0
Silver	ppm	ASTM D5185m		<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m	>25	<b>0</b>	0	0
Lead	ppm	ASTM D5185m	>25	<b>0</b>	0	0
Copper	ppm	ASTM D5185m	>50	<b>0</b>	0	0
Tin	ppm	ASTM D5185m	>15	<b>0</b>	0	0
Vanadium	ppm	ASTM D5185m		<b>&lt;1</b>	0	0
White Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE

### CONTAMINATION







There is no indication of any contamination in the oil.

Silicon	ppm	ASTM D5185m	>25	<b>2</b>	1	1
Potassium	ppm	ASTM D5185m	>20	<b>0</b>	0	0
Water		WC Method	>0.1	<b>NEG</b>	NEG	NEG
Silt	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Debris	scalar	*Visual	NONE	<b>NONE</b>	VLITE	NONE
Sand/Dirt	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Appearance	scalar	*Visual	NORML	<b>NORML</b>	NORML	NORML
Odor	scalar	*Visual	NORML	<b>NORML</b>	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	<b>NEG</b>	0.2%	NEG

### FLUID CONDITION

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

Sodium	ppm	ASTM D5185m		<b>0</b>	0	<1
Boron	ppm	ASTM D5185m	0.0	<b>&lt;1</b>	0	0
Barium	ppm	ASTM D5185m	0.0	<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m	0	<b>0</b>	0	0
Manganese	ppm	ASTM D5185m	0	<b>0</b>	0	0
Magnesium	ppm	ASTM D5185m	0.0	<b>0</b>	0	0
Calcium	ppm	ASTM D5185m	0.0	<b>0</b>	0	0
Phosphorus	ppm	ASTM D5185m	966	<b>536</b>	514	634
Zinc	ppm	ASTM D5185m	0	<b>0</b>	0	9
Sulfur	ppm	ASTM D5185m	1309	<b>1119</b>	822	428
Acid Number (AN)	mg KOH/g	ASTM D8045	0.172	<b>0.08</b>	0.11	0.100
Visc @ 40°C	cSt	ASTM D445	39.9	<b>42.6</b>	42.2	40.9

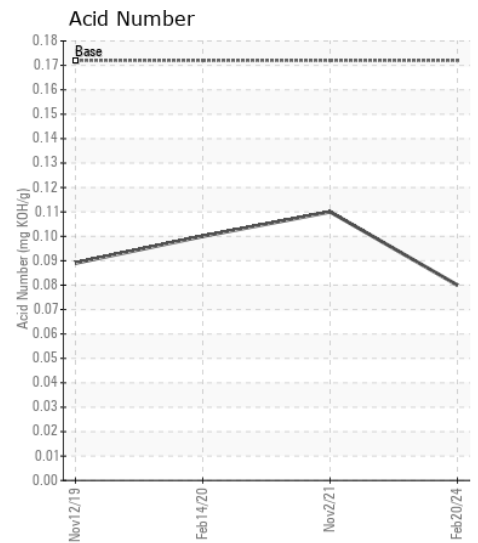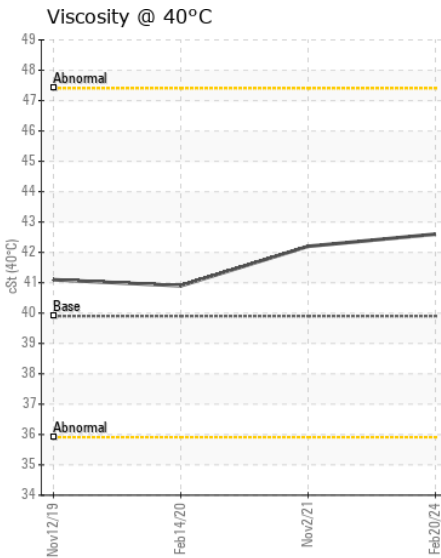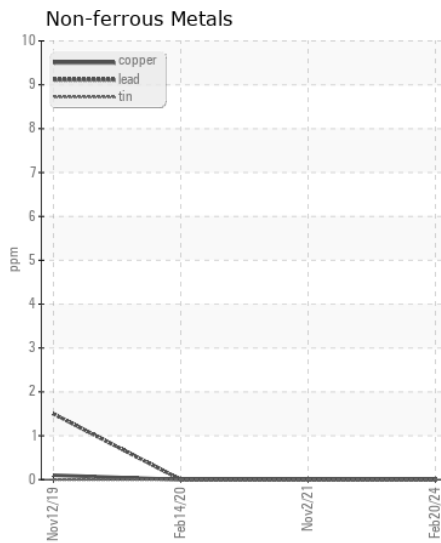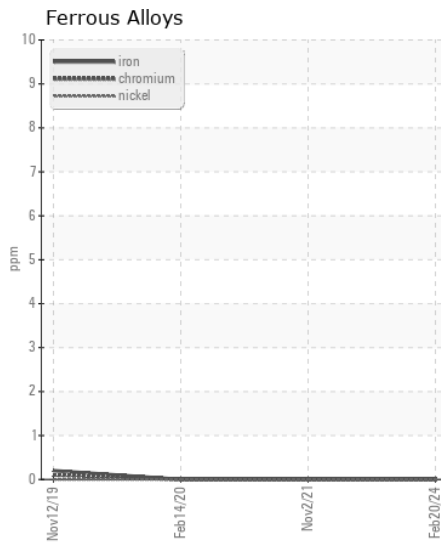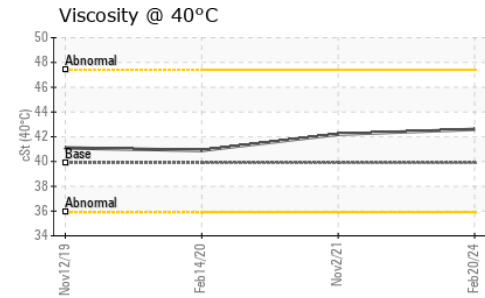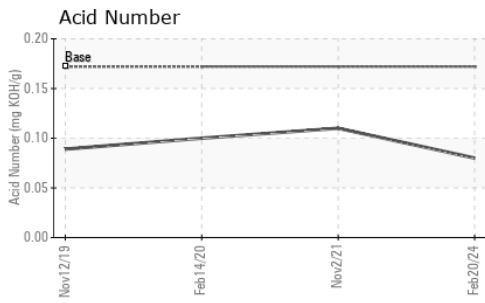

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : UCS06104426  
**Lab Number** : 06104426  
**Unique Number** : 10902656  
**Test Package** : IND 2

**Received** : 29 Feb 2024  
**Tested** : 01 Mar 2024  
**Diagnosed** : 03 Mar 2024 - Doug Bogart

**QUALITY COMPRESSED AIR SERVICES INC**  
 184 CONCOURSE DR  
 PEARL, MS  
 US 39208  
 Contact: EUGENA DOBSON  
 eugena@qcas-inc.com  
 T: (601)932-7288  
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)