MOB II WEAR CHECK

OIL ANALYSIS REPORT

WEAR	NORMAL
CONTAMINATION	NORMAL
FLUID CONDITION	NORMAL

Area
WCLSNC
Machine Id
QC230801DE
Component
Diesel Engine
Fluid
PETRO CANADA DURON SHP 15W40 (--- GAL)

RECOMMENDATION

Resample at the next service interval to monitor.

WEAR

All component wear rates are normal.

CONTAMINATION

There is no indication of any contamination in the oil.

FLUID CONDITION

The BN result indicates that there is suitable alkalinity remaining in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		**WC0906345**	WC0906344	WC0906343
Sample Date		Client Info		**29 Feb 2024**	28 Feb 2024	27 Feb 2024
Machine Age	hrs	Client Info		**0**	0	0
Oil Age	hrs	Client Info		**0**	0	0
Filter Age	hrs	Client Info		**0**	0	0
Oil Changed		Client Info		**N/A**	N/A	N/A
Filter Changed		Client Info		**N/A**	N/A	N/A
Sample Status				**NORMAL**	---	---
Iron	ppm	ASTM D5185m	>11	**8**	8	10
Chromium	ppm	ASTM D5185m	>3	**<1**	<1	<1
Nickel	ppm	ASTM D5185m	>2	**<1**	0	0
Titanium	ppm	ASTM D5185m	>2	**0**	0	0
Silver	ppm	ASTM D5185m	>2	**0**	0	0
Aluminum	ppm	ASTM D5185m	>5	**2**	2	2
Lead	ppm	ASTM D5185m	>2	**<1**	<1	0
Copper	ppm	ASTM D5185m	>7	**4**	3	4
Tin	ppm	ASTM D5185m	>2	**<1**	<1	0
Vanadium	ppm	ASTM D5185m		**<1**	0	0
White Metal	scalar	*Visual	NONE	**NONE**	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	**NONE**	NONE	NONE
Silicon	ppm	ASTM D5185m	>14	**4**	5	4
Potassium	ppm	ASTM D5185m	>20	**2**	1	2
Fuel	%	ASTM D3524	>4.1	**2.4**	2.5	2.4
Water	%	ASTM D6304	>0.2	**NEG**	NEG	NEG
Glycol	%	*ASTM D2982		**NEG**	NEG	NEG
Soot %	%	*ASTM D7844	>0.3	**0.1**	0.1	0.1
Nitration	Abs/cm	*ASTM D7624	>10.8	**10.4**	10.3	10.3
Sulfation	Abs/.1mm	*ASTM D7415	>20.8	**20.0**	20.0	20.3
Silt	scalar	*Visual	NONE	**NONE**	NONE	NONE
Debris	scalar	*Visual	NONE	**NONE**	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	**NONE**	NONE	NONE
Appearance	scalar	*Visual	NORML	**NORML**	NORML	NORML
Odor	scalar	*Visual	NORML	**NORML**	NORML	NORML
Emulsified Water	scalar	*Visual	>0.2	**NEG**	NEG	NEG
Sodium	ppm	ASTM D5185m	>13	**6**	6	7
Boron	ppm	ASTM D5185m	0	**6**	6	6
Barium	ppm	ASTM D5185m	0	**0**	0	0
Molybdenum	ppm	ASTM D5185m	60	**50**	▲ 47	▲ 60
Manganese	ppm	ASTM D5185m	0	**<1**	0	0
Magnesium	ppm	ASTM D5185m	1010	**635**	543	▲ 746
Calcium	ppm	ASTM D5185m	1070	**1740**	1539	▲ 1945
Phosphorus	ppm	ASTM D5185m	1150	**758**	704	▲ 945
Zinc	ppm	ASTM D5185m	1270	**1101**	933	▲ 1350
Sulfur	ppm	ASTM D5185m	2060	**2525**	2372	3311
Oxidation	Abs/.1mm	*ASTM D7414	>17.9	**17.5**	17.5	17.3
Acid Number (AN)	mg KOH/g	ASTM D8045	3.2	**0.37**	1.67	2.10
Base Number (BN)	mg KOH/g	ASTM D2896	9.8	**7.17**	7.20	7.35
Visc @ 40°C	cSt	ASTM D445	113.9	**98.7**	98.4	100
Visc @ 100°C	cSt	ASTM D445	15.4	**13.3**	13.5	13.4
Viscosity Index (VI)	Scale	ASTM D2270	142	**133**	137	133

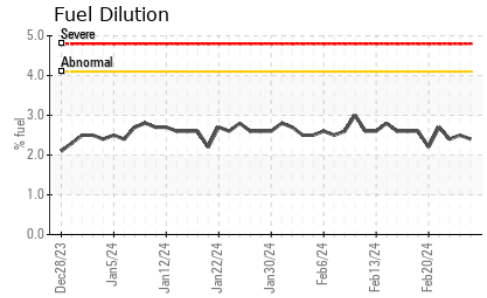

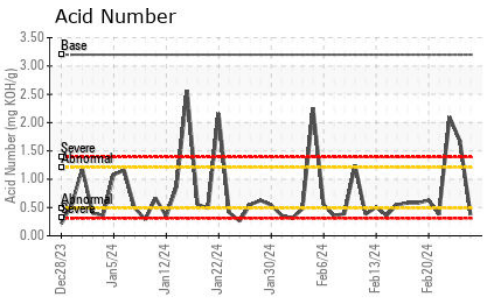

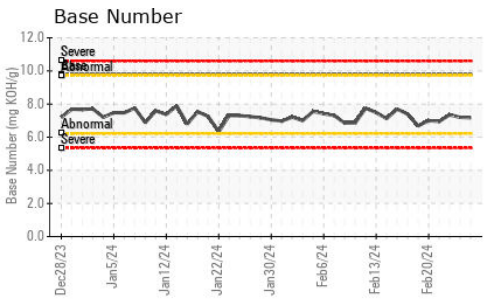

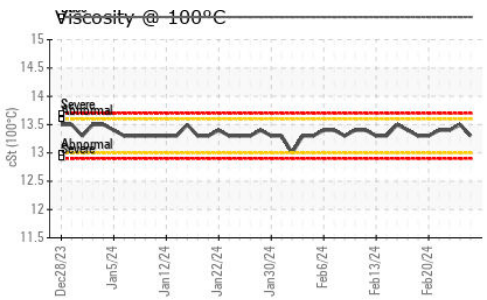

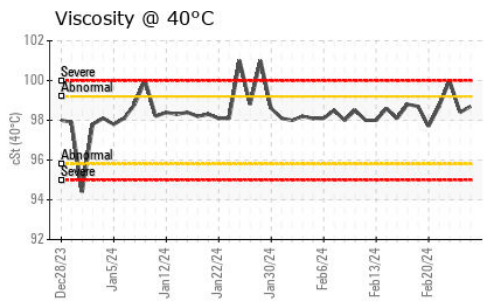

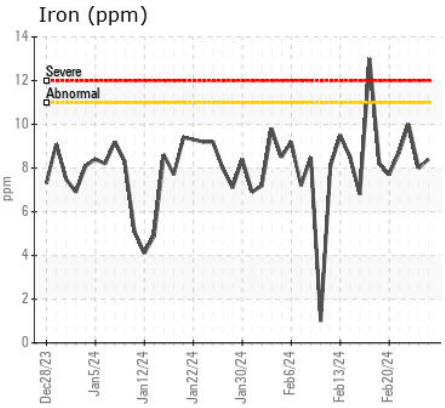

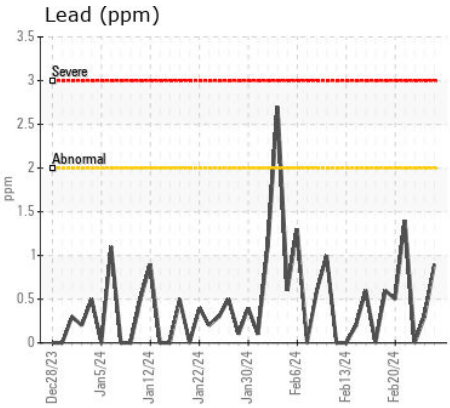

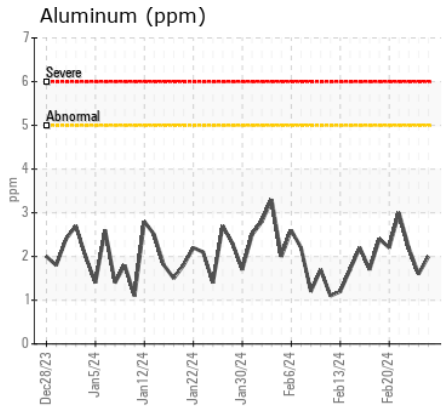

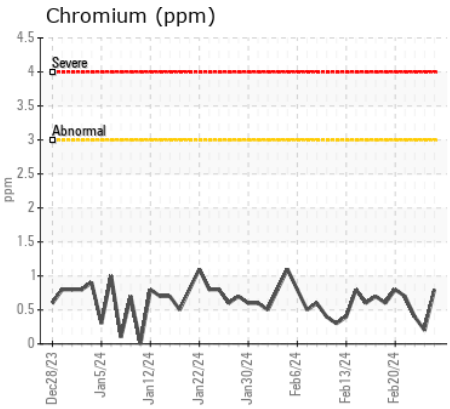

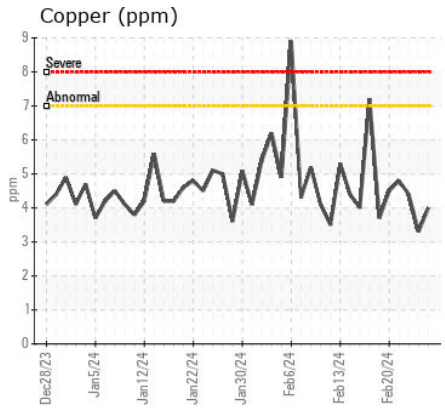

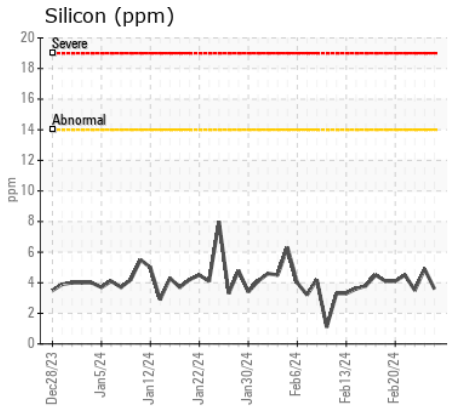

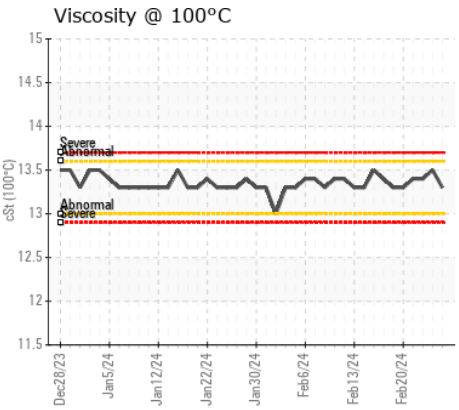

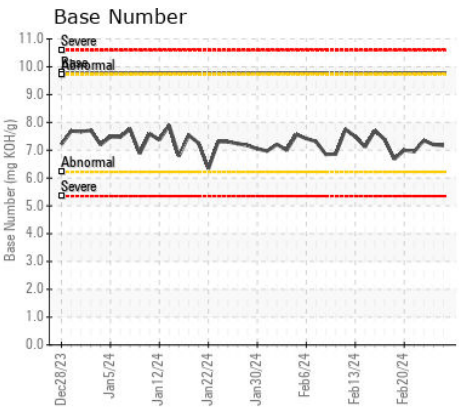

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0906345
Lab Number : 06104502
Unique Number : 10902732
Test Package : MOB 2 (Additional Tests: FuelDilution, Glycol, KF, KV40, PercentFuel, VI)

Received : 29 Feb 2024
Tested : 04 Mar 2024
Diagnosed : 04 Mar 2024 - Jonathan Hester

To discuss this sample report, contact Customer Service at 1-800-237-1369.
** - Denotes test methods that are outside of the ISO 17025 scope of accreditation.*
Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

WEARCHECK LUBRICATION SERVICES QA ACCOUNT
501 Madison Ave
Cary, NC
US 27513
Contact: WCLS CARY NC
T: (919)379-4102
F: (919)379-4050