



OIL ANALYSIS REPORT

WEAR	NORMAL
CONTAMINATION	NORMAL
FLUID CONDITION	NORMAL



Machine Id
WVTM01BE
Component
Biogas Engine
Fluid
MOBIL PEGASUS 605 (--- GAL)

RECOMMENDATION

Resample at the next service interval to monitor. Please note that this is a corrected copy for laboratory data and diagnostic comment updates. (Customer Sample Comment: Oil sample only)

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		WC0895545	WC0785398	WC0785400
Sample Date		Client Info		26 Feb 2024	21 Feb 2024	16 Feb 2024
Machine Age	hrs	Client Info		114351	114229	114110
Oil Age	hrs	Client Info		488	366	247
Filter Age	hrs	Client Info		488	366	247
Oil Changed		Client Info		Not Changd	Not Changd	Not Changd
Filter Changed		Client Info		Not Changd	Not Changd	Not Changd
Sample Status				NORMAL	NORMAL	NORMAL

WEAR

All component wear rates are normal.

Iron	ppm	ASTM D5185m	>15	5	4	4
Chromium	ppm	ASTM D5185m	>4	<1	0	0
Nickel	ppm	ASTM D5185m	>2	<1	<1	0
Titanium	ppm	ASTM D5185m		0	0	0
Silver	ppm	ASTM D5185m	>5	0	0	0
Aluminum	ppm	ASTM D5185m	>6	2	2	2
Lead	ppm	ASTM D5185m	>9	1	1	0
Copper	ppm	ASTM D5185m	>6	<1	1	<1
Tin	ppm	ASTM D5185m	>4	3	3	1
Vanadium	ppm	ASTM D5185m		<1	0	0
White Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE

CONTAMINATION












There is no indication of any contamination in the oil.

Silicon	ppm	ASTM D5185m	>181	145	115	83
Potassium	ppm	ASTM D5185m	>20	<1	<1	0
Fuel		WC Method	>4.0	<1.0	<1.0	<1.0
Water		WC Method	>0.1	NEG	NEG	NEG
Glycol		WC Method		NEG	NEG	NEG
Soot %	%	*ASTM D7844		0	0	0
Nitration	Abs/cm	*ASTM D7624	>20	3.6	3.4	3.2
Sulfation	Abs/.1mm	*ASTM D7415	>30	23.9	22.4	20.6
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG	NEG

FLUID CONDITION

The BN result indicates that there is suitable alkalinity remaining in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

Sodium	ppm	ASTM D5185m		16	19	21
Boron	ppm	ASTM D5185m		47	58	73
Barium	ppm	ASTM D5185m		0	0	0
Molybdenum	ppm	ASTM D5185m		3	2	4
Manganese	ppm	ASTM D5185m		0	<1	0
Magnesium	ppm	ASTM D5185m		12	19	17
Calcium	ppm	ASTM D5185m		1844	1543	1574
Phosphorus	ppm	ASTM D5185m		388	360	385
Zinc	ppm	ASTM D5185m		636	558	542
Sulfur	ppm	ASTM D5185m		5003	4572	4328
Oxidation	Abs/.1mm	*ASTM D7414	>25	12.2	11.2	10.2
Acid Number (AN)	mg KOH/g	ASTM D8045		2.19	1.91	1.29
Base Number (BN)	mg KOH/g	ASTM D2896	7.1	2.83	3.20	3.31
Visc @ 100°C	cSt	ASTM D445	13.3	14.6	14.6	14.1

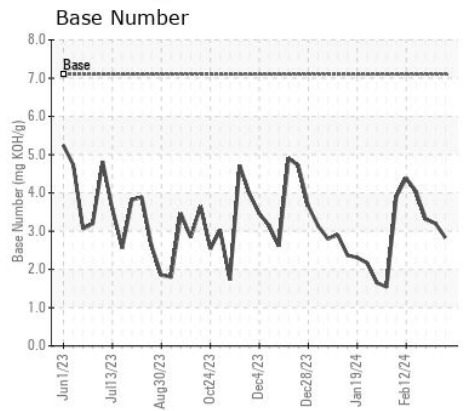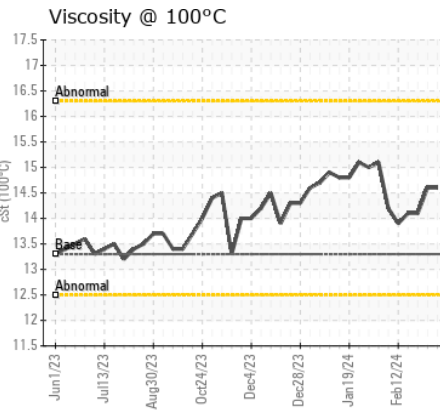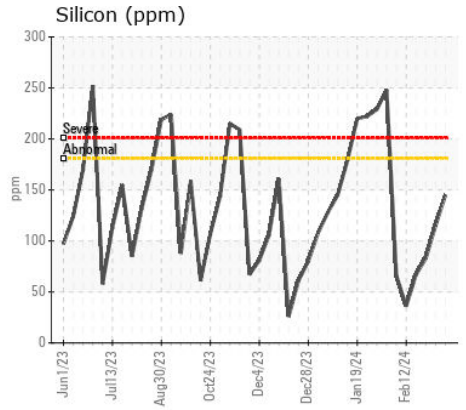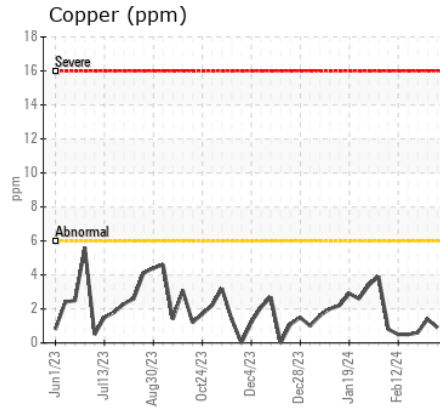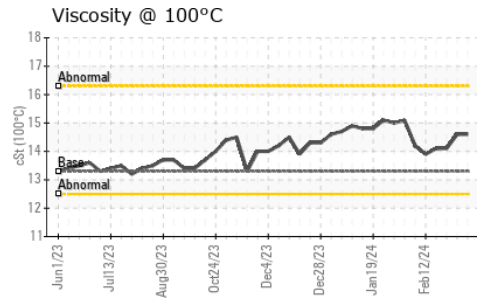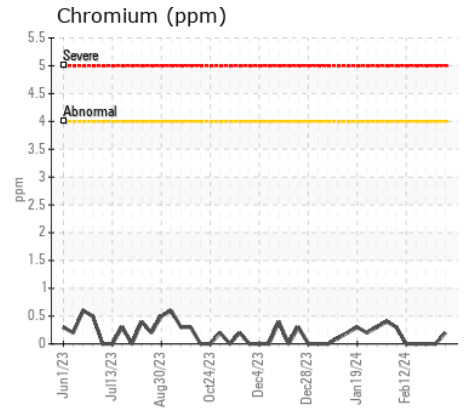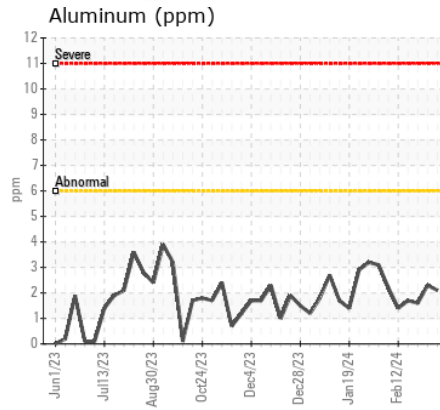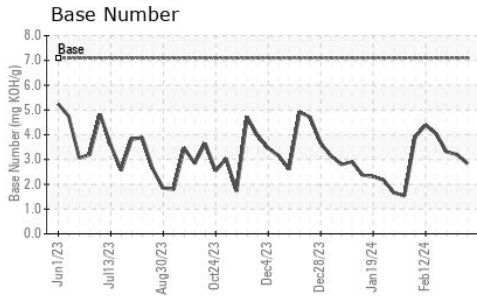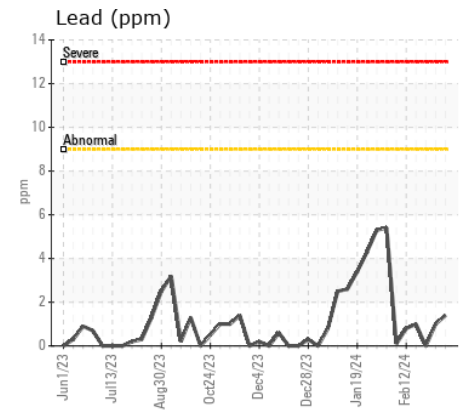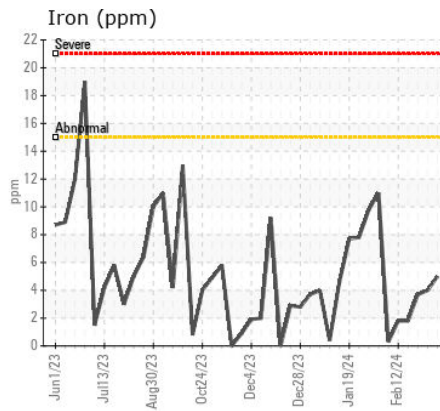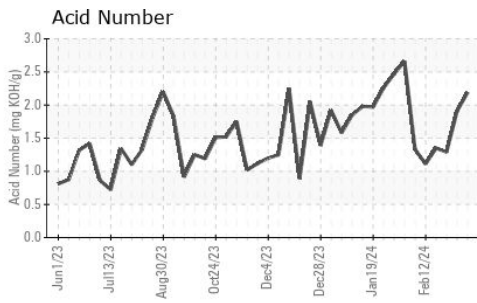

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0895545
Lab Number : 06104504
Unique Number : 10902734
Test Package : MOB 2

Received : 29 Feb 2024
Tested : 01 Mar 2024
Diagnosed : 04 Mar 2024 - Doug Bogart

EDL NA Recips-Watervliet
 Watervliet Powerstation, 3563 Hennessey Road
 Watervliet, MI
 US 49098
 Contact: Scott Eastman
 scott.eastman@edlenergy.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
F: