

Machine Id  
**G100**  
Component  
**Biogas Engine**  
Fluid  
**PETRO CANADA SENTRON LD 5000 (--- GAL)**

**RECOMMENDATION**

Resample at the next service interval to monitor.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		<b>PCA0069056</b>	PCA0069055	PCA0069053
Sample Date		Client Info		<b>23 Feb 2024</b>	17 Jan 2024	21 Oct 2023
Machine Age	hrs	Client Info		<b>12829</b>	12483	10668
Oil Age	hrs	Client Info		<b>0</b>	1268	0
Filter Age	hrs	Client Info		<b>0</b>	0	0
Oil Changed		Client Info		<b>N/A</b>	Not Changd	N/A
Filter Changed		Client Info		<b>N/A</b>	Not Changd	N/A
Sample Status				<b>NORMAL</b>	NORMAL	NORMAL

**WEAR**

All component wear rates are normal.

Iron	ppm	ASTM D5185m	>45	<b>26</b>	29	30
Chromium	ppm	ASTM D5185m	>2	<b>&lt;1</b>	1	<1
Nickel	ppm	ASTM D5185m	>2	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m		<b>0</b>	0	0
Silver	ppm	ASTM D5185m	>5	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m	>10	<b>1</b>	1	1
Lead	ppm	ASTM D5185m	>5	<b>3</b>	2	<1
Copper	ppm	ASTM D5185m	>14	<b>&lt;1</b>	0	<1
Tin	ppm	ASTM D5185m	>13	<b>1</b>	<1	<1
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	0
White Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE

**CONTAMINATION**












There is no indication of any contamination in the oil.

Silicon	ppm	ASTM D5185m	>200	<b>3</b>	4	3
Potassium	ppm	ASTM D5185m	>20	<b>2</b>	2	<1
Fuel		WC Method	>4.0	<b>&lt;1.0</b>	<1.0	<1.0
Water		WC Method	>0.1	<b>NEG</b>	NEG	NEG
Glycol		WC Method		<b>NEG</b>	NEG	NEG
Soot %	%	*ASTM D7844		<b>0.1</b>	0.1	0
Nitration	Abs/cm	*ASTM D7624	>20	<b>8.5</b>	8.0	5.4
Sulfation	Abs/.1mm	*ASTM D7415	>30	<b>23.7</b>	23.2	17.0
Silt	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Debris	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Appearance	scalar	*Visual	NORML	<b>NORML</b>	NORML	NORML
Odor	scalar	*Visual	NORML	<b>NORML</b>	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	<b>NEG</b>	NEG	NEG

**FLUID CONDITION**

The BN result indicates that there is suitable alkalinity remaining in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

Sodium	ppm	ASTM D5185m		<b>6</b>	6	5
Boron	ppm	ASTM D5185m	2	<b>&lt;1</b>	0	1
Barium	ppm	ASTM D5185m	3	<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m	0	<b>&lt;1</b>	<1	2
Manganese	ppm	ASTM D5185m	0	<b>&lt;1</b>	<1	<1
Magnesium	ppm	ASTM D5185m	4	<b>24</b>	25	14
Calcium	ppm	ASTM D5185m	1727	<b>2093</b>	2127	1857
Phosphorus	ppm	ASTM D5185m	272	<b>344</b>	359	308
Zinc	ppm	ASTM D5185m	333	<b>449</b>	458	408
Sulfur	ppm	ASTM D5185m	3415	<b>3451</b>	3470	3530
Oxidation	Abs/.1mm	*ASTM D7414	>25	<b>21.7</b>	20.3	11.0
Acid Number (AN)	mg KOH/g	ASTM D8045	1.1	<b>2.73</b>	2.53	0.80
Base Number (BN)	mg KOH/g	ASTM D2896	4.9	<b>3.25</b>	3.48	6.06
Visc @ 100°C	cSt	ASTM D445	13.4	<b>14.6</b>	14.5	13.5

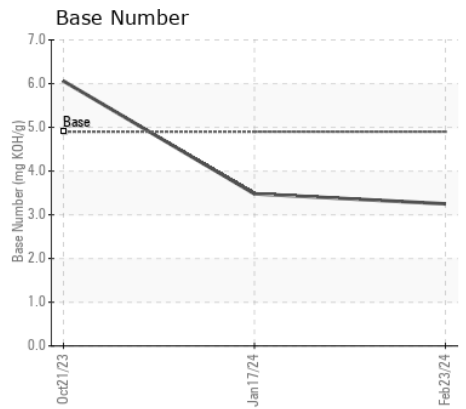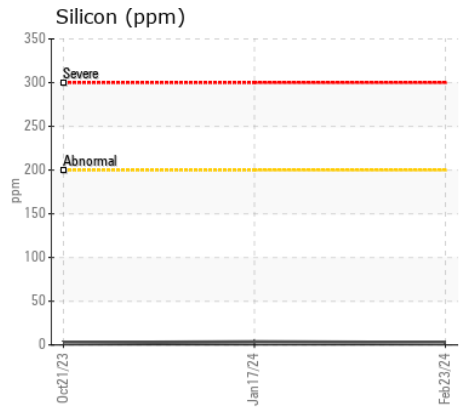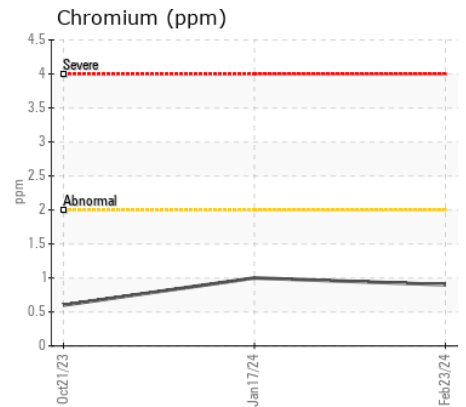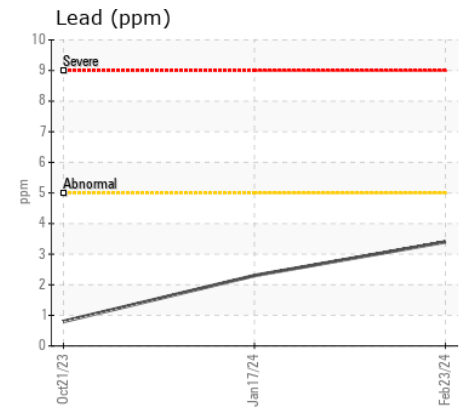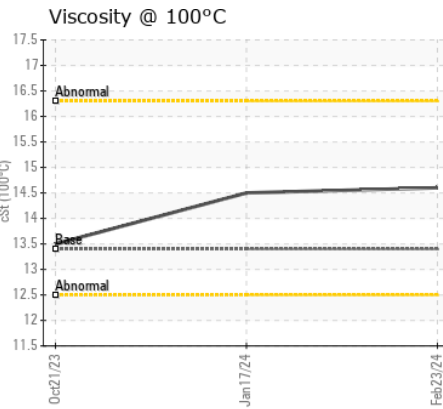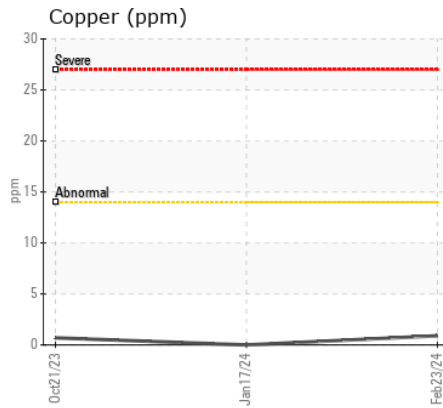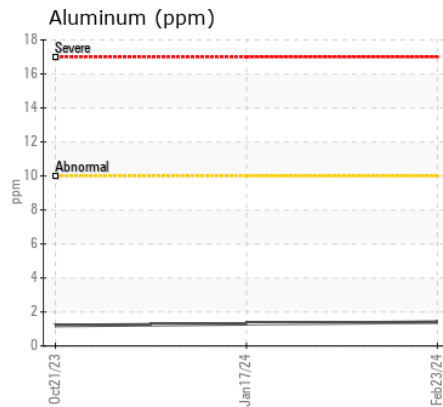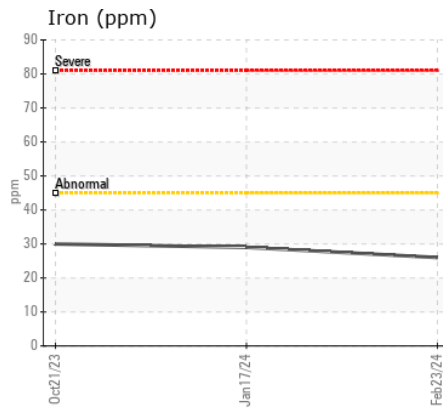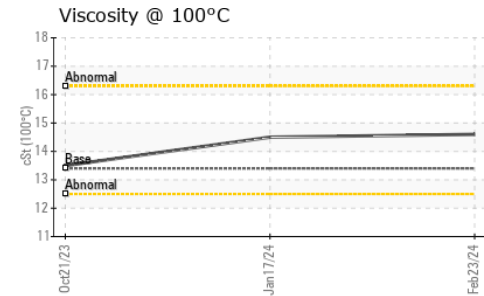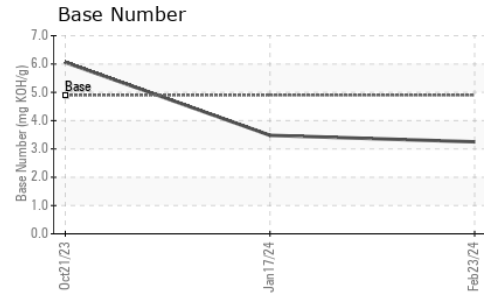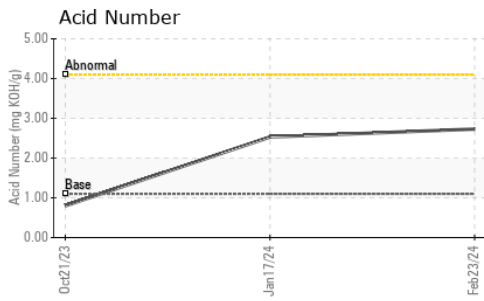

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : PCA0069056  
**Lab Number** : 06105400  
**Unique Number** : 10903630  
**Test Package** : MOB 2

**Received** : 29 Feb 2024  
**Tested** : 01 Mar 2024  
**Diagnosed** : 04 Mar 2024 - Sean Felton

**YAAMAVA RESORT AND CASINO**  
 777 SAN MANUEL BLVD  
 HIGHLAND, CA  
 US 92346  
 Contact: JOSHUA AVILA  
 joshua.avila@yaamava.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:  
F: