



FUEL REPORT

CORROSION	NORMAL
CONTAMINANTS	NORMAL
FUEL CONDITION	NORMAL

Machine Id
MTU 10V1600 DS500 95010500314

Component
Diesel Fuel
 Fluid
{not provided} (--- QTS)

RECOMMENDATION

All laboratory tests indicate that this sample meets specifications for No.2 ultra-low-sulfur diesel fuel.

CORROSION

All metal levels are normal indicating no corrosion in the system.




CONTAMINANTS

The water content is negligible. There is no bacteria or fungus (yeast and/or mold) indicated in the sample. There is no indication of any contamination in the fuel.

FUEL CONDITION

Sulfur value derived by ASTM D5453 method for ULSD validation. Sulfur level is acceptable for ULSD specification.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		DC0035928	---	---
Sample Date		Client Info		27 Feb 2024	---	---
Machine Age	hrs	Client Info		52	---	---
Sample Status				NORMAL	---	---
Aluminum	ppm	ASTM D5185m	<0.1	0	---	---
Nickel	ppm	ASTM D5185m	<0.1	0	---	---
Lead	ppm	ASTM D5185m	<0.1	0	---	---
Vanadium	ppm	ASTM D5185m	<0.1	0	---	---
Iron	ppm	ASTM D5185m	<0.1	0	---	---
Silicon	ppm	ASTM D5185m	<1.0	0	---	---
Sodium	ppm	ASTM D5185m	<0.1	0	---	---
Potassium	ppm	ASTM D5185m	<0.1	0	---	---
Water	%	ASTM D6304	<0.05	0.001	---	---
ppm Water	ppm	ASTM D6304	<500	8	---	---
% Gasoline	%	*In-House	<0.50	0.0	---	---
% Biodiesel	%	*In-House	<20.0	0.0	---	---
Calcium	ppm	ASTM D5185m	<0.1	0	---	---
Magnesium	ppm	ASTM D5185m	<0.1	0	---	---
Phosphorus	ppm	ASTM D5185m	<0.1	0	---	---
Zinc	ppm	ASTM D5185m	<0.1	0	---	---
ASTM Color	scalar	*ASTM D1500		L4.5	---	---
Visc @ 40°C	cSt	ASTM D445		2.53	---	---
Sulfur	ppm	ASTM D5185m		0	---	---
Sulfur (UVF)	ppm	ASTM D5453		11	---	---
API Gravity		ASTM D7777		36.8	---	---

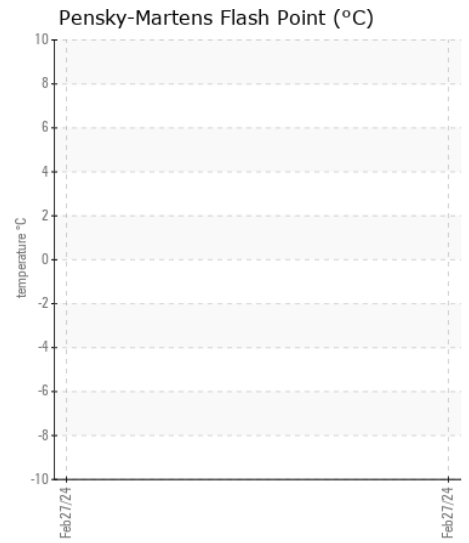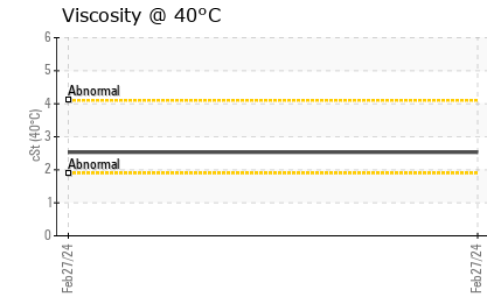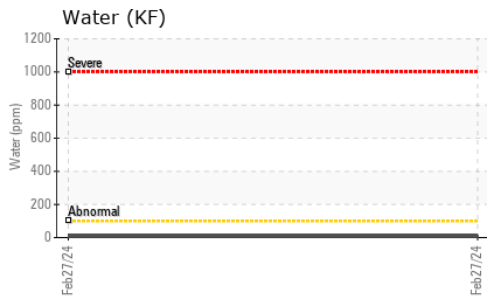

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513

Sample No. : DC0035928

Lab Number : 06122858

Unique Number : 10937009

Test Package : DF-5 (Additional Tests: API, Cetane, Fuel, Screen)

Received : 19 Mar 2024

Tested : 07 Apr 2024

Diagnosed : 07 Apr 2024 - Doug Bogart

KELLY GENERATOR & EQUIPMENT INC

1955 DALE LN

OWINGS, MD

US 20736

Contact: LESLIE SNURR

LSNURR@KGE.COM

T: (410)257-5225

F: (410)257-5227

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)