WEAR CONTAMINATION FLUID CONDITION


NORMAL NORMAL

Machine Id **742006**

Component Natural Gas Engine

PETRO CANADA DURON GEO LD 15W40 (--- GAL)

RECOMMENDATION	Test	UOM	Method	Limit/Abn	Current	History1	History2
Resample at the next service interval to monitor.	Sample Number	OCIVI	Client Info	LIIIIUAUII	GFL0108347		
	Sample Date		Client Info		15 Mar 2024		
	Machine Age	hrs	Client Info		391		
	Oil Age	hrs	Client Info		391		
	Filter Age	hrs	Client Info		0		
	Oil Changed	0	Client Info		Changed		
	Filter Changed		Client Info		Changed		
	Sample Status				NORMAL		
WEAR Metal levels are typical for a components first oil change.	Iron	ppm	ASTM D5185m	>50	23		
	Chromium	ppm	ASTM D5185m	>4	3		
	Nickel	ppm	ASTM D5185m	>2	0		
	Titanium	ppm	ASTM D5185m		0		
	Silver	ppm	ASTM D5185m	>3	0		
	Aluminum	ppm	ASTM D5185m	>9	2		
	Lead	ppm	ASTM D5185m	>30	3		
	Copper	ppm	ASTM D5185m	>35	1		
	Tin	ppm	ASTM D5185m	>4	0		
	Vanadium	ppm	ASTM D5185m		0		
	White Metal	scalar	*Visual	NONE	NONE		
	Yellow Metal	scalar	*Visual	NONE	NONE		
CONTAMINATION	0:1:		AOTM DE LOE	400	_		
	Silicon	ppm	ASTM D5185m		6		
There is no indication of any contamination in the oil.	Potassium	ppm	ASTM D5185m		4		
	Water	0.4	WC Method	>0.1	NEG		
	Soot %	%	*ASTM D7844		0		
	Nitration	Abs/cm	*ASTM D7624	>20	12.8		
	Sulfation	Abs/.1mm	*ASTM D7415		22.7		
	Silt	scalar	*Visual	NONE	NONE		
	Debris	scalar	*Visual	NONE	NONE		
	Sand/Dirt	scalar	*Visual	NONE	NONE		
	Appearance Odor	scalar	*Visual	NORML	NORML		
		scalar	*Visual	NORML	NORML		
	Emulsified Water	scalar	*Visual	>0.1	NEG		
FLUID CONDITION	Sodium	ppm	ASTM D5185m		10		
The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.	Boron	ppm	ASTM D5185m	50	11		
	Barium	ppm	ASTM D5185m		0		
	Molybdenum	ppm	ASTM D5185m		70		
	Manganese	ppm	ASTM D5185m		<1		
	Magnesium	ppm	ASTM D5185m		671		
	Calcium	ppm	ASTM D5185m		1925		
	Phosphorus	ppm	ASTM D5185m		876		
	Zinc	ppm	ASTM D5185m		1155		
	Sulfur	ppm	ASTM D5185m		3318		
	Oxidation	Abs/.1mm	*ASTM D7414		18.4		
	Base Number (BN)		ASTM D2896		5.2		
	Visc @ 100°C	cSt	ASTM D445		14.6		

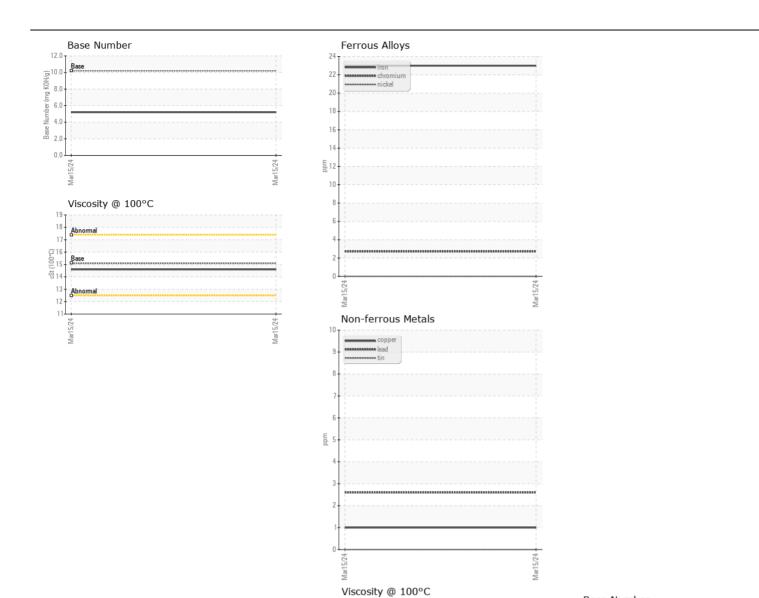

18.

(100°C)

13.

11.5

To discuss this sample report, contact Customer Service at 1-800-237-1369.



Certificate L2367

Laboratory Sample No.

Lab Number : 06123393 Unique Number : 10937544 Test Package : FLEET

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 : GFL0108347 Received

Tested Diagnosed

: 20 Mar 2024 : 21 Mar 2024

: 21 Mar 2024 - Wes Davis

Base Number

10.0 9.0

mg

GFL Environmental - 963 - Peoria HC Disposal 1113 N. Swords Ave. West Peoria, IL US 61604 Contact: Corey Dozard

cdozard@gflenv.com T:

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

F: