

WEAR CONTAMINATION FLUID CONDITION

NORMAL NORMAL


Aroa

[SILVER SEAS]

ONAN 201205

Component

Genset Fluid							
{not provided} (6 QTS) RECOMMENDATION	Test	UOM	Method	Limit/Abn	Current	History1	History2
	Sample Number	OOW	Client Info	LITTIOTOTT	VPA058330	VPA019789	
No corrective action is recommended at this time. Resample at the next service interval to monitor.	Sample Date		Client Info		14 Mar 2024	04 Jun 2020	
	Machine Age	hrs	Client Info		314	195	
	Oil Age	hrs	Client Info		314	195	
	Filter Age	hrs	Client Info		0	0	
	Oil Changed		Client Info		Not Changd	N/A	
	Filter Changed		Client Info		N/A	N/A	
	Sample Status				NORMAL	NORMAL	
WEAR	Iron	ppm	ASTM D5185m	>50	2	4	
All pages and the same states are marked	Chromium	ppm	ASTM D5185m	>4	<1	<1	
All component wear rates are normal.	Nickel	ppm	ASTM D5185m	>2	<1	0	
	Titanium	ppm	ASTM D5185m		<1	<1	
	Silver	ppm	ASTM D5185m	>5	0	0	
	Aluminum	ppm	ASTM D5185m	>12	2	1	
	Lead	ppm	ASTM D5185m	>17	<1	0	
	Copper	ppm	ASTM D5185m	>70	1	2	
	Tin	ppm	ASTM D5185m	>15	<1	0	
	Vanadium	ppm	ASTM D5185m		<1	0	
	White Metal	scalar	*Visual	NONE	NONE	NONE	
	Yellow Metal	scalar	*Visual	NONE	NONE	NONE	
CONTAMINATION	Silicon	ppm	ASTM D5185m	>25	6	9	
There is no indication of any contamination in the oil.	Potassium	ppm	ASTM D5185m	>20	3	0	
	Fuel		WC Method	>4.0	<1.0	<1.0	
	Water		WC Method	>0.1	NEG	NEG	
	Glycol		WC Method		NEG	NEG	
	Soot %	%	*ASTM D7844		0.1	0	
	Nitration	Abs/cm	*ASTM D7624	>20	5.9	6.6	
	Sulfation	Abs/.1mm	*ASTM D7415		17.2	18.8	
	Silt	scalar	*Visual	NONE	NONE	NONE	
	Debris	scalar	*Visual	NONE	NONE	NONE	
	Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	
	Appearance	scalar	*Visual	NORML	NORML	NORML	
	Odor	scalar	*Visual	NORML >0.1	NORML	NORML	
<u></u>	Emulsified Water	Scalar	visuai	>0.1	NEG	NEG	
FLUID CONDITION	Sodium	ppm	ASTM D5185m		3	4	
	Boron	ppm	ASTM D5185m		83	73	
The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is acceptable for the time in service.	Barium	ppm	ASTM D5185m		0	1	
	Molybdenum	ppm	ASTM D5185m		7	6	
	Manganese	ppm	ASTM D5185m		<1	<1	
	Magnesium	ppm	ASTM D5185m		714	546	
	Calcium	ppm	ASTM D5185m		1247	1152	
	Phosphorus	ppm	ASTM D5185m		704	578	
	Zinc	ppm	ASTM D5185m		816	677	
	Sulfur	ppm	ASTM D5185m		3158	1970	
	Oxidation	Abs/.1mm	*ASTM D7414	>25	11.9	13.4	
	Base Number (BN)	0 0	ASTM D2896		8.6		
	Visc @ 100°C	cSt	ASTM D445		13.8	13.62	

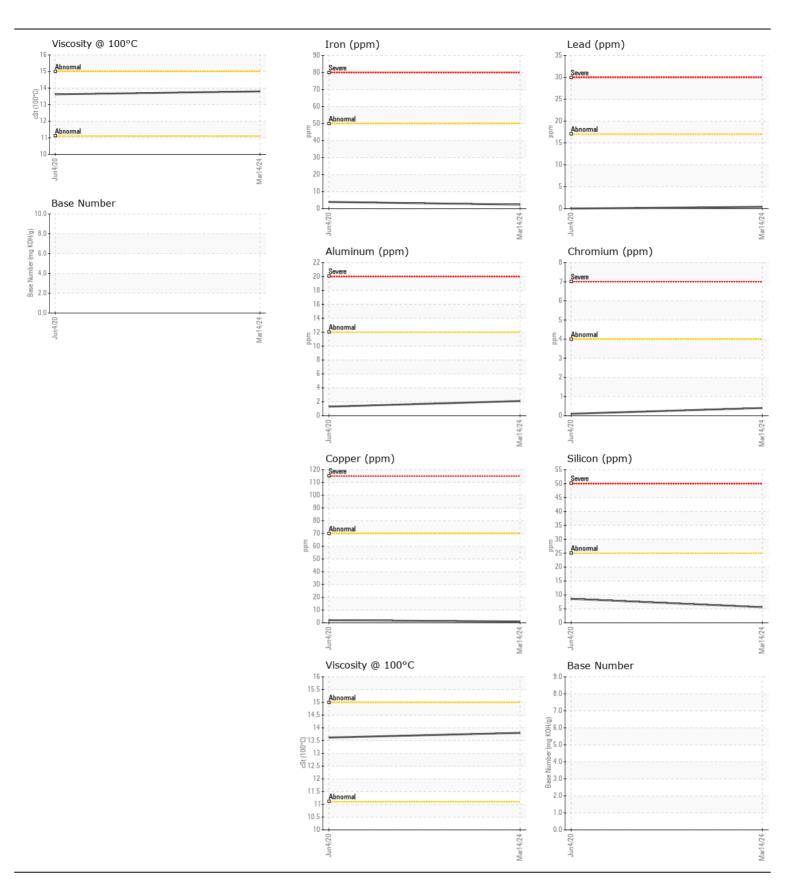





Certificate L2367

Laboratory Sample No.

Lab Number : 06123442 Unique Number : 10937593

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 : VPA058330

Received **Tested** Diagnosed Test Package : MOB 1 (Additional Tests: TBN)

: 20 Mar 2024 : 21 Mar 2024

: 21 Mar 2024 - Doug Bogart

Helmuts Marine Service 619 Canal Street SAN RAFAEL, CA US 94901-3545 Contact: NADINE URCIUOLI

To discuss this sample report, contact Customer Service at 1-800-237-1369.

SERVICE@HELMUTSMARINE.COM T: x:

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

F: x: