



WEAR	<b>NORMAL</b>
CONTAMINATION	<b>NORMAL</b>
FLUID CONDITION	<b>NORMAL</b>

Area  
**PALASYN 45**  
Machine Id  
**KAESER 1580 - TITAN MACHINERY ELGOW LAKE**  
Component  
**Compressor**

### RECOMMENDATION

Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		UCS06123846	---	---
Sample Date		Client Info		16 Feb 2024	---	---
Machine Age	hrs	Client Info		11431	---	---
Oil Age	hrs	Client Info		200	---	---
Filter Age	hrs	Client Info		200	---	---
Oil Changed		Client Info		Changed	---	---
Filter Changed		Client Info		Changed	---	---
Sample Status				<b>NORMAL</b>	---	---

### WEAR

All component wear rates are normal.

Iron	ppm	ASTM D5185m	>50	1	---	---
Chromium	ppm	ASTM D5185m	>10	0	---	---
Nickel	ppm	ASTM D5185m	>3	0	---	---
Titanium	ppm	ASTM D5185m	>3	0	---	---
Silver	ppm	ASTM D5185m	>2	0	---	---
Aluminum	ppm	ASTM D5185m	>10	0	---	---
Lead	ppm	ASTM D5185m	>10	0	---	---
Copper	ppm	ASTM D5185m	>50	9	---	---
Tin	ppm	ASTM D5185m	>10	0	---	---
Vanadium	ppm	ASTM D5185m		0	---	---
White Metal	scalar	*Visual	NONE	NONE	---	---
Yellow Metal	scalar	*Visual	NONE	NONE	---	---

### CONTAMINATION







Moderate concentration of visible dirt/debris present in the oil.

Silicon	ppm	ASTM D5185m	>25	<1	---	---
Potassium	ppm	ASTM D5185m	>20	0	---	---
Water		WC Method	>0.05	NEG	---	---
Silt	scalar	*Visual	NONE	NONE	---	---
Debris	scalar	*Visual	NONE	MODER	---	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---	---
Appearance	scalar	*Visual	NORML	NORML	---	---
Odor	scalar	*Visual	NORML	NORML	---	---
Emulsified Water	scalar	*Visual	>0.05	NEG	---	---

### FLUID CONDITION

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

Sodium	ppm	ASTM D5185m		0	---	---
Boron	ppm	ASTM D5185m	0.0	0	---	---
Barium	ppm	ASTM D5185m	0.0	0	---	---
Molybdenum	ppm	ASTM D5185m	0	0	---	---
Manganese	ppm	ASTM D5185m	0	0	---	---
Magnesium	ppm	ASTM D5185m	0.0	0	---	---
Calcium	ppm	ASTM D5185m	0.0	0	---	---
Phosphorus	ppm	ASTM D5185m	966	404	---	---
Zinc	ppm	ASTM D5185m	0	17	---	---
Sulfur	ppm	ASTM D5185m	1309	6329	---	---
Acid Number (AN)	mg KOH/g	ASTM D8045	0.172	0.29	---	---
Visc @ 40°C	cSt	ASTM D445	39.9	41.4	---	---

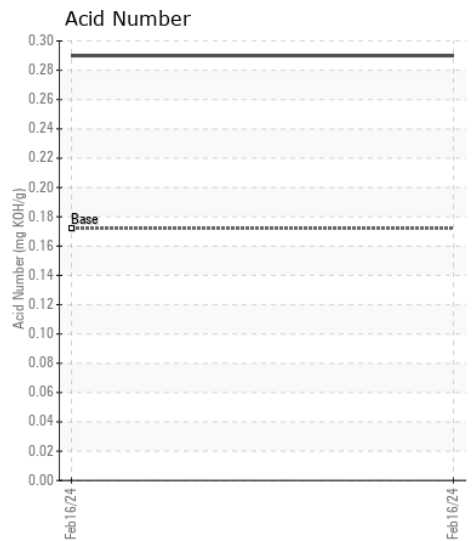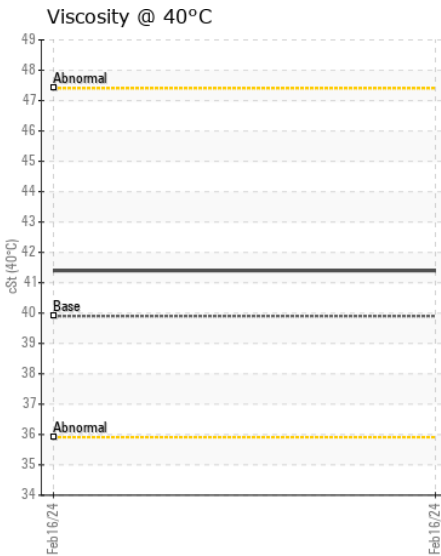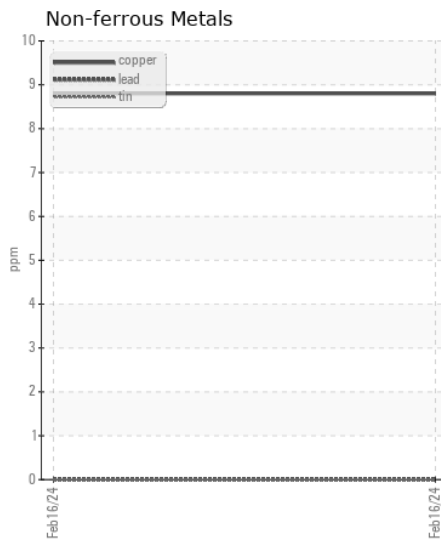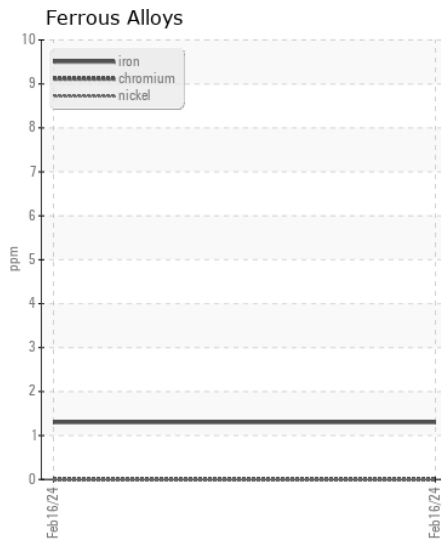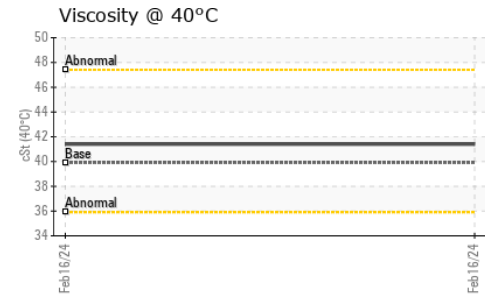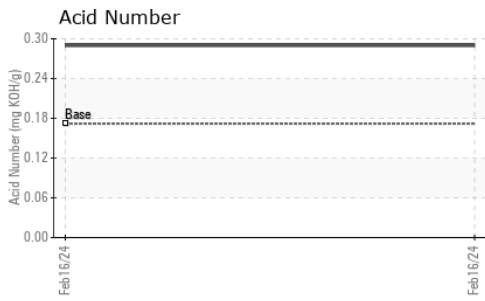

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513

**Sample No.** : UCS06123846

**Lab Number** : 06123846

**Unique Number** : 10937997

**Test Package** : IND 2

**Received** : 20 Mar 2024

**Tested** : 21 Mar 2024

**Diagnosed** : 22 Mar 2024 - Don Baldrige

**JEMCO-MAXAIR**

WEST FARGO, ND  
US 58078

Contact: DALE K  
dalek@jemco-maxair.com

T: (701)281-0362

F: x:

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)