

Area

WEAR NORMAL CONTAMINATION NORMAL FLUID CONDITION NORMAL


AC-3 Machine Id QUINCY QU1105040003 - GATEWAY BUILDING SYSTEM Component Compressor

RECOMMENDATION	Test	UOM	Method	Limit/Abn	Current	History1	History2
Resample at the next service interval to monitor.	Sample Number		Client Info		UCS06124357		
	Sample Date		Client Info		14 Mar 2024		
	Machine Age	hrs	Client Info		0		
	Oil Age	hrs	Client Info		0		
	Filter Age	hrs	Client Info		0		
	Oil Changed		Client Info		Changed		
	Filter Changed		Client Info		Not Changd		
	Sample Status				NORMAL		
WEAR	Iron	ppm	ASTM D5185m	>50	1		
	Chromium	ppm	ASTM D5185m		0		
All component wear rates are normal.	Nickel	ppm	ASTM D5185m		0		
	Titanium	ppm	ASTM D5185m		0		
	Silver	ppm	ASTM D5185m		0		
	Aluminum	ppm	ASTM D5185m	>25	0		
	Lead	ppm	ASTM D5185m	>25	0		
	Copper	ppm	ASTM D5185m	>50	<1		
	Tin	ppm	ASTM D5185m	>15	0		
	Vanadium	ppm	ASTM D5185m		0		
	White Metal	scalar	*Visual	NONE	NONE		
	Yellow Metal	scalar	*Visual	NONE	NONE		
CONTAMINATION	Silicon	ppm	ASTM D5185m	>25	2		
There is no indication of any contamination in the oil.	Potassium	ppm	ASTM D5185m		0		
	Water	ppm	WC Method		NEG		
	Silt	scalar	*Visual	NONE	NONE		
	Debris	scalar	*Visual	NONE	LIGHT		
	Sand/Dirt	scalar	*Visual	NONE	NONE		
	Appearance	scalar	*Visual	NORML	NORML		
	Odor	scalar	*Visual	NORML	NORML		
	Emulsified Water	scalar	*Visual	>0.1	NEG		
FLUID CONDITION					•		
	Sodium	ppm	ASTM D5185m		0		
The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.	Boron Barium	ppm	ASTM D5185m ASTM D5185m		0 0		
	Molybdenum	ppm ppm	ASTM D5185m		0		
	Manganese	ppm	ASTM D5185m		0		
	Magnesium	ppm	ASTM D5185m		0		
	Calcium	ppm	ASTM D5185m		98		
	Phosphorus	ppm	ASTM D5185m		1727		
	Zinc	ppm	ASTM D5185m		1913		
	Sulfur	ppm	ASTM D5185m		5113		
	Acid Number (AN)				1.66		
	()	0 0					

Visc @ 40°C cSt ASTM D445

Contact/Location: DALE K - UCJEMWES

148

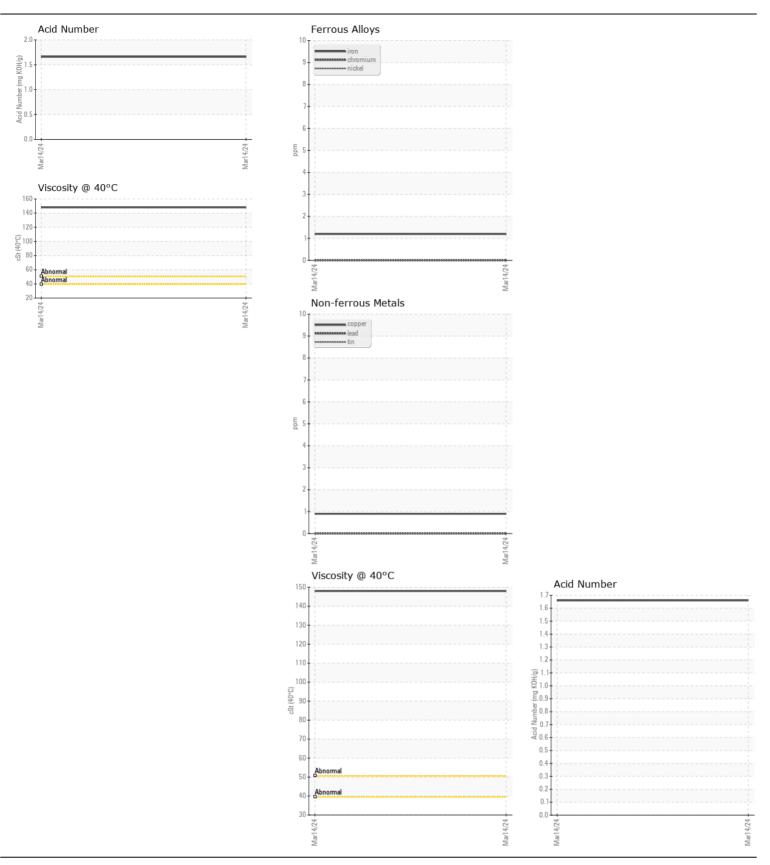

JEMCO-MAXAIR Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513 Sample No. : UCS06124357 Received : 20 Mar 2024 : 21 Mar 2024 Lab Number : 06124357 WEST FARGO, ND Tested : 23 Mar 2024 - Don Baldridge Unique Number : 10938508 Diagnosed US 58078 Test Package : IND 2 Contact: DALE K Certificate L2367 dalek@jemco-maxair.com To discuss this sample report, contact Customer Service at 1-800-237-1369. * - Denotes test methods that are outside of the ISO 17025 scope of accreditation. T: (701)281-0362 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012) F: x:

56

Contact/Location: DALE K - UCJEMWES

Page 2 of 2