



COOLANT REPORT

CORROSION	NORMAL
CONTAMINANTS	NORMAL
COOLANT CONDITION	NORMAL

Area
[PB-PMOAS2747306]
 Machine Id
6D24-302687 20A02330-5 (S/N 2057502)
 Component
Coolant
 Fluid
HYBRID (HOAT) COOLANT (--- GAL)

RECOMMENDATION

The fluid is suitable for further service.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		DC0028711	DC0023241	DC0016983
Sample Date		Client Info		11 Mar 2024	18 Jan 2023	15 Dec 2021
Machine Age	hrs	Client Info		857	818	790
Oil Age	hrs	Client Info		0	0	0
Oil Changed		Client Info		Changed	N/A	Not Chngd
Sample Status				NORMAL	NORMAL	NORMAL








CORROSION

Total Dissolved Solids				180.5	244.5	206.0
Coolant Appearance		*Visual	Clear	normal	normal	normal

CONTAMINANTS

There is no indication of any contamination in the coolant.

Boiling Point	°C	WC Method		227	---	---
Specific Gravity		*ASTM D1298		1.075	1.073	---
pH	Scale 0-14	ASTM D1287		7.72	7.60	7.84
Nitrites	ppm	AP-053:2009		1164	1164	1200
Reserve Alkalinity	Scale 0-20	*ASTM D1121		---	---	---
Percentage Glycol	%	ASTM D3321		55.6	54.8	50
Freezing Point	°F	ASTM D3321		-47	-45	-38
Carboxylate				n/a	n/a	n/a
Coolant Color		*Visual		Orange	Yllow	Orange

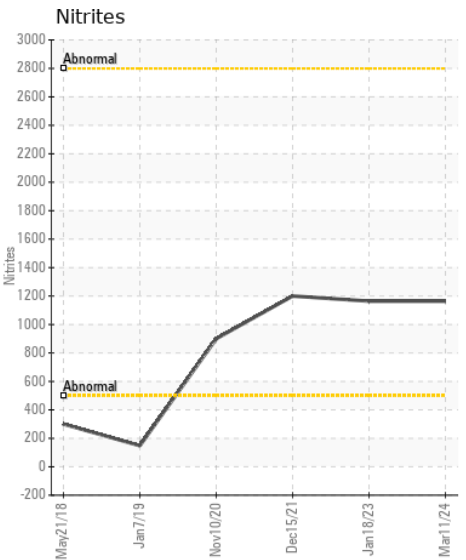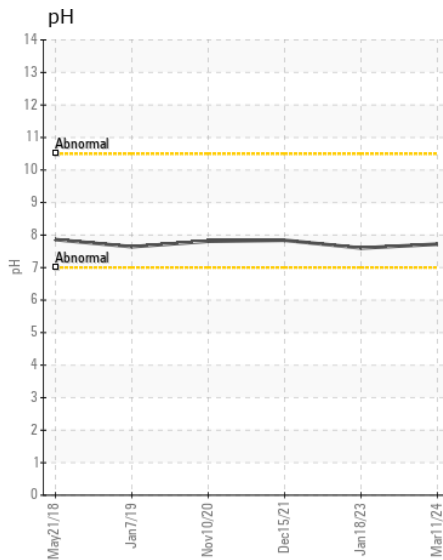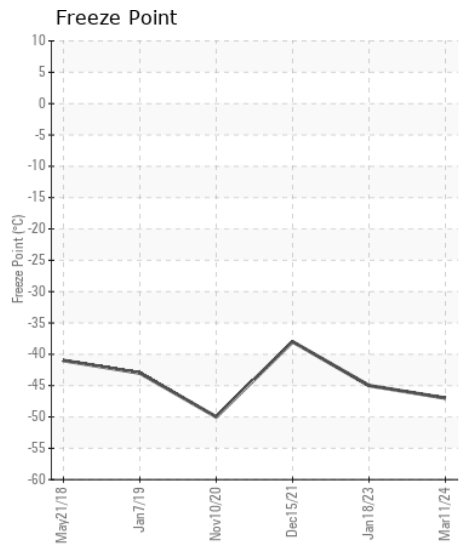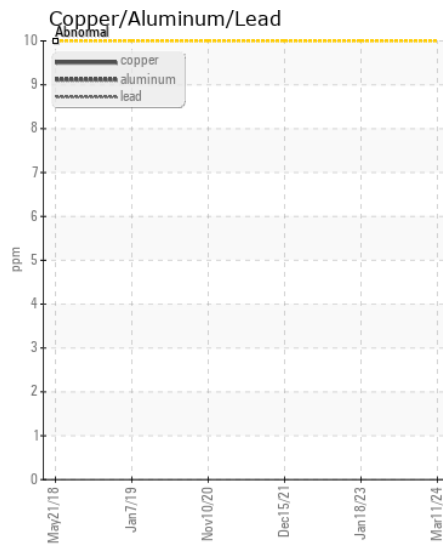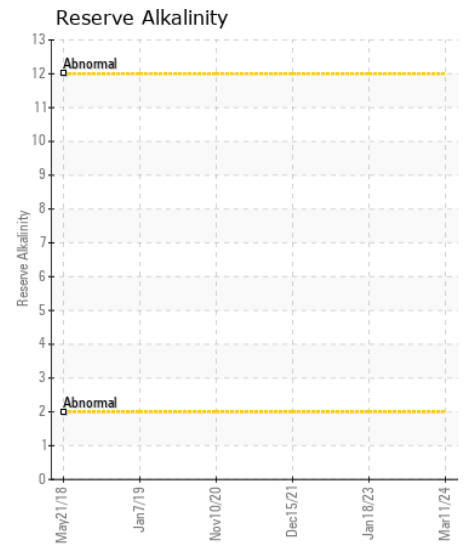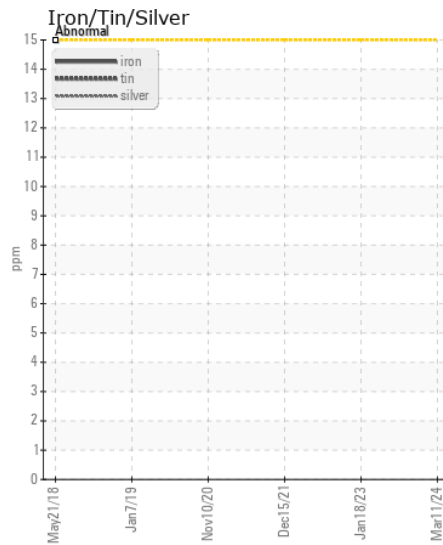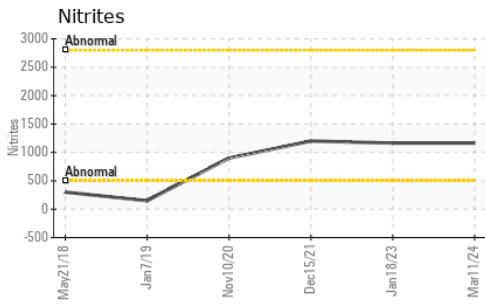

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : DC0028711 **Received** : 20 Mar 2024
Lab Number : 06124489 **Tested** : 25 Mar 2024
Unique Number : 10938640 **Diagnosed** : 25 Mar 2024 - Jonathan Hester
Test Package : COOL- (Additional Tests: BoilingPoint, COOL, GlycolType)

KELLY GENERATOR & EQUIPMENT INC
 1955 DALE LN
 OWINGS, MD
 US 20736
 Contact: LESLIE SNURR
 LSNURR@KGE.COM
 T: (410)257-5225
 F: (410)257-5227

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)