



# OIL ANALYSIS REPORT

WEAR	NORMAL
CONTAMINATION	NORMAL
FLUID CONDITION	NORMAL

Machine Id  
**R202-HPU-ENG**  
Component  
**Diesel Engine**  
Fluid  
**{not provided} (--- GAL)**

## RECOMMENDATION

Resample at the next service interval to monitor. The fluid was not specified, however, a fluid match indicates that this fluid is SAE 30 Diesel Engine Oil. Please confirm the oil type and grade, and specify the brand of the oil on your next sample. Please specify the component make and model with your next sample.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		<b>KL0014219</b>	KL0013990	KLM2339377
Sample Date		Client Info		<b>29 Mar 2024</b>	05 Jan 2024	26 Jan 2023
Machine Age	hrs	Client Info		<b>45326</b>	45297	44956
Oil Age	hrs	Client Info		<b>0</b>	0	0
Filter Age	hrs	Client Info		<b>0</b>	0	0
Oil Changed		Client Info		<b>N/A</b>	N/A	N/A
Filter Changed		Client Info		<b>N/A</b>	N/A	N/A
Sample Status				<b>NORMAL</b>	ABNORMAL	MARGINAL

## WEAR

All component wear rates are normal.

Iron	ppm	ASTM D5185m	>100	<b>10</b>	24	13
Chromium	ppm	ASTM D5185m	>20	<b>0</b>	<1	<1
Nickel	ppm	ASTM D5185m	>4	<b>0</b>	<1	<1
Titanium	ppm	ASTM D5185m		<b>0</b>	<1	0
Silver	ppm	ASTM D5185m	>3	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m	>20	<b>2</b>	2	<1
Lead	ppm	ASTM D5185m	>40	<b>2</b>	9	3
Copper	ppm	ASTM D5185m	>330	<b>7</b>	9	10
Tin	ppm	ASTM D5185m	>15	<b>&lt;1</b>	1	<1
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	0
White Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE

## CONTAMINATION











The system cleanliness is acceptable for your target ISO 4406 cleanliness code. The system and fluid cleanliness is acceptable.

Silicon	ppm	ASTM D5185m	>25	<b>2</b>	4	3
Potassium	ppm	ASTM D5185m	>20	<b>2</b>	2	1
Fuel		WC Method	>5	<b>&lt;1.0</b>	▲ 4.5	▲ 3.2
Water		WC Method	>0.2	<b>NEG</b>	NEG	NEG
Glycol		WC Method		<b>NEG</b>	NEG	NEG
Soot %	%	*ASTM D7844	>3	<b>0.2</b>	0.3	0.2
Nitration	Abs/cm	*ASTM D7624	>20	<b>6.9</b>	7.4	7.5
Sulfation	Abs/.1mm	*ASTM D7415	>30	<b>20.7</b>	21.1	20.8
Particles >4µm		ASTM D7647		<b>3950</b>	2427	1470
Particles >6µm		ASTM D7647	>5000	<b>2152</b>	1322	801
Particles >14µm		ASTM D7647	>640	<b>366</b>	225	136
Particles >21µm		ASTM D7647	>160	<b>123</b>	76	46
Particles >38µm		ASTM D7647	>40	<b>19</b>	12	7
Particles >71µm		ASTM D7647	>10	<b>2</b>	1	1
Oil Cleanliness		ISO 4406 (c)	>19/16	<b>18/16</b>	18/15	17/14
Silt	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Debris	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Appearance	scalar	*Visual	NORML	<b>NORML</b>	NORML	NORML
Odor	scalar	*Visual	NORML	<b>NORML</b>	NORML	NORML
Emulsified Water	scalar	*Visual	>0.2	<b>NEG</b>	NEG	NEG

## FLUID CONDITION

The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

Sodium	ppm	ASTM D5185m		<b>0</b>	1	1
Boron	ppm	ASTM D5185m		<b>382</b>	235	301
Barium	ppm	ASTM D5185m		<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m		<b>68</b>	64	71
Manganese	ppm	ASTM D5185m		<b>0</b>	<1	<1
Magnesium	ppm	ASTM D5185m		<b>293</b>	290	327
Calcium	ppm	ASTM D5185m		<b>1311</b>	1172	1520
Phosphorus	ppm	ASTM D5185m		<b>977</b>	814	838
Zinc	ppm	ASTM D5185m		<b>1039</b>	952	1070
Sulfur	ppm	ASTM D5185m		<b>3993</b>	3675	3474
Oxidation	Abs/.1mm	*ASTM D7414	>25	<b>15.8</b>	16.3	15.7
Base Number (BN)	mg KOH/g	ASTM D2896		<b>6.95</b>	5.94	8.43
Visc @ 100°C	cSt	ASTM D445		<b>12.5</b>	▲ 11.7	12.3

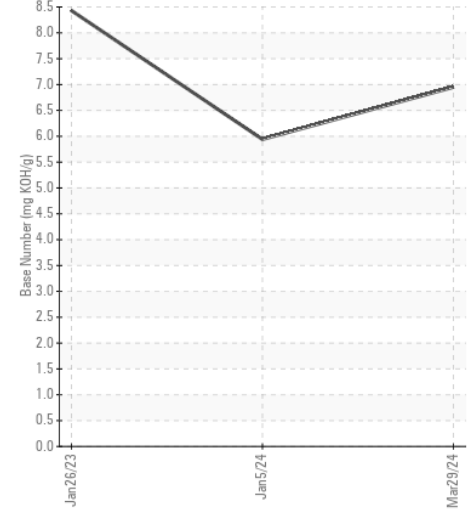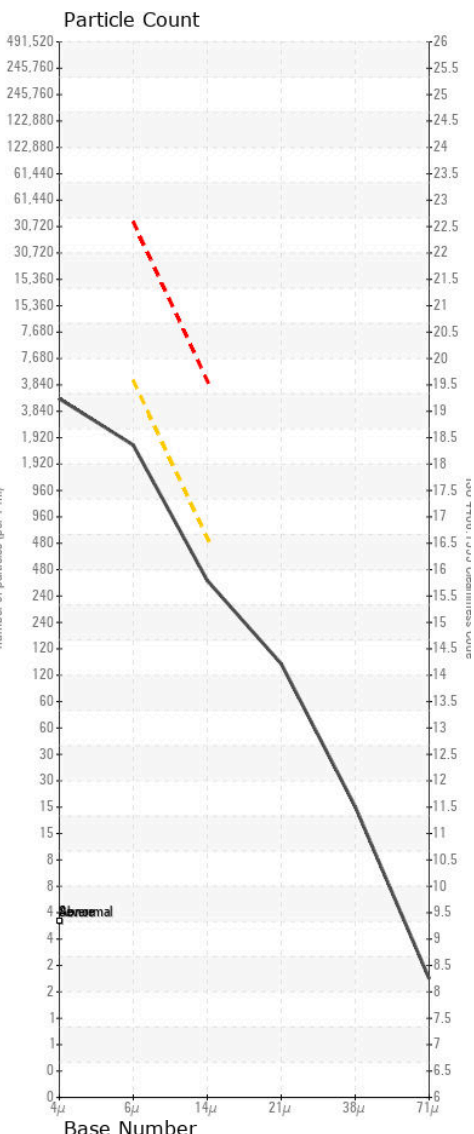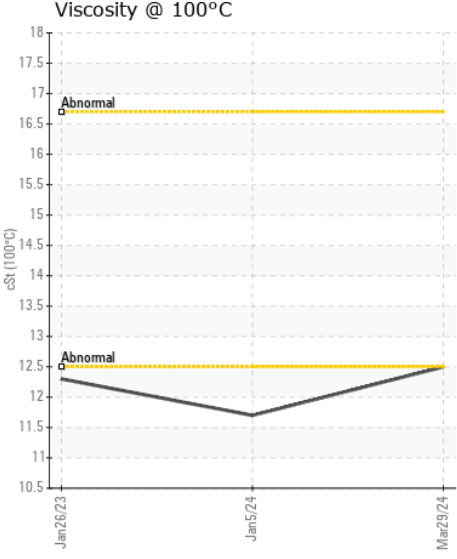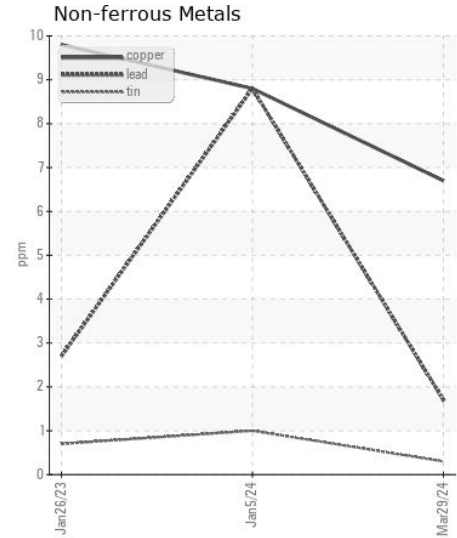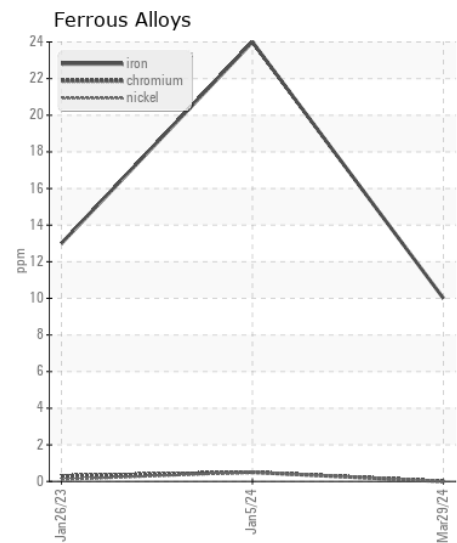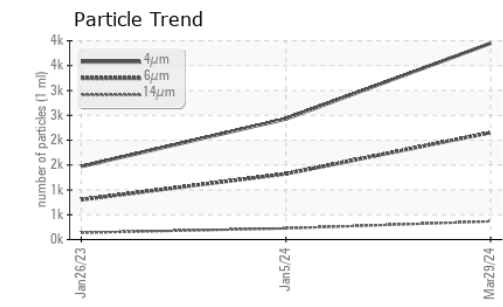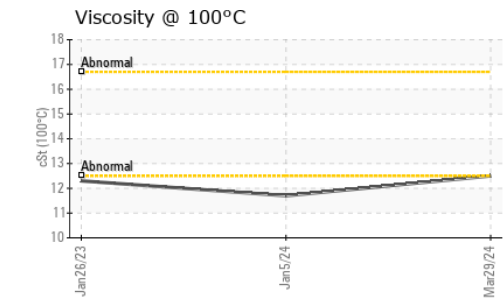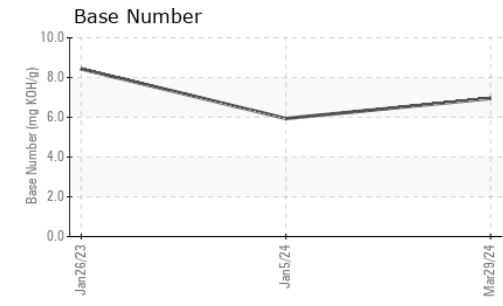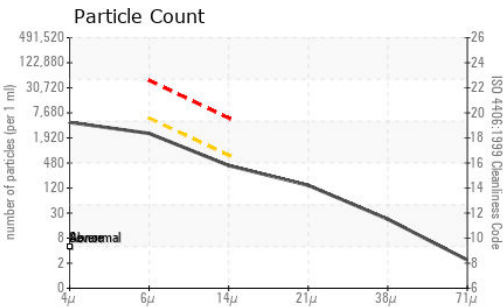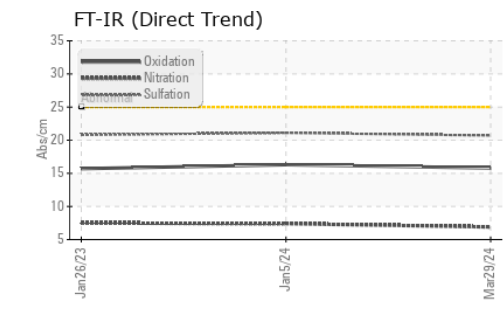

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KL0014219 **Received** : 10 Apr 2024  
**Lab Number** : 06145363 **Tested** : 15 Apr 2024  
**Unique Number** : 10970171 **Diagnosed** : 15 Apr 2024 - Wes Davis  
**Test Package** : MOB 2 ( Additional Tests: PrtCount )

**STRATEGY LATERAL**  
 PO BOX 80543  
 MIDLAND, TX  
 US 76065  
 Contact: KIRK WADE  
 KIRK.WADE@STRATEGYLATERAL.COM  
 T:  
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)