



OIL ANALYSIS REPORT

WEAR	NORMAL
CONTAMINATION	ABNORMAL
FLUID CONDITION	NORMAL

Machine Id
OAKWOOD VILLAGE EAST COM CTR C-2B CIRC 2 (S/N U18C00508)

Component
Refrigeration Compressor

Fluid
TRANE 0048 (--- GAL)

RECOMMENDATION

No corrective action is recommended at this time. We recommend an early resample to monitor this condition.

WEAR

All component wear rates are normal.









CONTAMINATION

There is a light concentration of water present in the oil.

FLUID CONDITION

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		WC0709605	WC0578150	WC0578151
Sample Date		Client Info		10 Apr 2024	17 Aug 2022	16 Aug 2022
Machine Age	hrs	Client Info		0	0	0
Oil Age	hrs	Client Info		0	0	0
Filter Age	hrs	Client Info		0	0	0
Oil Changed		Client Info		N/A	N/A	N/A
Filter Changed		Client Info		N/A	N/A	N/A
Sample Status				ABNORMAL	ABNORMAL	ABNORMAL
Iron	ppm	ASTM D5185m	>8	0	2	<1
Chromium	ppm	ASTM D5185m	>2	0	0	0
Nickel	ppm	ASTM D5185m		0	0	0
Titanium	ppm	ASTM D5185m		0	0	0
Silver	ppm	ASTM D5185m	>2	0	0	0
Aluminum	ppm	ASTM D5185m	>3	0	0	0
Lead	ppm	ASTM D5185m	>2	0	0	0
Copper	ppm	ASTM D5185m	>8	<1	<1	0
Tin	ppm	ASTM D5185m	>4	0	<1	<1
Vanadium	ppm	ASTM D5185m		0	0	0
White Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Silicon	ppm	ASTM D5185m	>15	4	5	2
Potassium	ppm	ASTM D5185m	>20	0	0	0
Water	%	ASTM D6304	>0.01	▲ 0.053	▲ 0.096	▲ 0.091
ppm Water	ppm	ASTM D6304	>100	▲ 531	▲ 967.5	▲ 911.0
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.01	NEG	NEG	NEG
Sodium	ppm	ASTM D5185m		0	0	0
Boron	ppm	ASTM D5185m	1	0	0	0
Barium	ppm	ASTM D5185m	0	0	<1	<1
Molybdenum	ppm	ASTM D5185m	0	0	0	0
Manganese	ppm	ASTM D5185m	0	0	0	0
Magnesium	ppm	ASTM D5185m	0	0	0	0
Calcium	ppm	ASTM D5185m	0	0	0	0
Phosphorus	ppm	ASTM D5185m	5	0	<1	2
Zinc	ppm	ASTM D5185m	0	0	15	0
Sulfur	ppm	ASTM D5185m	10	0	<1	0
Acid Number (AN)	mg KOH/g	ASTM D974	0.09	0.083	0.151	0.08
Visc @ 40°C	cSt	ASTM D445	68	56.2	67.4	55.5

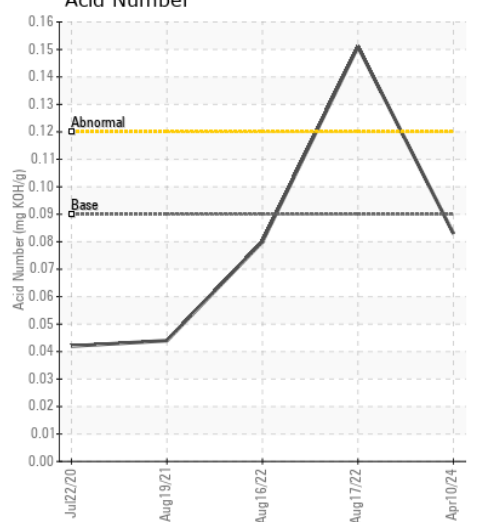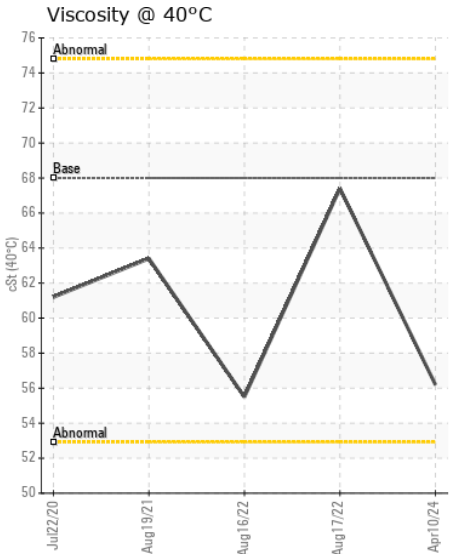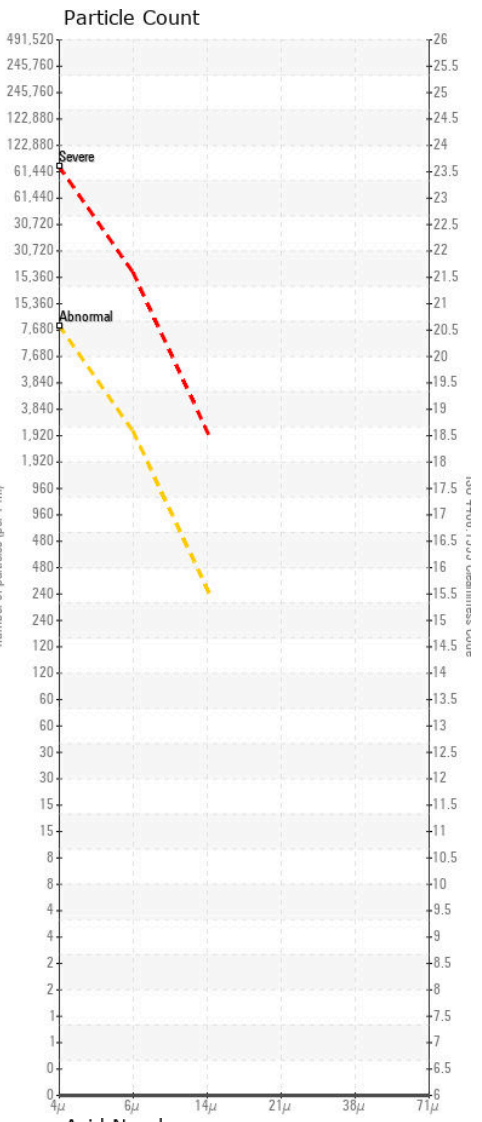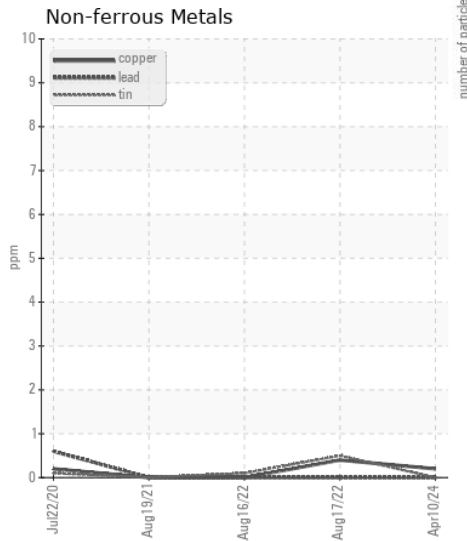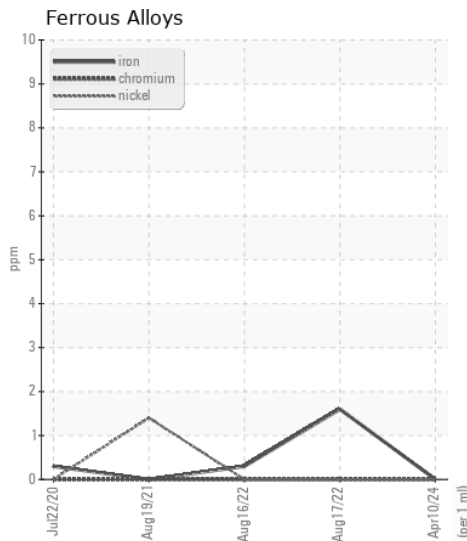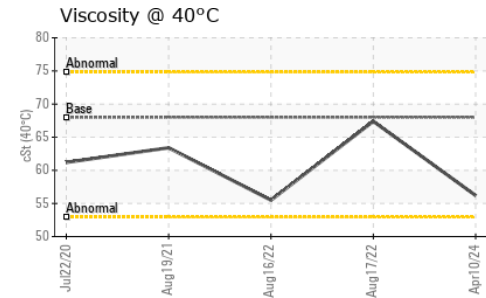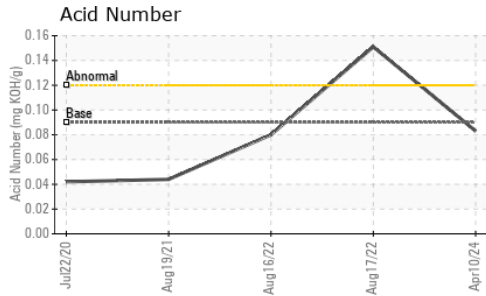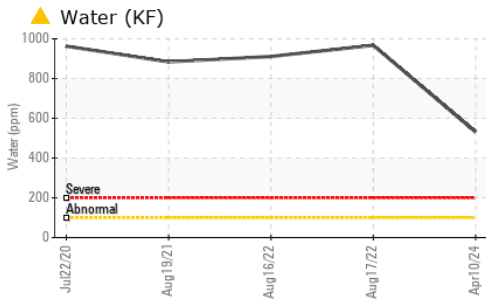

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0709605 **Received** : 11 Apr 2024
Lab Number : 06145941 **Tested** : 12 Apr 2024
Unique Number : 10976019 **Diagnosed** : 12 Apr 2024 - Doug Bogart
Test Package : PLANT (Additional Tests: PrtCountNAS)

NORTH AMERICAN MECHANICAL
 4401 STATE RD 19
 WINDSOR, WI
 US 53598
 Contact: STACEY QUAM
 squam@naminc.com
 T: (608)240-8906
 F: (608)240-8965

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)