



# OIL ANALYSIS REPORT

WEAR	<b>NORMAL</b>
CONTAMINATION	<b>NORMAL</b>
FLUID CONDITION	<b>NORMAL</b>

Machine Id  
**GENERAC BALL PARK RD**  
 Component  
**Propane Engine**  
 Fluid  
**SHELL ROTELLA T 15W40 (4 QTS)**

## RECOMMENDATION

Resample at the next service interval to monitor.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		<b>WC0887907</b>	WCM1165259	---
Sample Date		Client Info		<b>12 Feb 2024</b>	30 Nov 2009	---
Machine Age	hrs	Client Info		<b>488</b>	207	---
Oil Age	hrs	Client Info		<b>0</b>	0	---
Filter Age	hrs	Client Info		<b>0</b>	0	---
Oil Changed		Client Info		<b>Changed</b>	Changed	---
Filter Changed		Client Info		<b>Changed</b>	Changed	---
Sample Status				<b>NORMAL</b>	NORMAL	---

## WEAR

Metal levels are typical for a new component breaking in.

Iron	ppm	ASTM D5185m	>100	<b>0</b>	3	---
Chromium	ppm	ASTM D5185m	>25	<b>0</b>	<1	---
Nickel	ppm	ASTM D5185m	>5	<b>0</b>	0	---
Titanium	ppm	ASTM D5185m		<b>0</b>	<1	---
Silver	ppm	ASTM D5185m	>5	<b>0</b>	0	---
Aluminum	ppm	ASTM D5185m	>20	<b>1</b>	1	---
Lead	ppm	ASTM D5185m	>25	<b>0</b>	3	---
Copper	ppm	ASTM D5185m	>35	<b>0</b>	3	---
Tin	ppm	ASTM D5185m	>8	<b>0</b>	0	---
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	---
White Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	---
Yellow Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	---

## CONTAMINATION












There is no indication of any contamination in the oil.

Silicon	ppm	ASTM D5185m	>50	<b>8</b>	12	---
Potassium	ppm	ASTM D5185m	>20	<b>1</b>	0	---
Water		WC Method	>0.1	<b>NEG</b>	NEG	---
Soot %	%	*ASTM D7844		<b>0</b>	0	---
Nitration	Abs/cm	*ASTM D7624	>20	<b>6.7</b>	5.	---
Sulfation	Abs/.1mm	*ASTM D7415	>30	<b>15.9</b>	16.	---
Silt	scalar	*Visual	NONE	<b>NONE</b>	NONE	---
Debris	scalar	*Visual	NONE	<b>NONE</b>	NONE	---
Sand/Dirt	scalar	*Visual	NONE	<b>NONE</b>	NONE	---
Appearance	scalar	*Visual	NORML	<b>NORML</b>	NORML	---
Odor	scalar	*Visual	NORML	<b>NORML</b>	NORML	---
Emulsified Water	scalar	*Visual	>0.1	<b>NEG</b>	NEG	---

## FLUID CONDITION

The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

Sodium	ppm	ASTM D5185m		<b>2</b>	4	---
Boron	ppm	ASTM D5185m	316	<b>109</b>	4	---
Barium	ppm	ASTM D5185m	0.0	<b>0</b>	<1	---
Molybdenum	ppm	ASTM D5185m	1.2	<b>83</b>	21	---
Manganese	ppm	ASTM D5185m		<b>0</b>	<1	---
Magnesium	ppm	ASTM D5185m	24	<b>165</b>	462	---
Calcium	ppm	ASTM D5185m	2292	<b>2151</b>	2042	---
Phosphorus	ppm	ASTM D5185m	1064	<b>1085</b>	1050	---
Zinc	ppm	ASTM D5185m	1160	<b>1204</b>	1192	---
Sulfur	ppm	ASTM D5185m	4996	<b>4731</b>	4768	---
Oxidation	Abs/.1mm	*ASTM D7414	>25	<b>11.5</b>	12.	---
Base Number (BN)	mg KOH/g	ASTM D2896	10.1	<b>7.1</b>	---	---
Visc @ 100°C	cSt	ASTM D445	15.7	<b>13.2</b>	15.46	---

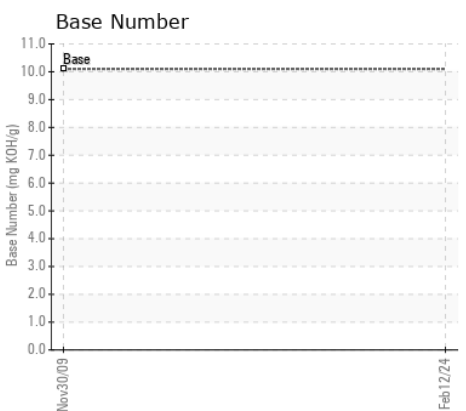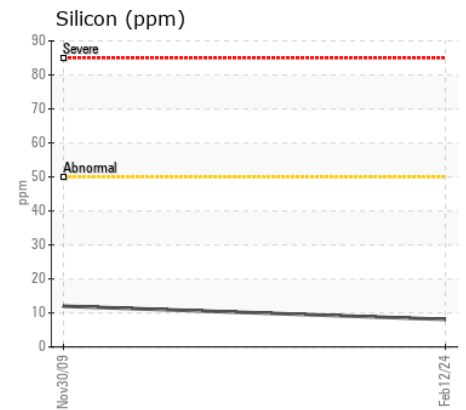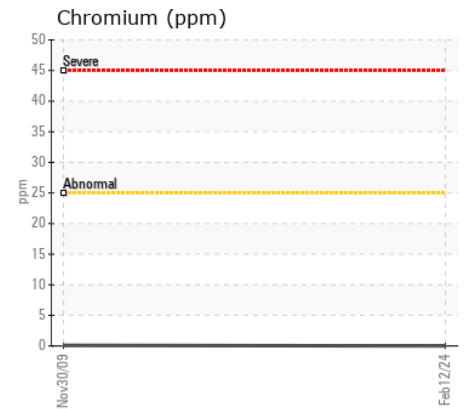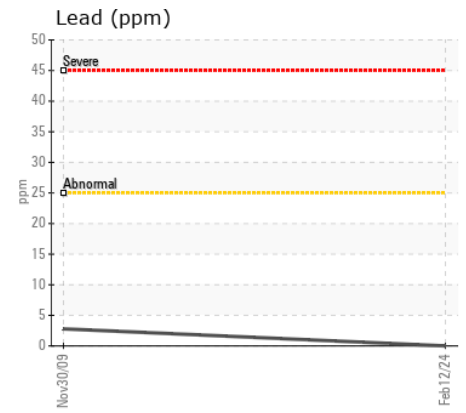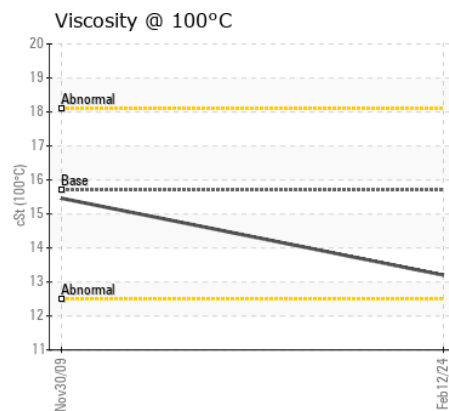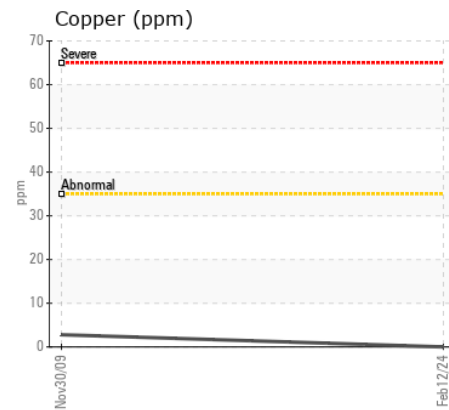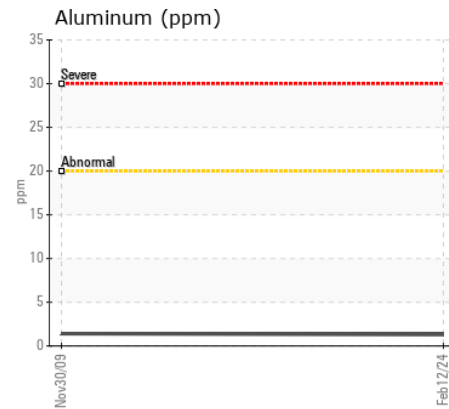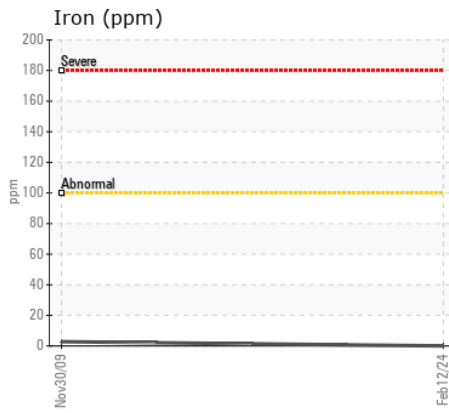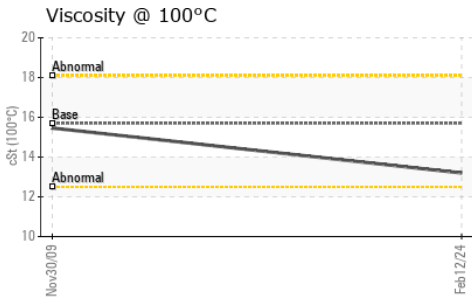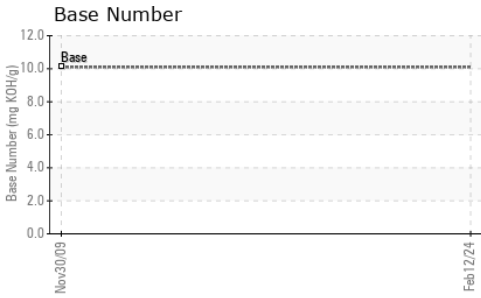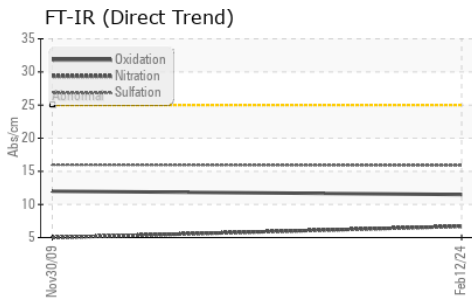

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : WC0887907  
**Lab Number** : 06146948  
**Unique Number** : 10977026  
**Test Package** : MOB 1

**Received** : 12 Apr 2024  
**Tested** : 15 Apr 2024  
**Diagnosed** : 15 Apr 2024 - Wes Davis

**PIEDMONT GENERATOR**  
 7560 NC HWY 22 NORTH  
 CLIMAX, NC  
 US 27233

Contact: TERRY SHEPPARD  
 terry1pg@bellsouth.net; bill3pg@bellsouth.net

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: (336)685-4859  
 F: (336)685-5297