



WEAR	<b>NORMAL</b>
CONTAMINATION	<b>NORMAL</b>
FLUID CONDITION	<b>NORMAL</b>

Area  
**PALASYN 45 [JAX-PM3013157-3]**  
Machine Id  
**SULLIVAN PALATEK 11L005 - WICKER MACHINE CO**  
Component  
**Compressor**

### RECOMMENDATION

Resample at the next service interval to monitor.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		<b>UCS06147441</b>	UCS05986647	UCS05827810
Sample Date		Client Info		<b>01 Apr 2024</b>	13 Oct 2023	03 Apr 2023
Machine Age	hrs	Client Info		<b>30124</b>	29001	27605
Oil Age	hrs	Client Info		<b>0</b>	0	0
Filter Age	hrs	Client Info		<b>0</b>	0	0
Oil Changed		Client Info		<b>Changed</b>	Not Chngd	Changed
Filter Changed		Client Info		<b>Changed</b>	Changed	Changed
Sample Status				<b>NORMAL</b>	NORMAL	NORMAL

### WEAR

All component wear rates are normal.

Iron	ppm	ASTM D5185m	>50	<b>0</b>	0	0
Chromium	ppm	ASTM D5185m	>10	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m		<b>0</b>	0	0
Titanium	ppm	ASTM D5185m		<b>0</b>	0	0
Silver	ppm	ASTM D5185m		<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m	>25	<b>0</b>	0	0
Lead	ppm	ASTM D5185m	>25	<b>0</b>	0	0
Copper	ppm	ASTM D5185m	>50	<b>0</b>	<1	1
Tin	ppm	ASTM D5185m	>15	<b>0</b>	0	0
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	0
White Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE

### CONTAMINATION







There is no indication of any contamination in the oil.

Silicon	ppm	ASTM D5185m	>25	<b>&lt;1</b>	2	2
Potassium	ppm	ASTM D5185m	>20	<b>&lt;1</b>	<1	<1
Water		WC Method	>0.1	<b>NEG</b>	NEG	NEG
Silt	scalar	*Visual	NONE	<b>NONE</b>	MODER	NONE
Debris	scalar	*Visual	NONE	<b>LIGHT</b>	LIGHT	NONE
Sand/Dirt	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Appearance	scalar	*Visual	NORML	<b>NORML</b>	NORML	NORML
Odor	scalar	*Visual	NORML	<b>NORML</b>	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	<b>NEG</b>	NEG	NEG

### FLUID CONDITION

The AN level is acceptable for this fluid. The condition of the oil is acceptable for the time in service.

Sodium	ppm	ASTM D5185m		<b>&lt;1</b>	0	0
Boron	ppm	ASTM D5185m	0.0	<b>0</b>	0	0
Barium	ppm	ASTM D5185m	0.0	<b>11</b>	0	0
Molybdenum	ppm	ASTM D5185m	0	<b>0</b>	0	0
Manganese	ppm	ASTM D5185m	0	<b>0</b>	0	0
Magnesium	ppm	ASTM D5185m	0.0	<b>0</b>	0	<1
Calcium	ppm	ASTM D5185m	0.0	<b>0</b>	0	0
Phosphorus	ppm	ASTM D5185m	966	<b>516</b>	488	519
Zinc	ppm	ASTM D5185m	0	<b>0</b>	0	0
Sulfur	ppm	ASTM D5185m	1309	<b>1204</b>	1012	1314
Acid Number (AN)	mg KOH/g	ASTM D8045	0.172	<b>0.17</b>	0.082	0.11
Visc @ 40°C	cSt	ASTM D445	39.9	<b>43.5</b>	43.2	42.8

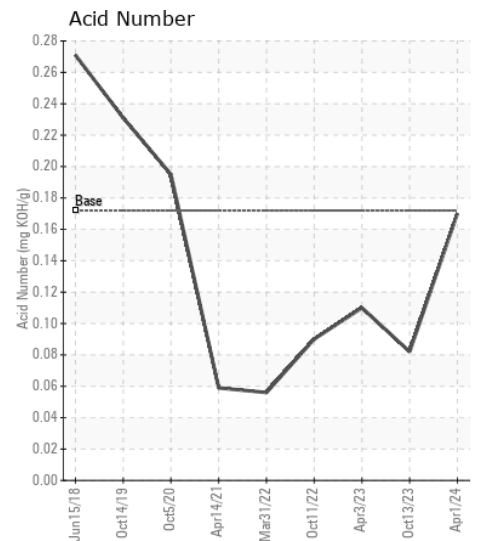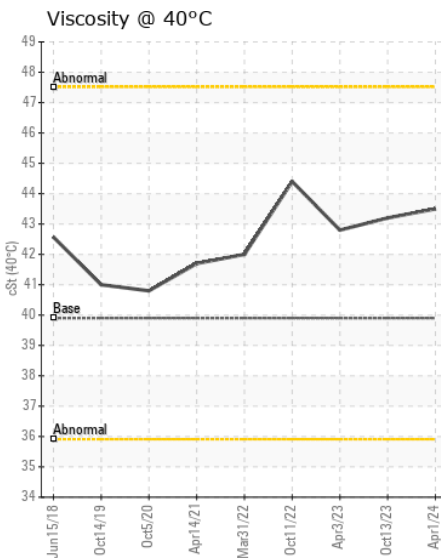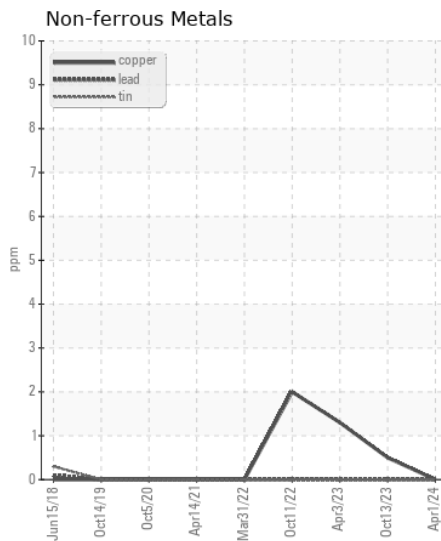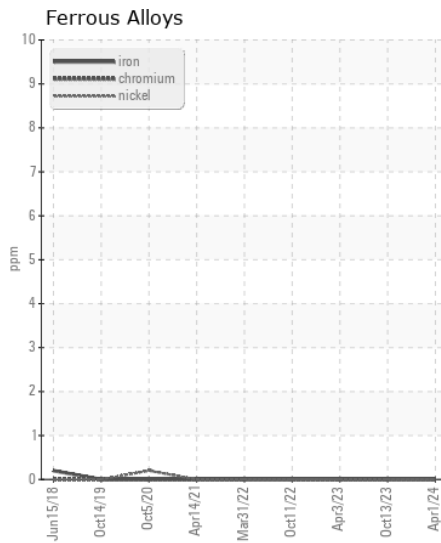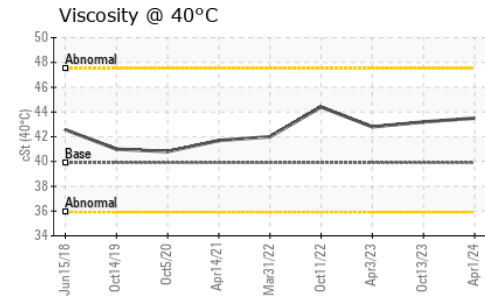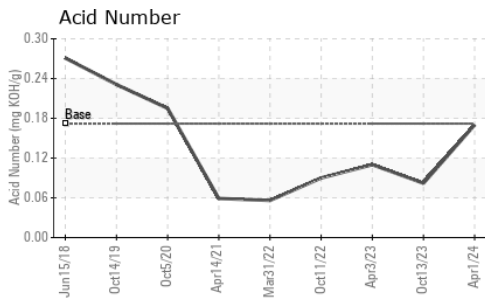

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : UCS06147441  
**Lab Number** : 06147441  
**Unique Number** : 10977519  
**Test Package** : IND 2

**Received** : 12 Apr 2024  
**Tested** : 15 Apr 2024  
**Diagnosed** : 16 Apr 2024 - Sean Felton

**QUALITY COMPRESSED AIR SERVICES INC**

BATON ROUGE, LA  
 US 70814  
 Contact: GEORGIA HOLLEY  
 georgia@qcas-inc.com  
 T: (225)932-0029  
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)