



WEAR	NORMAL
CONTAMINATION	NORMAL
FLUID CONDITION	NORMAL

Machine Id
847001
 Component
Natural Gas Engine
 Fluid
PETRO CANADA DURON GEO LD 15W40 (--- GAL)

RECOMMENDATION

Resample at the next service interval to monitor.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		GFL0108396	GFL0065046	---
Sample Date		Client Info		10 Apr 2024	20 Apr 2023	---
Machine Age	hrs	Client Info		16051	14254	---
Oil Age	hrs	Client Info		16051	14254	---
Filter Age	hrs	Client Info		0	0	---
Oil Changed		Client Info		Changed	Not Changd	---
Filter Changed		Client Info		Changed	N/A	---
Sample Status				NORMAL	NORMAL	---

WEAR

All component wear rates are normal.

Iron	ppm	ASTM D5185m	>50	13	17	---
Chromium	ppm	ASTM D5185m	>4	2	2	---
Nickel	ppm	ASTM D5185m	>2	<1	0	---
Titanium	ppm	ASTM D5185m		<1	0	---
Silver	ppm	ASTM D5185m	>3	0	0	---
Aluminum	ppm	ASTM D5185m	>9	2	4	---
Lead	ppm	ASTM D5185m	>30	<1	<1	---
Copper	ppm	ASTM D5185m	>35	212	<1	---
Tin	ppm	ASTM D5185m	>4	<1	<1	---
Vanadium	ppm	ASTM D5185m		0	0	---
White Metal	scalar	*Visual	NONE	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	---

CONTAMINATION









There is no indication of any contamination in the oil.

Silicon	ppm	ASTM D5185m	>+100	17	5	---
Potassium	ppm	ASTM D5185m	>20	4	0	---
Water		WC Method	>0.1	NEG	NEG	---
Glycol	%	*ASTM D2982		0.0	---	---
Soot %	%	*ASTM D7844		0	0	---
Nitration	Abs/cm	*ASTM D7624	>20	11.1	13.1	---
Sulfation	Abs/.1mm	*ASTM D7415	>30	21.9	24.5	---
Silt	scalar	*Visual	NONE	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG	---

FLUID CONDITION

The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

Sodium	ppm	ASTM D5185m		26	10	---
Boron	ppm	ASTM D5185m	50	12	7	---
Barium	ppm	ASTM D5185m	5	0	0	---
Molybdenum	ppm	ASTM D5185m	50	57	59	---
Manganese	ppm	ASTM D5185m	0	<1	<1	---
Magnesium	ppm	ASTM D5185m	560	556	619	---
Calcium	ppm	ASTM D5185m	1510	1687	1808	---
Phosphorus	ppm	ASTM D5185m	780	773	765	---
Zinc	ppm	ASTM D5185m	870	980	1042	---
Sulfur	ppm	ASTM D5185m	2040	2642	2772	---
Oxidation	Abs/.1mm	*ASTM D7414	>25	18.5	19.9	---
Base Number (BN)	mg KOH/g	ASTM D2896	10.2	4.5	4.3	---
Visc @ 100°C	cSt	ASTM D445	15.1	14.8	14.9	---

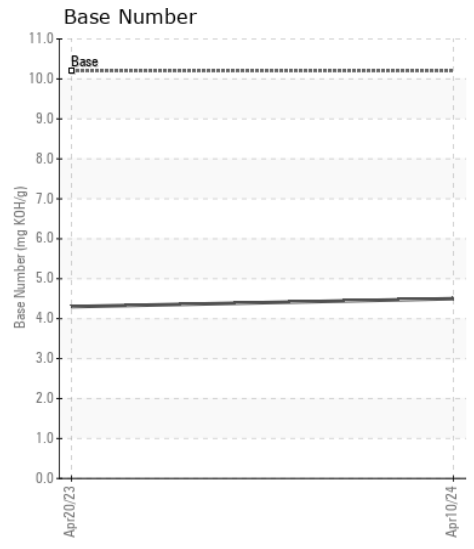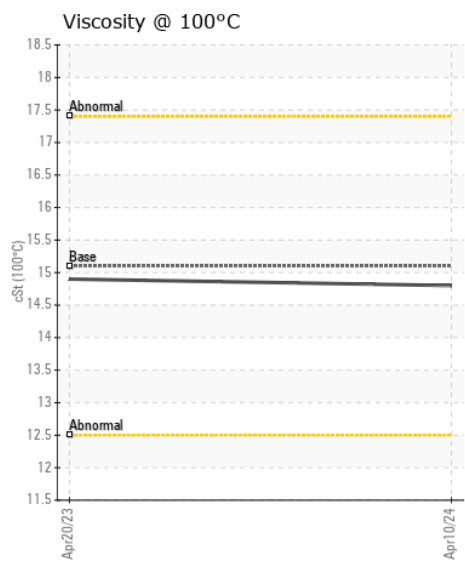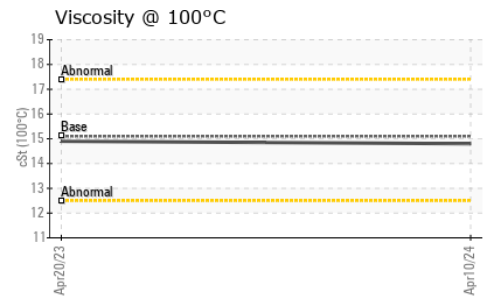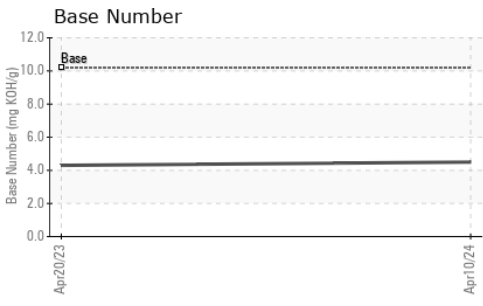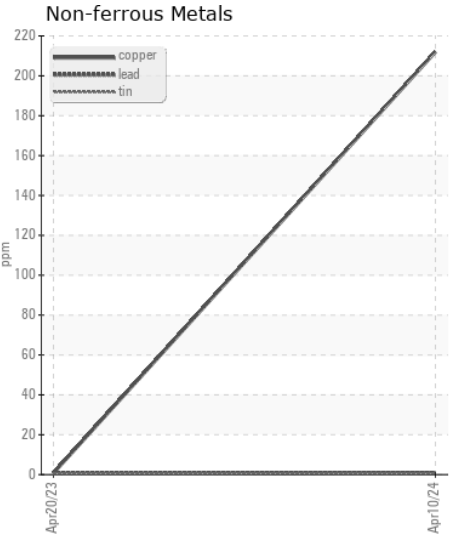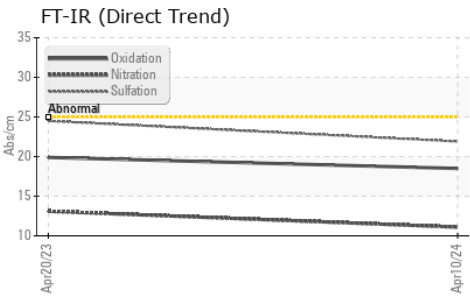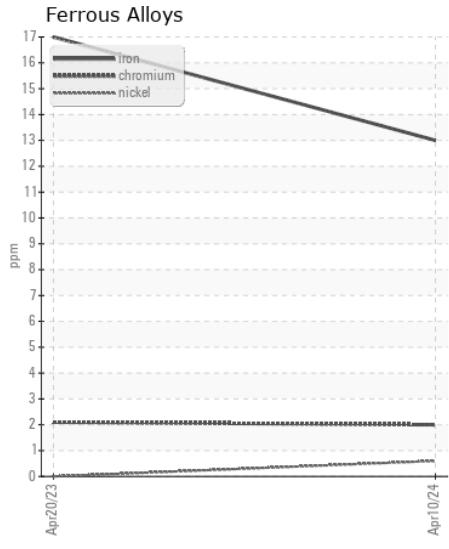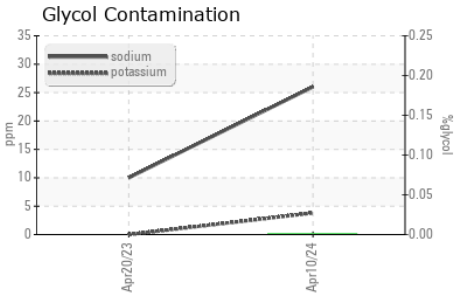

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : GFL0108396 **Received** : 15 Apr 2024
Lab Number : 06148454 **Tested** : 17 Apr 2024
Unique Number : 10978532 **Diagnosed** : 17 Apr 2024 - Wes Davis
Test Package : FLEET (Additional Tests: Glycol)

GFL Environmental - 932 - Muskego HC
 W144 S6400 College Ct.
 Muskego, WI
 US 53150
 Contact: Brian Schlomann
 brian.schlomann@gflenv.com
 T: (262)510-4586
 F:

Certificate L2367
 To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)