



OIL ANALYSIS REPORT

WEAR	NORMAL
CONTAMINATION	NORMAL
FLUID CONDITION	NORMAL

Machine Id
MARC 29
 Component
Air Compressor
 Fluid
DURALENE 600 20 ISO 68 (--- QTS)

RECOMMENDATION

Resample at the next service interval to monitor.

WEAR

All component wear rates are normal.

CONTAMINATION

There is no indication of any contamination in the oil.

FLUID CONDITION











The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		DC0035785	DC0028848	DC0025804
Sample Date		Client Info		12 Apr 2024	22 Jan 2024	16 Oct 2023
Machine Age	mls	Client Info		0	0	0
Oil Age	mls	Client Info		0	0	0
Filter Age	mls	Client Info		0	0	0
Oil Changed		Client Info		Changed	Not Changd	Not Changd
Filter Changed		Client Info		Changed	Changed	Changed
Sample Status				NORMAL	NORMAL	NORMAL

Iron	ppm	ASTM D5185m	>50	0	<1	0
Chromium	ppm	ASTM D5185m	>4	0	<1	0
Nickel	ppm	ASTM D5185m	>4	0	0	0
Titanium	ppm	ASTM D5185m		0	<1	0
Silver	ppm	ASTM D5185m		0	0	0
Aluminum	ppm	ASTM D5185m	>10	0	1	0
Lead	ppm	ASTM D5185m	>20	0	<1	0
Copper	ppm	ASTM D5185m	>40	<1	<1	3
Tin	ppm	ASTM D5185m	>5	0	<1	<1
Vanadium	ppm	ASTM D5185m		0	0	0
White Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE

Silicon	ppm	ASTM D5185m	>25	<1	<1	<1
Potassium	ppm	ASTM D5185m	>20	0	<1	0
Water		WC Method	>0.6	NEG	NEG	NEG
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.6	NEG	NEG	NEG

Sodium	ppm	ASTM D5185m		2	0	<1
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m		0	0	0
Molybdenum	ppm	ASTM D5185m		0	<1	0
Manganese	ppm	ASTM D5185m		0	0	<1
Magnesium	ppm	ASTM D5185m		0	6	0
Calcium	ppm	ASTM D5185m		10	33	13
Phosphorus	ppm	ASTM D5185m		151	169	146
Zinc	ppm	ASTM D5185m		4	24	2
Sulfur	ppm	ASTM D5185m		6744	8192	7196
Acid Number (AN)	mg KOH/g	ASTM D8045	.2	0.18	0.09	0.16
Visc @ 40°C	cSt	ASTM D445	65	65.7	72.1	65.0

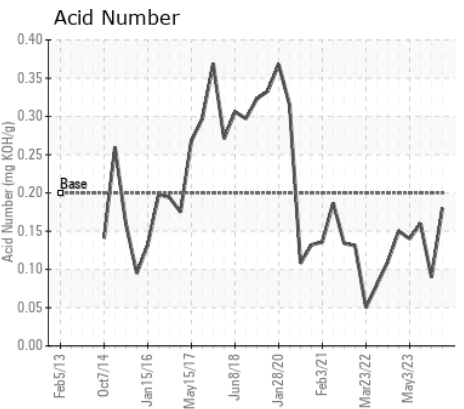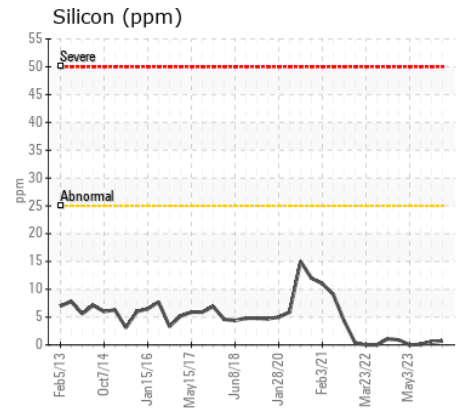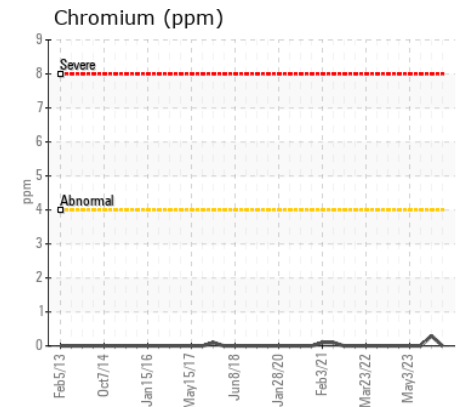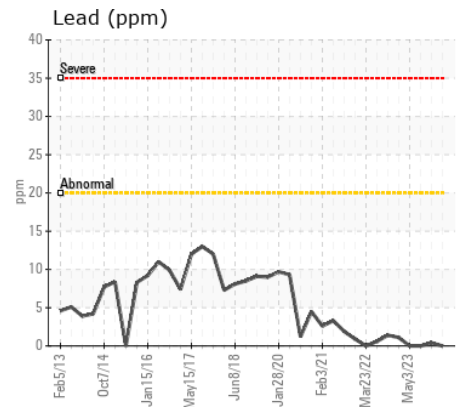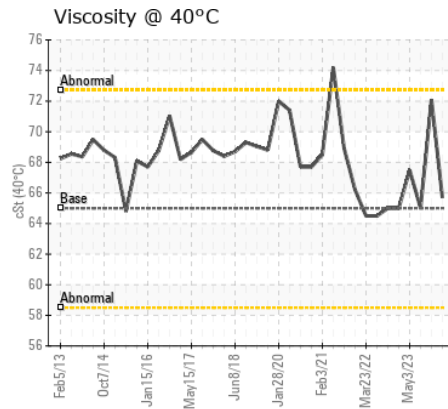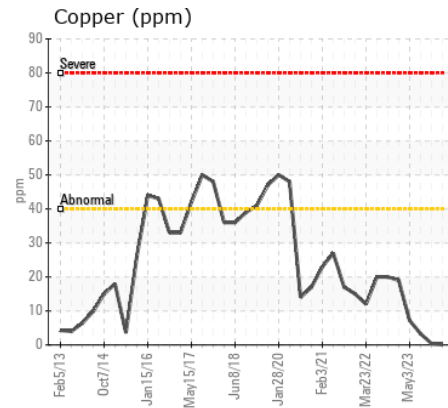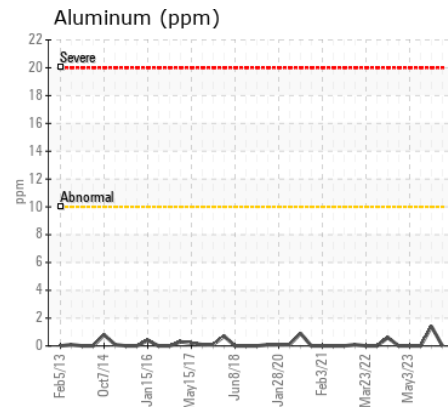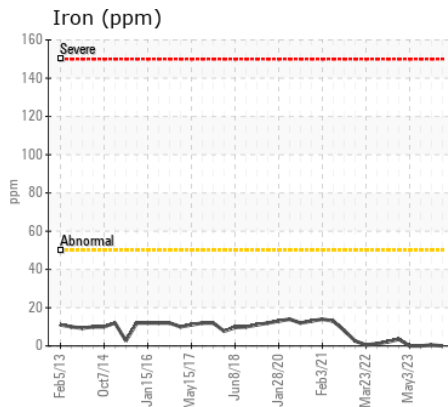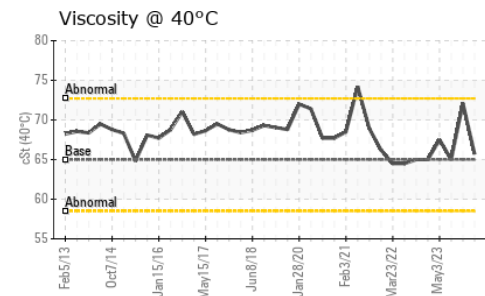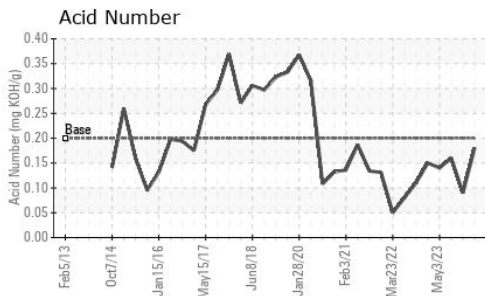

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
 Sample No. : DC0035785
 Lab Number : 06148855
 Unique Number : 10978933
 Test Package : MOB 2

Received : 15 Apr 2024
 Tested : 16 Apr 2024
 Diagnosed : 16 Apr 2024 - Wes Davis

ALSTOM - BALTIMORE
 1600 LUDLOW ST
 BALTIMORE, MD
 US 21230

Contact: SEAN MCCARTY
 sean.mccarty@rail.bombardier.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
 F: (443)220-0469