OIL ANALYSIS REPORT

WEAR CONTAMINATION FLUID CONDITION **ABNORMAL NORMAL NORMAL**


Machine Id

NORD-MAIN GEAR CLARIFIER 2

Gearbox

TRC 890 VARI-PURPOSE SAE80W90 (1 GAL)

THE 890 VARI-PURPOSE SAE80W90 (T GAL)							
RECOMMENDATION	Test	UOM	Method	Limit/Abn	Current	History1	History2
No corrective action is recommended at this time. Resample at the next service interval to monitor.	Sample Number		Client Info		TR06148859		
	Sample Date		Client Info		04 Apr 2024		
	Machine Age	hrs	Client Info		27508		
	Oil Age	hrs	Client Info		8884		
	Filter Age	hrs	Client Info		0		
	Oil Changed		Client Info		Not Changd		
	Filter Changed		Client Info		Not Changd		
	Sample Status				ABNORMAL		
WEAR	Iron	ppm	ASTM D5185m	>200	▲ 316		
	Chromium	ppm	ASTM D5185m		4		
Gear wear is indicated. Bearing and/or bushing wear is indicated.	Nickel	ppm	ASTM D5185m		1		
	Titanium	ppm	ASTM D5185m	>10	0		
	Silver		ASTM D5185m		0		
	Aluminum	ppm	ASTM D5185m	\25	0		
	Lead	ppm	ASTM D5185m		22		
	Copper	ppm	ASTM D5185m				
	Tin	ppm	ASTM D5185m		<u>^</u> 264		
		ppm		>10	<u> </u>		
	Vanadium White Metal	ppm	ASTM D5185m	NONE	<1 NONE		
		scalar	*Visual	NONE			
	Yellow Metal	scalar	*Visual	NONE	NONE		
CONTAMINATION	Silicon	ppm	ASTM D5185m	>50	3		
There is no indication of any contamination in the oil.	Potassium	ppm	ASTM D5185m	>20	2		
	Water	%	ASTM D6304	>0.2	0.137		
	ppm Water	ppm	ASTM D6304	>2000	1370		
	Silt	scalar	*Visual	NONE	NONE		
	Debris	scalar	*Visual	NONE	LIGHT		
	Sand/Dirt	scalar	*Visual	NONE	NONE		
	Appearance	scalar	*Visual	NORML	NORML		
	Odor	scalar	*Visual	NORML	NORML		
	Emulsified Water	scalar	*Visual	>0.2	0.2%		
FLUID CONDITION	Sodium	ppm	ASTM D5185m		0		
	Boron	ppm	ASTM D5185m		0		
The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.	Barium	ppm	ASTM D5185m		0		
	Molybdenum	ppm	ASTM D5185m		0		
	Manganese	ppm	ASTM D5185m		2		
	Magnesium	ppm	ASTM D5185m		0		
	Calcium	ppm	ASTM D5185m		12		
	Phosphorus	ppm	ASTM D5185m	1000	587		
	Zinc	ppm	ASTM D5185m	.000	22		
	Sulfur	ppm	ASTM D5185m	17000	19066		
	Acid Number (AN)	mg KOH/g	ASTM D3103111	17000	0.70		
	Visc @ 40°C	cSt	ASTM D8045	207	172		
	Visc @ 100°C	cSt	ASTM D445		18.0		
			ASTM D445				
	Viscosity Index (VI)	Scale	ASTIVI DZZ/U	30	115		

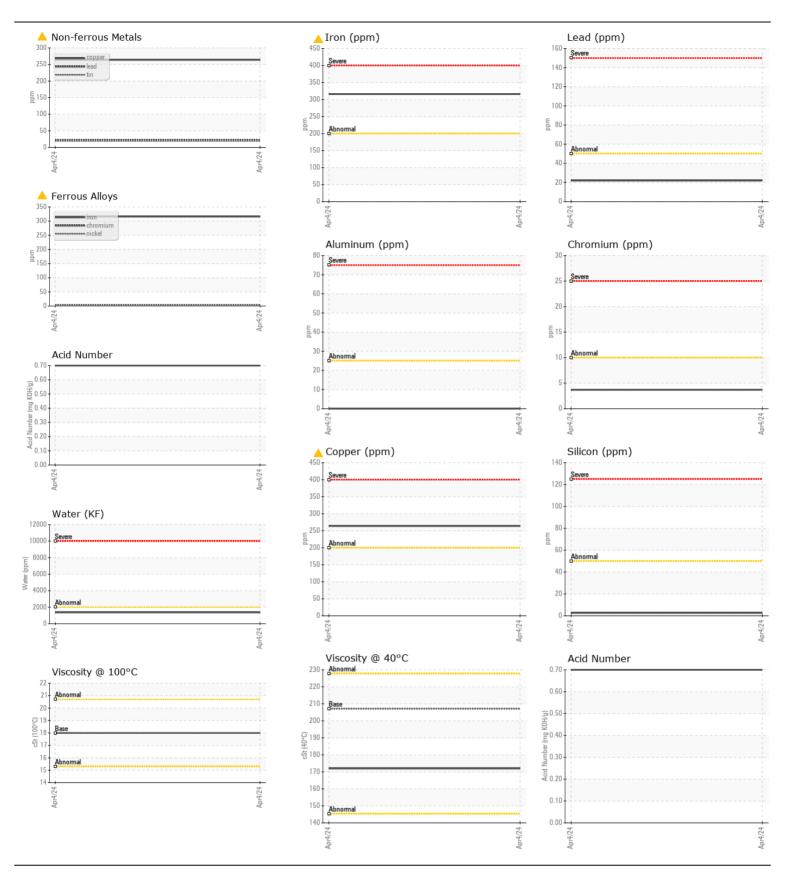



Laboratory Sample No.

: TR06148859 Lab Number : 06148859

: WearCheck USA - 501 Madison Ave., Cary, NC 27513

Received **Tested** Unique Number: 10978937

Diagnosed

: 15 Apr 2024 : 17 Apr 2024 : 17 Apr 2024 - Don Baldridge

CITY OF MCHENRY - KEVIN BEGGS 1415 INDUSTRIAL DR

MCHENRY, IL US 60050 Contact: JERRY MORTON

Test Package: MOB 2 (Additional Tests: KF, KV100, VI) Certificate L2367 To discuss this sample report, contact Customer Service at 1-800-827-0711.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:

F: