



# OIL ANALYSIS REPORT

WEAR	NORMAL
CONTAMINATION	NORMAL
FLUID CONDITION	NORMAL

Machine Id  
**JENBACHER E1**  
 Component  
**Biogas Engine**  
 Fluid  
**CONOCO EL MAR LA4 EXD (180 GAL)**

## RECOMMENDATION

Resample at the next service interval to monitor.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		<b>WC0896474</b>	WC0896472	WC0896478
Sample Date		Client Info		<b>09 Apr 2024</b>	01 Apr 2024	22 Mar 2024
Machine Age	hrs	Client Info		<b>26249</b>	26036	25832
Oil Age	hrs	Client Info		<b>5851</b>	5638	5434
Filter Age	hrs	Client Info		<b>5851</b>	5638	5434
Oil Changed		Client Info		<b>Not Changd</b>	Not Changd	Not Changd
Filter Changed		Client Info		<b>Not Changd</b>	Not Changd	Not Changd
Sample Status				<b>NORMAL</b>	NORMAL	NORMAL

## WEAR

All component wear rates are normal.

Iron	ppm	ASTM D5185m	>20	<b>4</b>	3	4
Chromium	ppm	ASTM D5185m	>5	<b>&lt;1</b>	<1	<1
Nickel	ppm	ASTM D5185m	>2	<b>&lt;1</b>	0	<1
Titanium	ppm	ASTM D5185m		<b>0</b>	0	0
Silver	ppm	ASTM D5185m	>5	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m	>15	<b>6</b>	7	7
Lead	ppm	ASTM D5185m	>20	<b>2</b>	3	4
Copper	ppm	ASTM D5185m	>15	<b>1</b>	<1	2
Tin	ppm	ASTM D5185m	>5	<b>&lt;1</b>	2	2
Vanadium	ppm	ASTM D5185m		<b>&lt;1</b>	0	0
White Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE

## CONTAMINATION













There is no indication of any contamination in the oil.

Silicon	ppm	ASTM D5185m	>200	<b>135</b>	150	127
Potassium	ppm	ASTM D5185m	>20	<b>0</b>	0	2
Fuel		WC Method	>4.0	<b>&lt;1.0</b>	<1.0	<1.0
Water		WC Method	>.2	<b>NEG</b>	NEG	NEG
Glycol		WC Method		<b>NEG</b>	NEG	NEG
Soot %	%	*ASTM D7844	>2	<b>0</b>	0	0
Nitration	Abs/cm	*ASTM D7624	>20	<b>5.8</b>	5.8	5.9
Sulfation	Abs/.1mm	*ASTM D7415	>30	<b>21.5</b>	21.5	21.4
Silt	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Debris	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Appearance	scalar	*Visual	NORML	<b>NORML</b>	NORML	NORML
Odor	scalar	*Visual	NORML	<b>NORML</b>	NORML	NORML
Emulsified Water	scalar	*Visual	>.2	<b>NEG</b>	NEG	NEG

## FLUID CONDITION

The BN result indicates that there is suitable alkalinity remaining in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

Sodium	ppm	ASTM D5185m	>20	<b>2</b>	2	2
Boron	ppm	ASTM D5185m		<b>0</b>	0	<1
Barium	ppm	ASTM D5185m		<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m		<b>&lt;1</b>	0	<1
Manganese	ppm	ASTM D5185m		<b>0</b>	<1	<1
Magnesium	ppm	ASTM D5185m		<b>4</b>	<1	8
Calcium	ppm	ASTM D5185m	1500	<b>1842</b>	1966	1930
Phosphorus	ppm	ASTM D5185m	280	<b>295</b>	343	352
Zinc	ppm	ASTM D5185m	330	<b>366</b>	449	456
Sulfur	ppm	ASTM D5185m		<b>3246</b>	3951	3920
Oxidation	Abs/.1mm	*ASTM D7414	>25	<b>15.9</b>	16.1	16.1
Acid Number (AN)	mg KOH/g	ASTM D8045	0.11	<b>1.78</b>	1.88	2.96
Base Number (BN)	mg KOH/g	ASTM D2896	5.5	<b>3.60</b>	3.79	4.20
Visc @ 100°C	cSt	ASTM D445	13.9	<b>14.5</b>	14.4	14.5

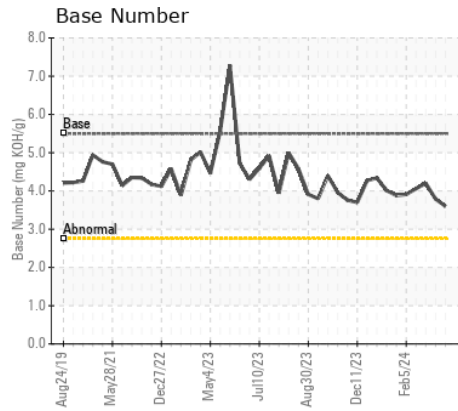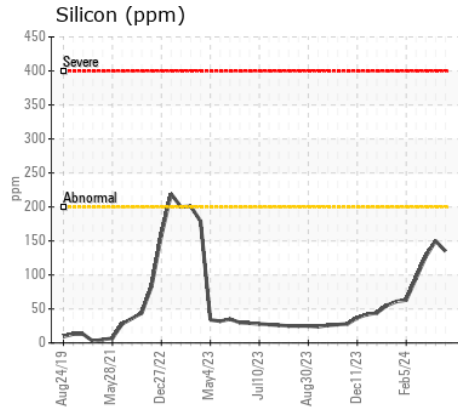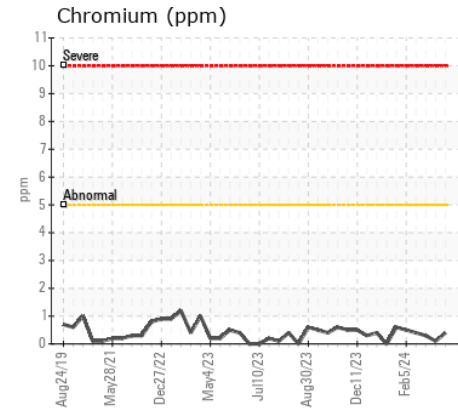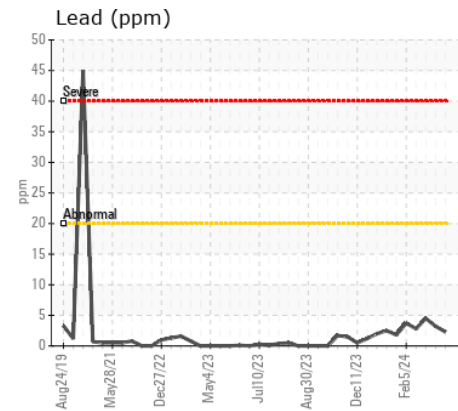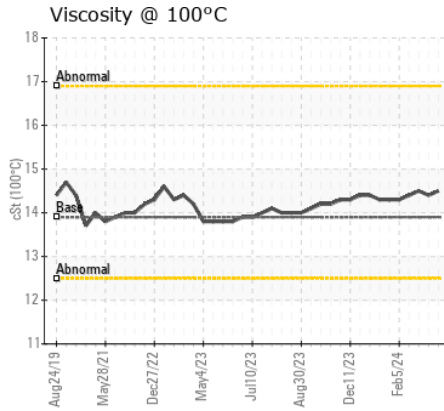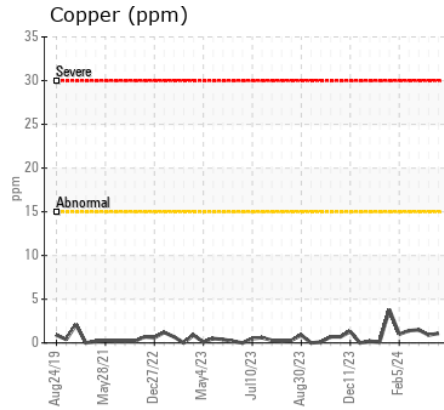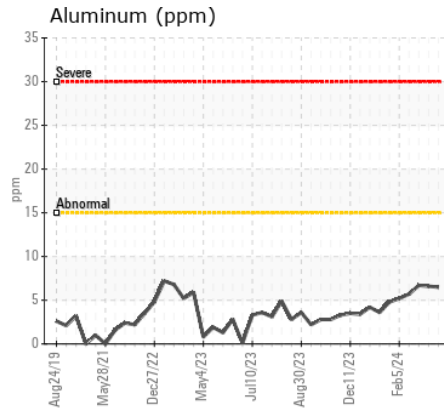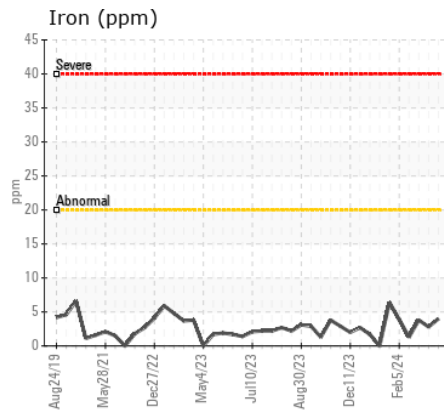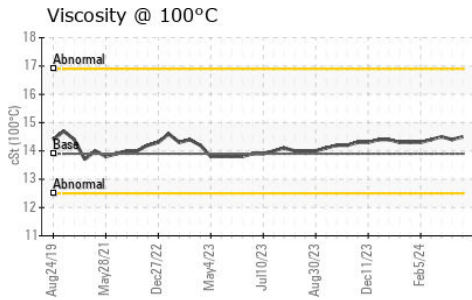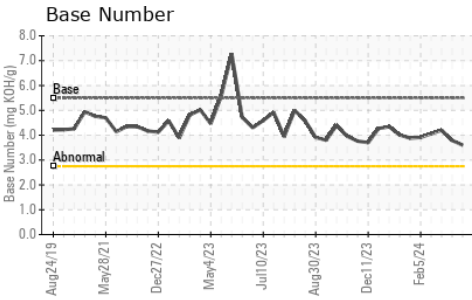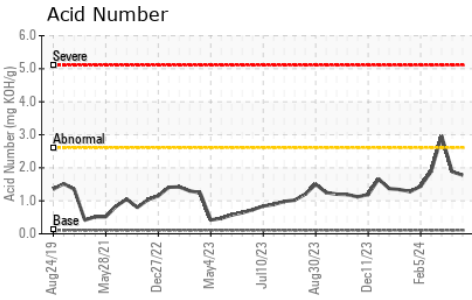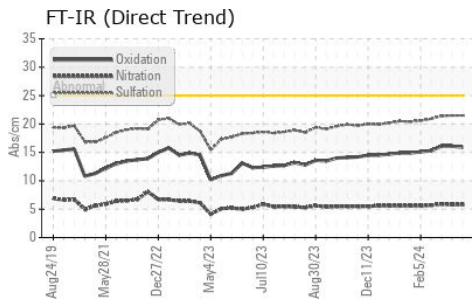

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : WC0896474  
**Lab Number** : 06148887  
**Unique Number** : 10978965  
**Test Package** : MOB 2  
**Received** : 15 Apr 2024  
**Tested** : 16 Apr 2024  
**Diagnosed** : 17 Apr 2024 - Sean Felton

**SANTEE COOPER / LEE COUNTY LANDFILL**  
 1435 SUMTER HIGHWAY (HWY 15)  
 BISHOPVILLE, SC  
 US 29010  
 Contact: DAVID WINSTEAD  
 david.winstead@santeecooper.com; dhwinste@santeecooper.com  
 T: (843)248-7235  
 F: (843)234-7206

Certificate L2367  
 To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)