



TRAAP

Texas Refinery Advanced Analysis Program

# OIL ANALYSIS REPORT

WEAR	NORMAL
CONTAMINATION	NORMAL
FLUID CONDITION	NORMAL

Machine Id  
**CUMMINS NORTH RIVERSIDE LIFT**  
 Component  
**Left Genset**  
 Fluid  
**TRC PRO-SPEC IV HD 5W40 (16 QTS)**

## RECOMMENDATION

Resample at the next service interval to monitor.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		TR06148918	---	---
Sample Date		Client Info		04 Apr 2024	---	---
Machine Age	hrs	Client Info		1152	---	---
Oil Age	hrs	Client Info		58	---	---
Filter Age	hrs	Client Info		58	---	---
Oil Changed		Client Info		Not Changd	---	---
Filter Changed		Client Info		Not Changd	---	---
Sample Status				NORMAL	---	---

## WEAR

All component wear rates are normal.

Iron	ppm	ASTM D5185m	>50	3	---	---
Chromium	ppm	ASTM D5185m	>4	<1	---	---
Nickel	ppm	ASTM D5185m	>2	0	---	---
Titanium	ppm	ASTM D5185m		0	---	---
Silver	ppm	ASTM D5185m	>5	0	---	---
Aluminum	ppm	ASTM D5185m	>12	<1	---	---
Lead	ppm	ASTM D5185m	>17	0	---	---
Copper	ppm	ASTM D5185m	>70	2	---	---
Tin	ppm	ASTM D5185m	>15	0	---	---
Vanadium	ppm	ASTM D5185m		<1	---	---
White Metal	scalar	*Visual	NONE	NONE	---	---
Yellow Metal	scalar	*Visual	NONE	NONE	---	---

## CONTAMINATION












There is no indication of any contamination in the oil.

Silicon	ppm	ASTM D5185m	>25	20	---	---
Potassium	ppm	ASTM D5185m	>20	<1	---	---
Fuel		WC Method	>4.0	<1.0	---	---
Water		WC Method	>0.1	NEG	---	---
Glycol		WC Method		NEG	---	---
Soot %	%	*ASTM D7844		0	---	---
Nitration	Abs/cm	*ASTM D7624	>20	7.1	---	---
Sulfation	Abs/.1mm	*ASTM D7415	>30	17.2	---	---
Silt	scalar	*Visual	NONE	NONE	---	---
Debris	scalar	*Visual	NONE	NONE	---	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---	---
Appearance	scalar	*Visual	NORML	NORML	---	---
Odor	scalar	*Visual	NORML	NORML	---	---
Emulsified Water	scalar	*Visual	>0.1	NEG	---	---

## FLUID CONDITION

The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

Sodium	ppm	ASTM D5185m		2	---	---
Boron	ppm	ASTM D5185m		0	---	---
Barium	ppm	ASTM D5185m		0	---	---
Molybdenum	ppm	ASTM D5185m		4	---	---
Manganese	ppm	ASTM D5185m		<1	---	---
Magnesium	ppm	ASTM D5185m		68	---	---
Calcium	ppm	ASTM D5185m	4500	3933	---	---
Phosphorus	ppm	ASTM D5185m		776	---	---
Zinc	ppm	ASTM D5185m	1200	921	---	---
Sulfur	ppm	ASTM D5185m		4095	---	---
Oxidation	Abs/.1mm	*ASTM D7414	>25	11.7	---	---
Base Number (BN)	mg KOH/g	ASTM D2896	15	14.88	---	---
Visc @ 100°C	cSt	ASTM D445	15	14.6	---	---

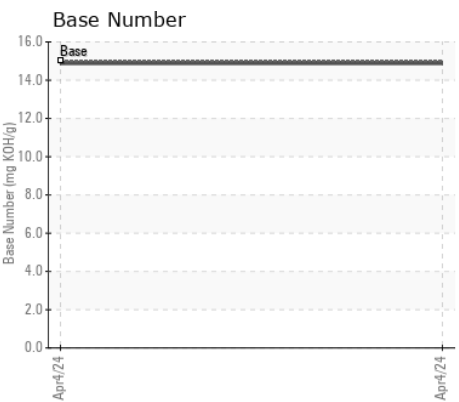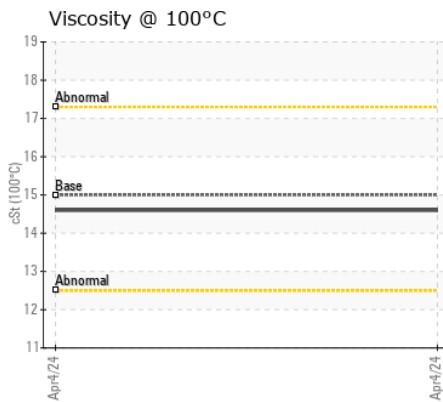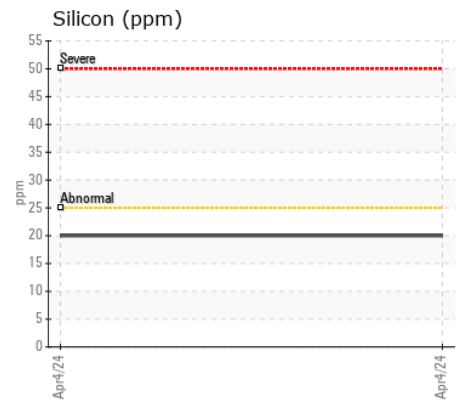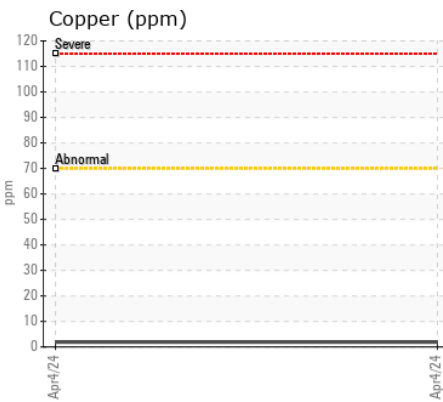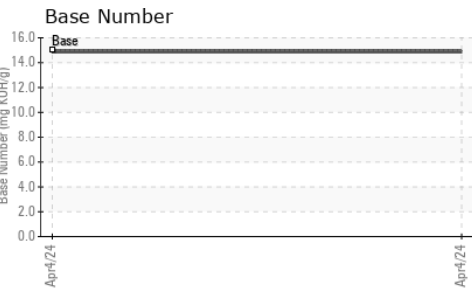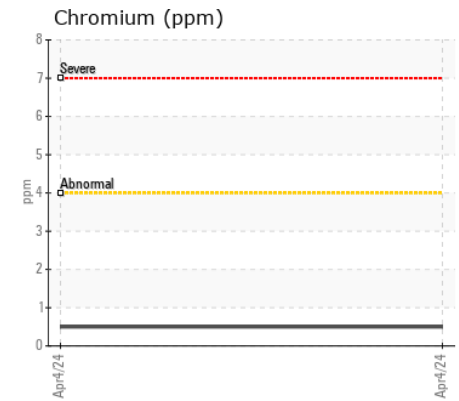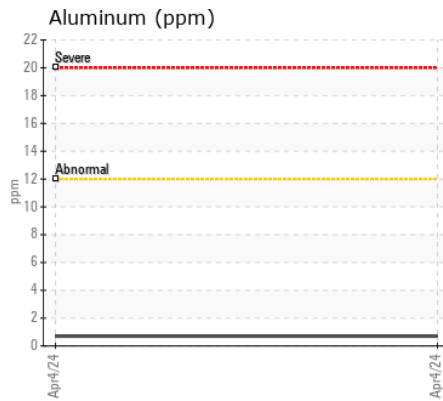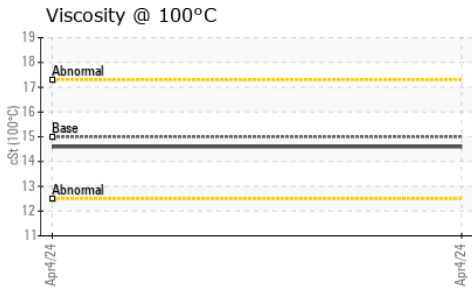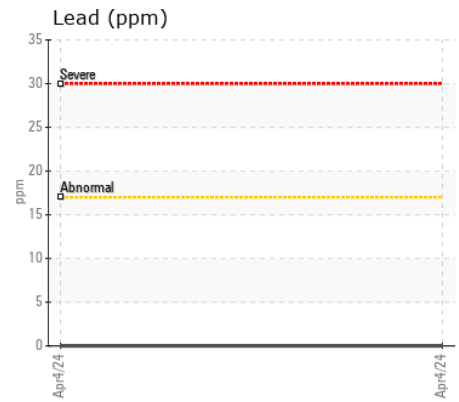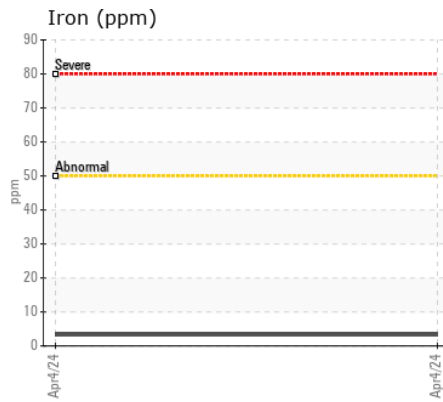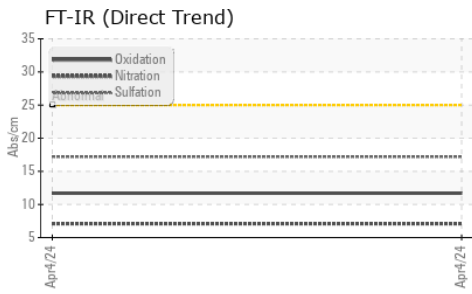

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
 Sample No. : TR06148918  
 Lab Number : 06148918  
 Unique Number : 10978996  
 Test Package : MOB 2

Received : 15 Apr 2024  
 Tested : 18 Apr 2024  
 Diagnosed : 18 Apr 2024 - Doug Bogart

**CITY OF MCHENRY - KEVIN BEGGS**  
 1415 INDUSTRIAL DR  
 MCHENRY, IL  
 US 60050  
 Contact: JERRY MORTON

To discuss this sample report, contact Customer Service at 1-800-827-0711.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:  
F: