



FUEL REPORT

CORROSION	NORMAL
CONTAMINANTS	ATTENTION
FUEL CONDITION	ABNORMAL

Machine Id
CUMMINS GEN 2 - NOVANT HEALTH
 Component
Tank Diesel Fuel
 Fluid
No.2 DIESEL FUEL (ULTRALOW SULPHUR) (--- GAL)

RECOMMENDATION

We advise that you filter this fluid before use. Resample at the next service interval to monitor.

CORROSION

All metal levels are normal indicating no corrosion in the cooling system.

CONTAMINANTS


There is a moderate amount of particulates present in the fuel. The water content is negligible.

FUEL CONDITION


Laboratory tests indicate that this sample does NOT meet specifications for No.2 ultra-low-sulfur diesel fuel (US EPA/CGSB-3.517-3 type B).

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		DC0030160	---	---
Sample Date		Client Info		14 Apr 2024	---	---
Machine Age	hrs	Client Info		0	---	---
Sample Status				ABNORMAL	---	---
Aluminum	ppm	ASTM D5185m	<0.1	0	---	---
Nickel	ppm	ASTM D5185m	<0.1	0	---	---
Lead	ppm	ASTM D5185m	<0.1	0	---	---
Vanadium	ppm	ASTM D5185m	<0.1	0	---	---
Iron	ppm	ASTM D5185m	<0.1	0	---	---
Silicon	ppm	ASTM D5185m	<1.0	0	---	---
Sodium	ppm	ASTM D5185m	<0.1	<1	---	---
Potassium	ppm	ASTM D5185m	<0.1	0	---	---
Water	%	ASTM D6304	<0.05	0.003	---	---
ppm Water	ppm	ASTM D6304	<500	38	---	---
Particles >4µm		ASTM D7647	>2500	3771	---	---
Particles >6µm		ASTM D7647	>640	1131	---	---
Particles >14µm		ASTM D7647	>80	124	---	---
Particles >21µm		ASTM D7647	>20	35	---	---
Particles >38µm		ASTM D7647	>4	0	---	---
Particles >71µm		ASTM D7647	>3	0	---	---
Oil Cleanliness		ISO 4406 (c)	>18/16/13	19/17/14	---	---
% Gasoline	%	*In-House	<0.50	0.0	---	---
% Biodiesel	%	*In-House	<20.0	0.0	---	---
Calcium	ppm	ASTM D5185m	<0.1	▲ 11	---	---
Magnesium	ppm	ASTM D5185m	<0.1	0	---	---
Phosphorus	ppm	ASTM D5185m	<0.1	1	---	---
Zinc	ppm	ASTM D5185m	<0.1	0	---	---
ASTM Color	scalar	*ASTM D1500		L4.5	---	---
Visc @ 40°C	cSt	ASTM D445	3.0	2.46	---	---
Sulfur	ppm	ASTM D5185m	10	▲ 100	---	---
Sulfur (UVF)	ppm	ASTM D5453		118	---	---
API Gravity		ASTM D7777	37.7	36.1	---	---

▲ Additives

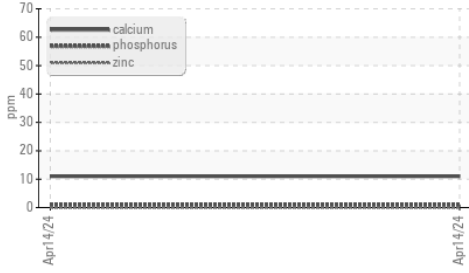


● Particle Count

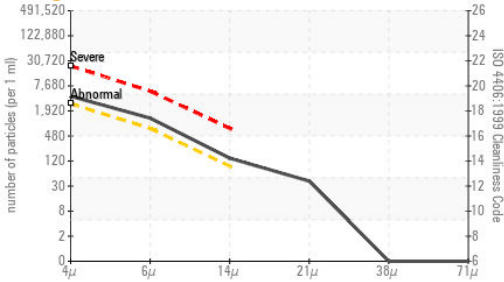

● Particle Trend




Water (KF)

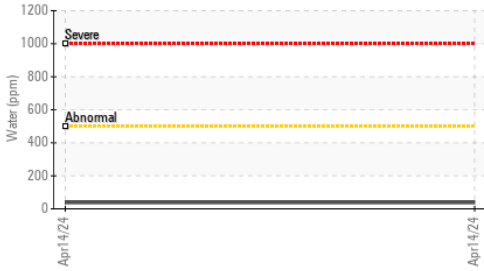

Viscosity @ 40°C



Pensky-Martens Flash Point (°C)

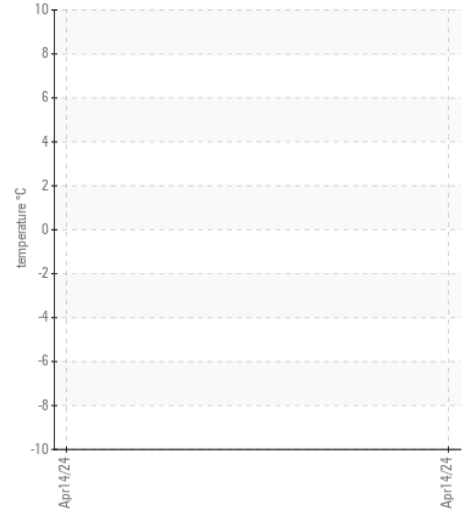

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : DC0030160 **Received** : 15 Apr 2024
Lab Number : 06149231 **Tested** : 19 Apr 2024
Unique Number : 10979309 **Diagnosed** : 26 Apr 2024 - Angela Borella
Test Package : DF-5 (Additional Tests: API, Cetane, Fuel, Screen)

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

JE RICHARDS
 4600 HARGROVE DR
 LANHAM, MD
 US 20706
 Contact: E. NOEL
 enoel@phalconusa.com
 T: (240)623-4398
 F: