



WEAR	NORMAL
CONTAMINATION	NORMAL
FLUID CONDITION	NORMAL

Area

CHRIS THOMPSON [6615]

Machine Id

NORTHERN LIGHTS M673L3.3 6732-47598C

Component

Genset

Fluid

{not provided} (--- GAL)

RECOMMENDATION

No corrective action is recommended at this time. Resample at the next service interval to monitor.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		VPA051558	---	---
Sample Date		Client Info		15 Apr 2024	---	---
Machine Age	hrs	Client Info		272	---	---
Oil Age	hrs	Client Info		0	---	---
Filter Age	hrs	Client Info		0	---	---
Oil Changed		Client Info		Not Changd	---	---
Filter Changed		Client Info		Not Changd	---	---
Sample Status				NORMAL	---	---

WEAR

All component wear rates are normal.

Iron	ppm	ASTM D5185m	>50	16	---	---
Chromium	ppm	ASTM D5185m	>4	0	---	---
Nickel	ppm	ASTM D5185m	>2	0	---	---
Titanium	ppm	ASTM D5185m		0	---	---
Silver	ppm	ASTM D5185m	>5	0	---	---
Aluminum	ppm	ASTM D5185m	>12	1	---	---
Lead	ppm	ASTM D5185m	>17	0	---	---
Copper	ppm	ASTM D5185m	>70	4	---	---
Tin	ppm	ASTM D5185m	>15	<1	---	---
Vanadium	ppm	ASTM D5185m		0	---	---
White Metal	scalar	*Visual	NONE	NONE	---	---
Yellow Metal	scalar	*Visual	NONE	NONE	---	---

CONTAMINATION












There is no indication of any contamination in the oil.

Silicon	ppm	ASTM D5185m	>25	5	---	---
Potassium	ppm	ASTM D5185m	>20	3	---	---
Fuel		WC Method	>4.0	<1.0	---	---
Water		WC Method	>0.1	NEG	---	---
Glycol		WC Method		NEG	---	---
Soot %	%	*ASTM D7844		0	---	---
Nitration	Abs/cm	*ASTM D7624	>20	6.1	---	---
Sulfation	Abs/.1mm	*ASTM D7415	>30	17.4	---	---
Silt	scalar	*Visual	NONE	NONE	---	---
Debris	scalar	*Visual	NONE	NONE	---	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---	---
Appearance	scalar	*Visual	NORML	NORML	---	---
Odor	scalar	*Visual	NORML	NORML	---	---
Emulsified Water	scalar	*Visual	>0.1	NEG	---	---

FLUID CONDITION

The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is acceptable for the time in service.

Sodium	ppm	ASTM D5185m		4	---	---
Boron	ppm	ASTM D5185m		103	---	---
Barium	ppm	ASTM D5185m		0	---	---
Molybdenum	ppm	ASTM D5185m		2	---	---
Manganese	ppm	ASTM D5185m		<1	---	---
Magnesium	ppm	ASTM D5185m		653	---	---
Calcium	ppm	ASTM D5185m		1333	---	---
Phosphorus	ppm	ASTM D5185m		670	---	---
Zinc	ppm	ASTM D5185m		781	---	---
Sulfur	ppm	ASTM D5185m		3494	---	---
Oxidation	Abs/.1mm	*ASTM D7414	>25	12.3	---	---
Base Number (BN)	mg KOH/g	ASTM D2896		8.8	---	---
Visc @ 100°C	cSt	ASTM D445		14.1	---	---

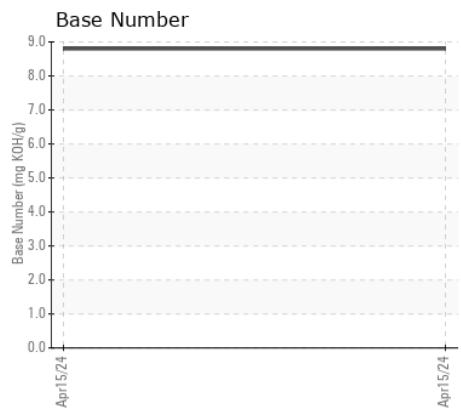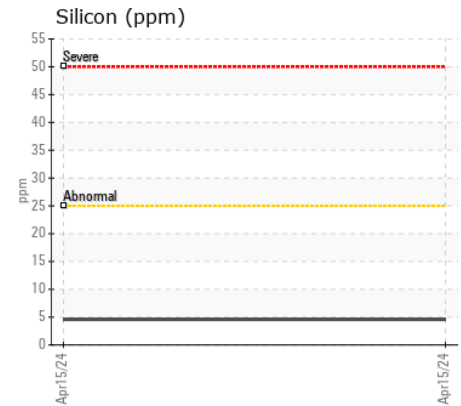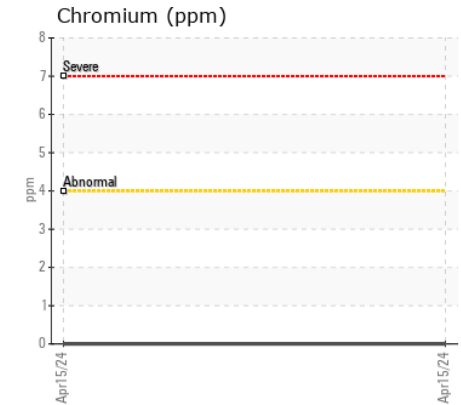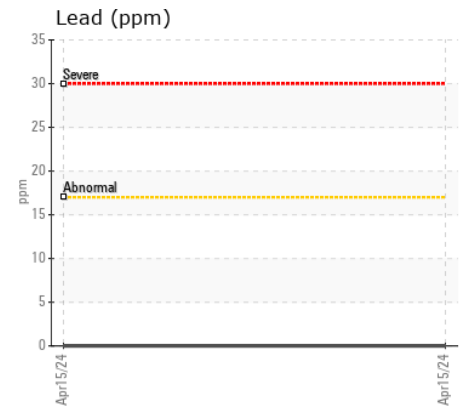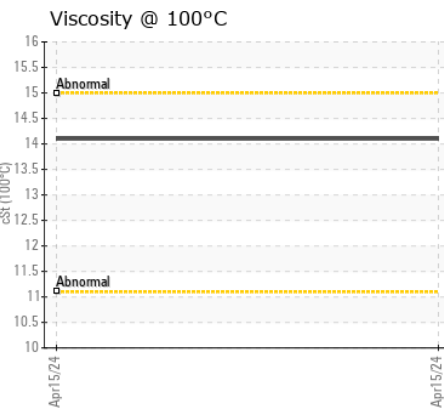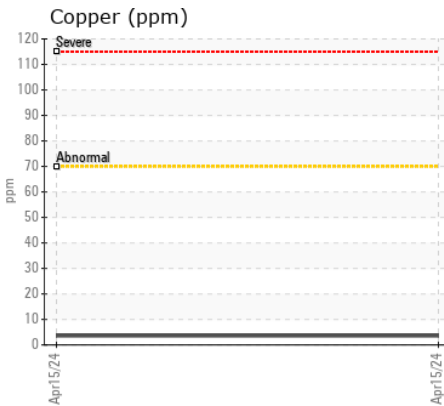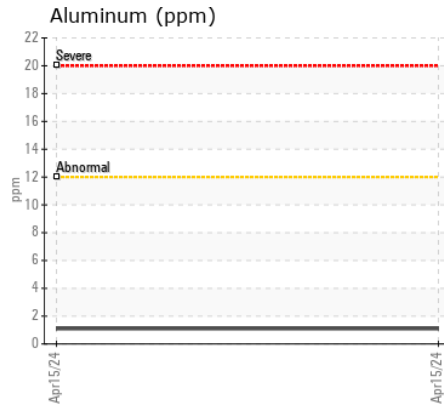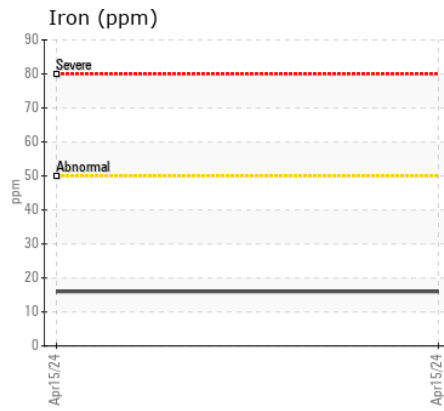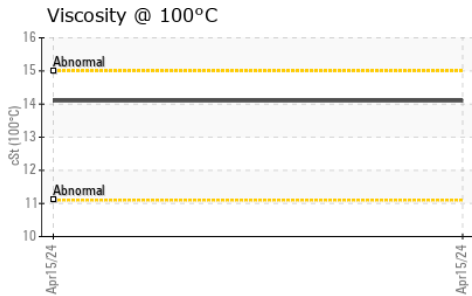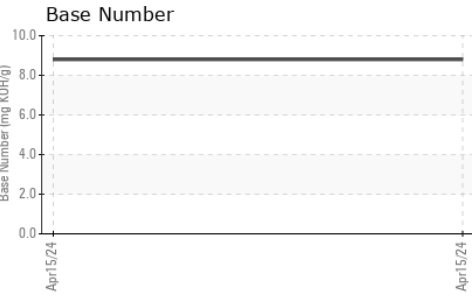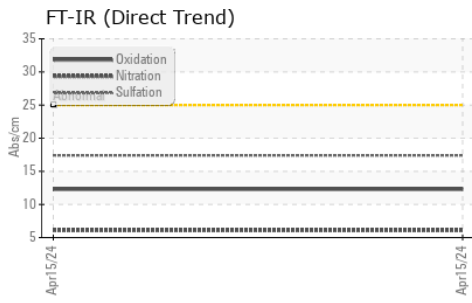

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : VPA051558 **Received** : 16 Apr 2024
Lab Number : 06150137 **Tested** : 16 Apr 2024
Unique Number : 10980215 **Diagnosed** : 16 Apr 2024 - Doug Bogart
Test Package : MOB 1 (Additional Tests: TBN)

Northwest Diesel Power
 1325 ROEDER AVE SUITE 103
 BELLINGHAM, WA
 US 98225
 Contact: BRANDON ROBERTSON
 parts@nwdieselpower.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
F: