WEAR CONTAMINATION FLUID CONDITION

NORMAL
ATTENTION
NORMAL


Machine Id

13105

Component Hydraulic System

{not provided} (--- GAL)

·							
RECOMMENDATION	Test	UOM	Method	Limit/Abn	Current	History1	History2
No corrective action is recommended at this time. Resample at the next service interval to monitor. Please specify the brand, type, and viscosity of the oil on your next sample.	Sample Number		Client Info		PCA0121174		
	Sample Date		Client Info		10 Apr 2024		
	Machine Age	hrs	Client Info		0		
	Oil Age	hrs	Client Info		0		
	Filter Age	hrs	Client Info		0		
	Oil Changed		Client Info		N/A		
	Filter Changed		Client Info		N/A		
	Sample Status				ATTENTION		
WEAR	Iron	ppm	ASTM D5185m	>20	<1		
All component wear rates are normal.	Chromium	ppm	ASTM D5185m	>20	0		
	Nickel	ppm	ASTM D5185m	>20	0		
	Titanium	ppm	ASTM D5185m		0		
	Silver	ppm	ASTM D5185m		0		
	Aluminum	ppm	ASTM D5185m	>20	0		
	Lead	ppm	ASTM D5185m	>20	0		
	Copper	ppm	ASTM D5185m		<1		
	Tin	ppm	ASTM D5185m	>20	<1		
	Vanadium	ppm	ASTM D5185m		0		
	White Metal	scalar	*Visual	NONE	NONE		
	Yellow Metal	scalar	*Visual	NONE	NONE		
			40714 05405				
CONTAMINATION	Silicon	ppm	ASTM D5185m		11		
There is a moderate amount of silt (particulates < 14 microns in size) present in the oil.	Potassium	ppm	ASTM D5185m		0		
	Water	%	ASTM D6304	>0.05	NEG		
	Particles >4µm		ASTM D7647		9095		
	Particles >6µm		ASTM D7647		1191		
	Particles >14μm		ASTM D7647		36		
	Particles >21µm		ASTM D7647		8		
	Particles >38µm		ASTM D7647		1		
	Particles >71μm		ASTM D7647		1		
	Oil Cleanliness		ISO 4406 (c)		20/17/12		
	Silt	scalar	*Visual	NONE	NONE		
	Debris	scalar	*Visual	NONE	NONE		
	Sand/Dirt	scalar	*Visual	NONE	NONE		
	Appearance	scalar	*Visual	NORML	NORML		
	Odor	scalar	*Visual	NORML	NORML		
	Emulsified Water	scalar	*Visual	>0.05	NEG		
FLUID CONDITION	Sodium	ppm	ASTM D5185m		1		
TEOID CONDITION	Boron	ppm	ASTM D5185m		0		
The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.	Barium	ppm	ASTM D5185m		0		
	Molybdenum	ppm	ASTM D5185m		0		
	Manganese	ppm	ASTM D5185m		0		
	Magnesium	ppm	ASTM D5185m		0		
	Calcium	ppm	ASTM D5185m		40		
	Phosphorus	ppm	ASTM D5185m		231		
	Zinc	ppm	ASTM D5185m		257		
	Sulfur	ppm	ASTM D5185m		1688		
	Acid Number (AN)	mg KOH/g	ASTM D8045		0.23		

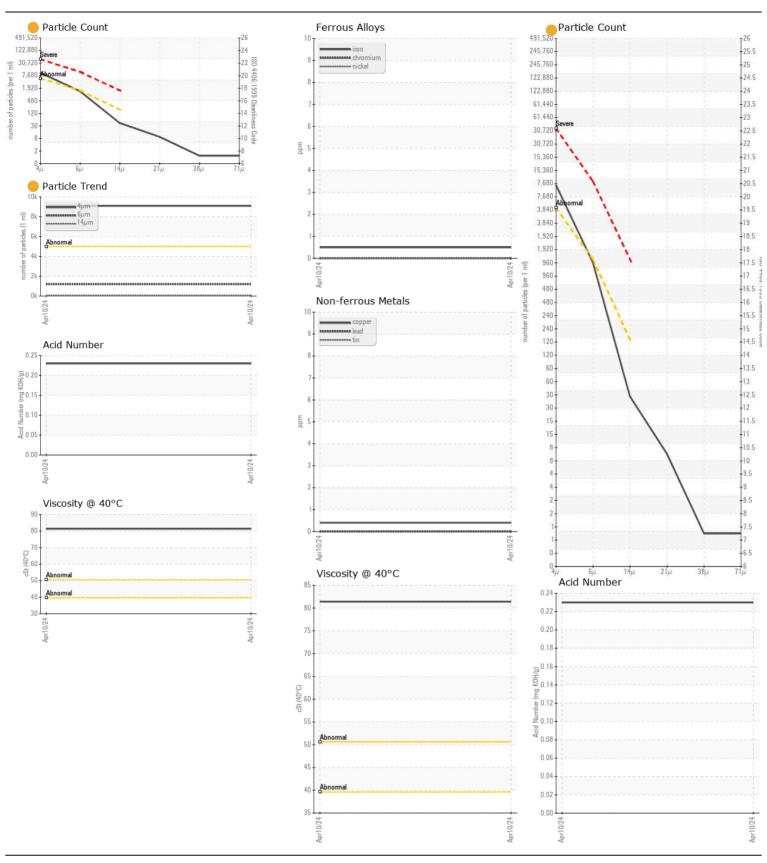



Certificate L2367

Laboratory Sample No.

Lab Number : 06150291 Unique Number: 10980369 Test Package : PLANT

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 : PCA0121174 Received : 16 Apr 2024 Tested : 18 Apr 2024

Diagnosed : 18 Apr 2024 - Don Baldridge **RAYBESTOS POWERTRAIN** 1204 DARLINGTON AVE CRAWFORDSVILLE, IN US 47933

Contact: DON B.

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: F: