



OIL ANALYSIS REPORT

WEAR	NORMAL
CONTAMINATION	NORMAL
FLUID CONDITION	NORMAL

Area

[PMIAS3221625]

Machine Id

GENERAC 5D0200GG178.7 4017299 - HUNTINGTOWN VFDRSC06 (S/N 10027644)

Component

Diesel Engine

Fluid

DIESEL ENGINE OIL SAE 15W40 (7 QTS)

RECOMMENDATION

Resample at the next service interval to monitor.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		DC0034965	DC0029903	DC0026727
Sample Date		Client Info		28 Mar 2024	08 Aug 2023	10 May 2023
Machine Age	hrs	Client Info		157	145	341
Oil Age	hrs	Client Info		0	4	0
Filter Age	hrs	Client Info		0	4	0
Oil Changed		Client Info		Not Changd	Not Changd	Changed
Filter Changed		Client Info		Not Changd	Not Changd	Changed
Sample Status				NORMAL	NORMAL	NORMAL

WEAR

Metal levels are typical for a new component breaking in.

Iron	ppm	ASTM D5185m	>100	1	2	2
Chromium	ppm	ASTM D5185m	>20	<1	<1	0
Nickel	ppm	ASTM D5185m	>4	0	<1	0
Titanium	ppm	ASTM D5185m		0	0	0
Silver	ppm	ASTM D5185m	>3	0	0	0
Aluminum	ppm	ASTM D5185m	>20	2	1	<1
Lead	ppm	ASTM D5185m	>40	<1	<1	<1
Copper	ppm	ASTM D5185m	>330	8	4	1
Tin	ppm	ASTM D5185m	>15	0	0	0
Vanadium	ppm	ASTM D5185m		0	0	0
White Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE

CONTAMINATION












There is no indication of any contamination in the oil.

Silicon	ppm	ASTM D5185m	>25	3	4	3
Potassium	ppm	ASTM D5185m	>20	2	2	1
Fuel		WC Method	>5	<1.0	<1.0	<1.0
Water		WC Method	>0.2	NEG	NEG	NEG
Glycol		WC Method		NEG	NEG	NEG
Soot %	%	*ASTM D7844	>3	0	0	0
Nitration	Abs/cm	*ASTM D7624	>20	4.9	4.7	4.9
Sulfation	Abs/.1mm	*ASTM D7415	>30	15.2	14.8	15.8
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE	LIGHT
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.2	NEG	NEG	NEG

FLUID CONDITION

The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

Sodium	ppm	ASTM D5185m	>158	1	<1	0
Boron	ppm	ASTM D5185m	250	6	5	5
Barium	ppm	ASTM D5185m	10	0	0	2
Molybdenum	ppm	ASTM D5185m	100	4	6	8
Manganese	ppm	ASTM D5185m		0	0	0
Magnesium	ppm	ASTM D5185m	450	54	67	96
Calcium	ppm	ASTM D5185m	3000	2338	2066	2118
Phosphorus	ppm	ASTM D5185m	1150	975	825	853
Zinc	ppm	ASTM D5185m	1350	1070	971	1008
Sulfur	ppm	ASTM D5185m	4250	3992	3832	3854
Oxidation	Abs/.1mm	*ASTM D7414	>25	9.3	9.1	9.4
Base Number (BN)	mg KOH/g	ASTM D2896	8.5	7.4	7.3	7.9
Visc @ 100°C	cSt	ASTM D445	14.4	13.8	13.8	13.4

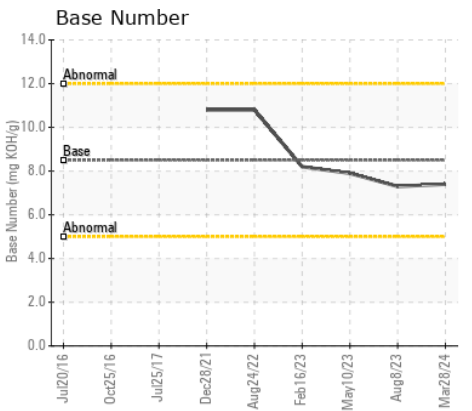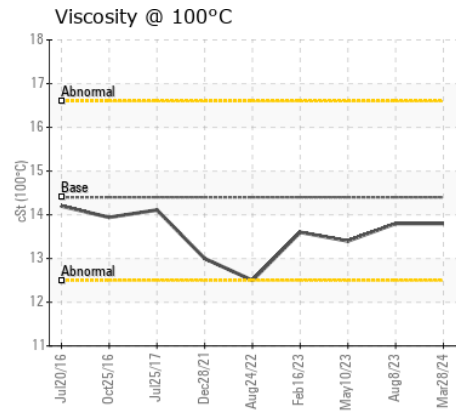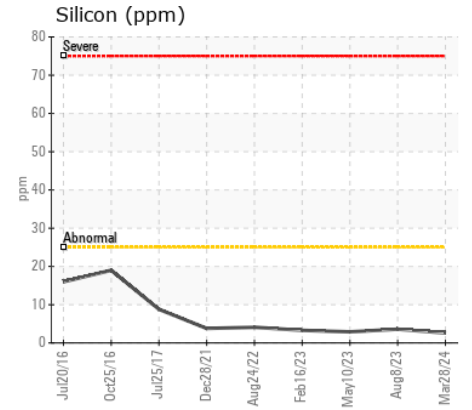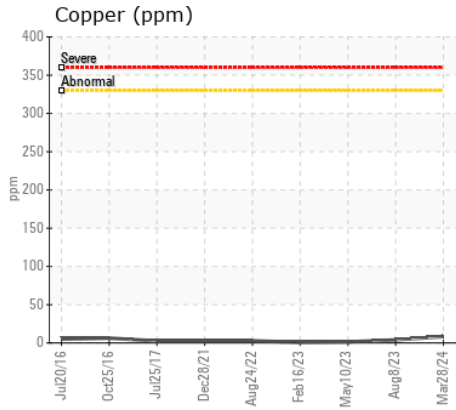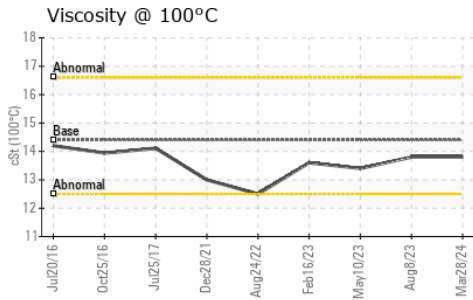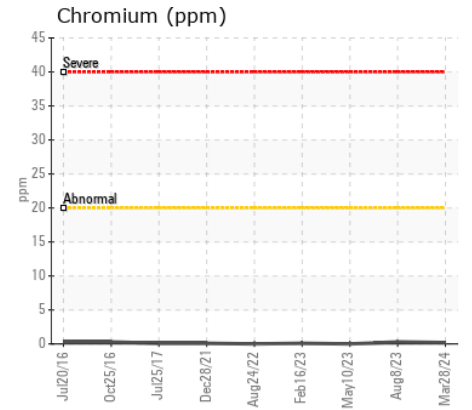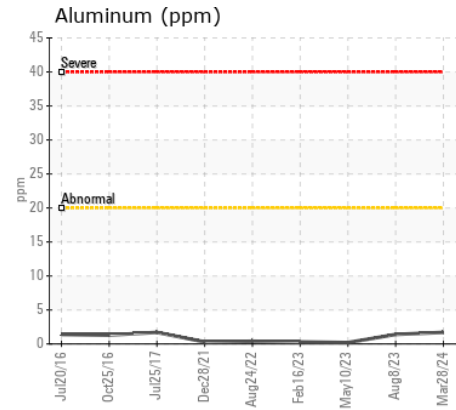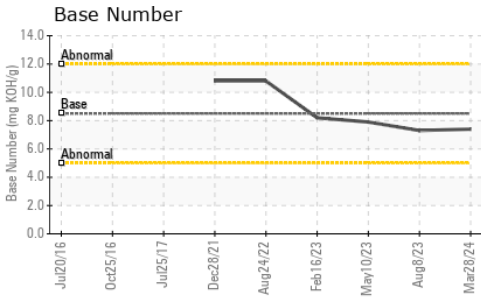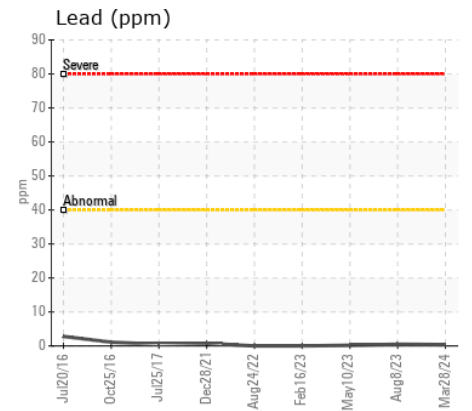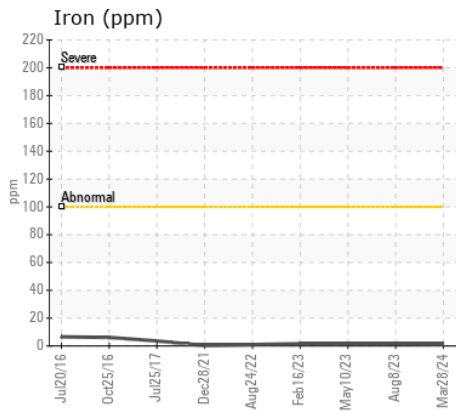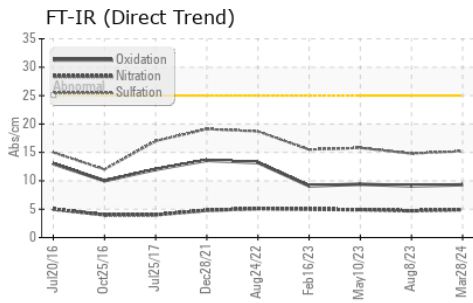

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : DC0034965
Lab Number : 06151830
Unique Number : 10981908
Test Package : MOB 1 (Additional Tests: TBN)

KELLY GENERATOR & EQUIPMENT INC
 1955 DALE LN
 OWINGS, MD
 US 20736
 Contact: LESLIE SNURR
 LSNURR@KGE.COM
 T: (410)257-5225
 F: (410)257-5227

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)