



# OIL ANALYSIS REPORT

WEAR	NORMAL
CONTAMINATION	NORMAL
FLUID CONDITION	ATTENTION

Area  
**[OJT3393264]**  
 Machine Id  
**150RE0ZJF 3379GMKH0027**  
 Component  
**Diesel Engine**  
 Fluid  
**DIESEL ENGINE OIL SAE 15W40 (--- GAL)**

## RECOMMENDATION

Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		DC0035055	---	---
Sample Date		Client Info		20 Mar 2024	---	---
Machine Age	hrs	Client Info		0	---	---
Oil Age	hrs	Client Info		51	---	---
Filter Age	hrs	Client Info		0	---	---
Oil Changed		Client Info		Changed	---	---
Filter Changed		Client Info		Changed	---	---
Sample Status				ATTENTION	---	---

## WEAR

All component wear rates are normal.

Iron	ppm	ASTM D5185m	>100	13	---	---
Chromium	ppm	ASTM D5185m	>20	<1	---	---
Nickel	ppm	ASTM D5185m	>4	0	---	---
Titanium	ppm	ASTM D5185m		0	---	---
Silver	ppm	ASTM D5185m	>3	0	---	---
Aluminum	ppm	ASTM D5185m	>20	6	---	---
Lead	ppm	ASTM D5185m	>40	1	---	---
Copper	ppm	ASTM D5185m	>330	4	---	---
Tin	ppm	ASTM D5185m	>15	0	---	---
Vanadium	ppm	ASTM D5185m		0	---	---
White Metal	scalar	*Visual	NONE	NONE	---	---
Yellow Metal	scalar	*Visual	NONE	NONE	---	---

## CONTAMINATION













Fuel content negligible. There is no indication of any contamination in the oil.

Silicon	ppm	ASTM D5185m	>25	10	---	---
Potassium	ppm	ASTM D5185m	>20	3	---	---
Fuel	%	ASTM D3524	>5	0.2	---	---
Water		WC Method	>0.2	NEG	---	---
Glycol		WC Method		NEG	---	---
Soot %	%	*ASTM D7844	>3	0.1	---	---
Nitration	Abs/cm	*ASTM D7624	>20	6.2	---	---
Sulfation	Abs/.1mm	*ASTM D7415	>30	20.0	---	---
Silt	scalar	*Visual	NONE	NONE	---	---
Debris	scalar	*Visual	NONE	NONE	---	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---	---
Appearance	scalar	*Visual	NORML	NORML	---	---
Odor	scalar	*Visual	NORML	NORML	---	---
Emulsified Water	scalar	*Visual	>0.2	NEG	---	---

## FLUID CONDITION

The oil viscosity is lower than normal. The BN result indicates that there is suitable alkalinity remaining in the oil. Confirm oil type.

Sodium	ppm	ASTM D5185m	>158	2	---	---
Boron	ppm	ASTM D5185m	250	268	---	---
Barium	ppm	ASTM D5185m	10	0	---	---
Molybdenum	ppm	ASTM D5185m	100	264	---	---
Manganese	ppm	ASTM D5185m		1	---	---
Magnesium	ppm	ASTM D5185m	450	797	---	---
Calcium	ppm	ASTM D5185m	3000	1493	---	---
Phosphorus	ppm	ASTM D5185m	1150	997	---	---
Zinc	ppm	ASTM D5185m	1350	1077	---	---
Sulfur	ppm	ASTM D5185m	4250	3106	---	---
Oxidation	Abs/.1mm	*ASTM D7414	>25	15.4	---	---
Base Number (BN)	mg KOH/g	ASTM D2896	8.5	10.3	---	---
Visc @ 100°C	cSt	ASTM D445	14.4	9.8	---	---

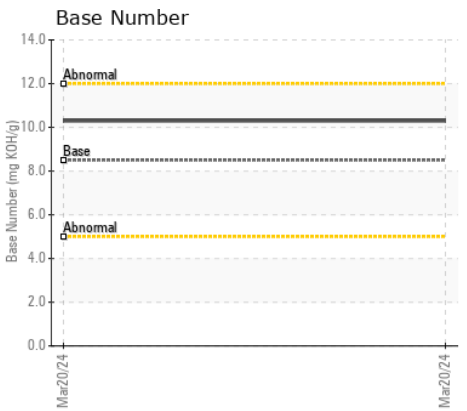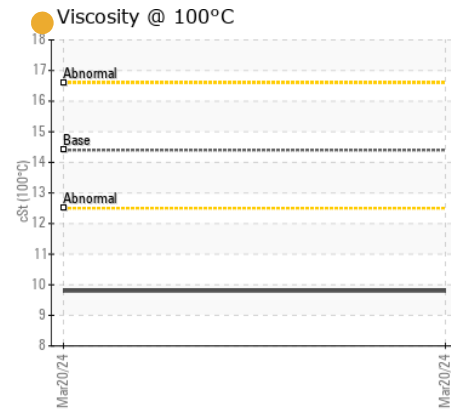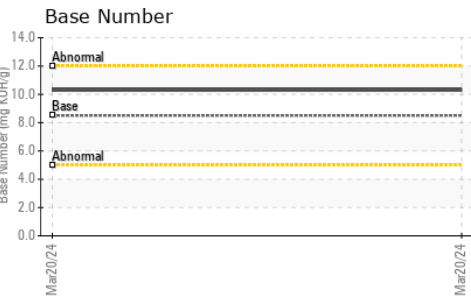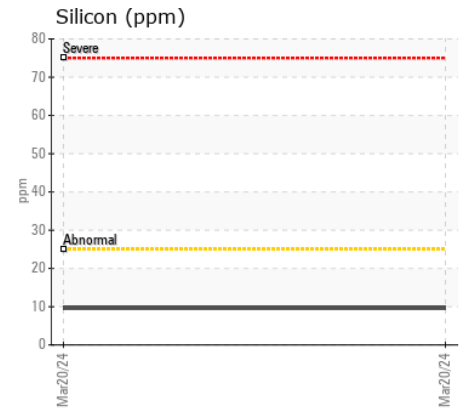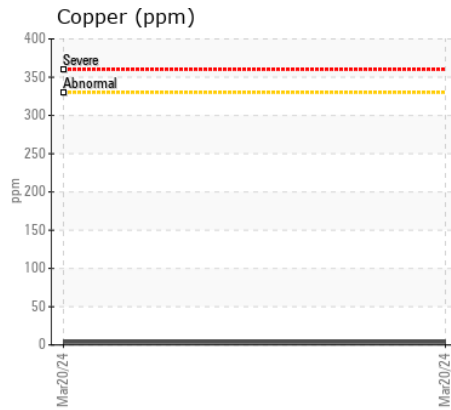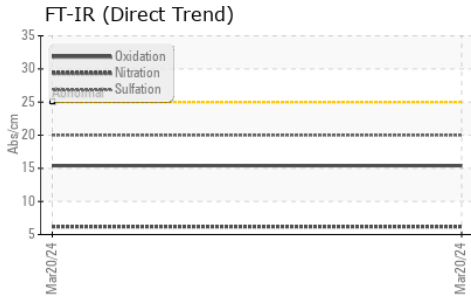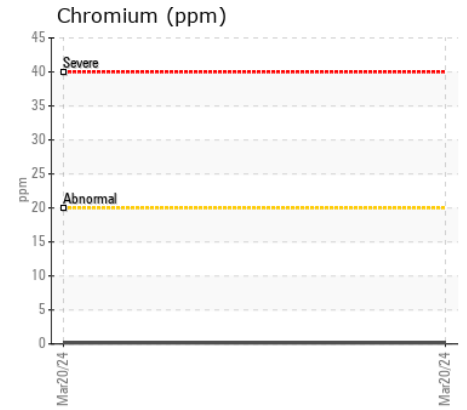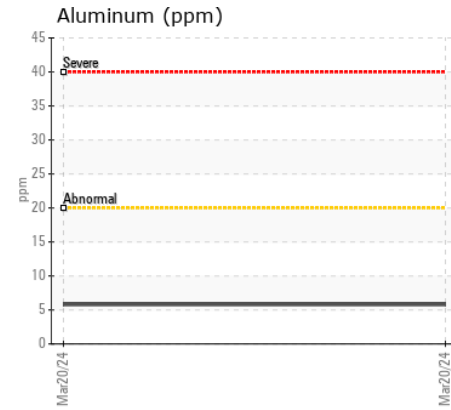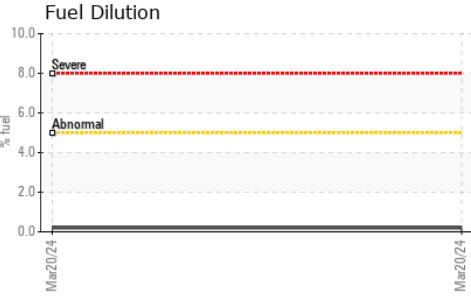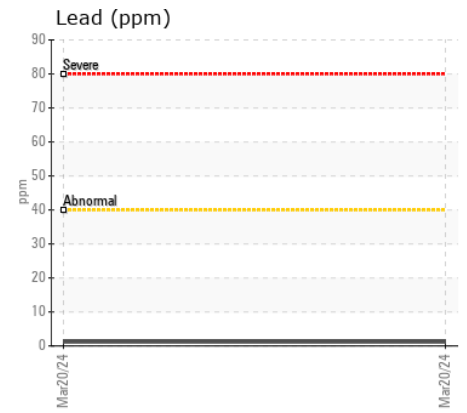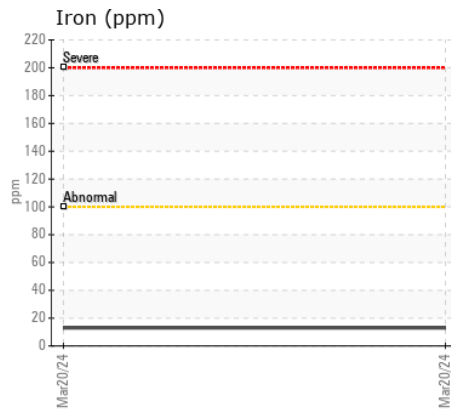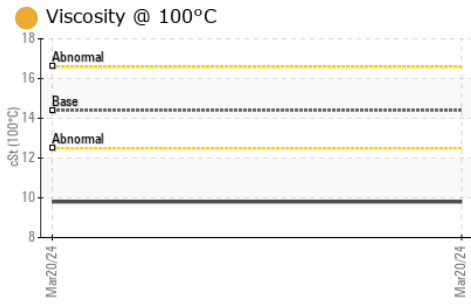

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : DC0035055 **Received** : 17 Apr 2024  
**Lab Number** : 06151839 **Tested** : 22 Apr 2024  
**Unique Number** : 10981917 **Diagnosed** : 22 Apr 2024 - Jonathan Hester  
**Test Package** : MOB 1 ( Additional Tests: FuelDilution, PercentFuel, TBN )

**KELLY GENERATOR & EQUIPMENT INC**  
 1955 DALE LN  
 OWINGS, MD  
 US 20736  
 Contact: LESLIE SNURR  
 LSNURR@KGE.COM  
 T: (410)257-5225  
 F: (410)257-5227

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)