



**OIL ANALYSIS REPORT**

WEAR	<b>NORMAL</b>
CONTAMINATION	<b>NORMAL</b>
FLUID CONDITION	<b>NORMAL</b>

Machine Id  
**21514**  
 Component  
**Compressor**  
 Fluid  
**INGERSOLL-RAND TECHTROL GOLD TL (--- GAL)**

**RECOMMENDATION**

Resample at the next service interval to monitor.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		<b>CCSI2014509</b>	CCSI2010803	CCSI2014506
Sample Date		Client Info		<b>05 Apr 2024</b>	13 Dec 2023	11 Sep 2023
Machine Age	hrs	Client Info		<b>20199</b>	17739	15532
Oil Age	hrs	Client Info		<b>20199</b>	17739	15532
Filter Age	hrs	Client Info		<b>0</b>	0	0
Oil Changed		Client Info		<b>Not Changd</b>	Not Changd	Not Changd
Filter Changed		Client Info		<b>N/A</b>	N/A	N/A
Sample Status				<b>NORMAL</b>	NORMAL	NORMAL

**WEAR**

All component wear rates are normal.

Iron	ppm	ASTM D5185m	>50	<b>0</b>	0	0
Chromium	ppm	ASTM D5185m	>10	<b>0</b>	<1	0
Nickel	ppm	ASTM D5185m		<b>0</b>	0	<1
Titanium	ppm	ASTM D5185m		<b>0</b>	0	0
Silver	ppm	ASTM D5185m		<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m	>25	<b>0</b>	2	0
Lead	ppm	ASTM D5185m	>25	<b>0</b>	0	0
Copper	ppm	ASTM D5185m	>50	<b>0</b>	0	0
Tin	ppm	ASTM D5185m	>15	<b>0</b>	0	0
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	0
White Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE

**CONTAMINATION**










There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

Silicon	ppm	ASTM D5185m	>25	<b>1</b>	2	2
Potassium	ppm	ASTM D5185m	>20	<b>0</b>	<1	0
Water		WC Method	>0.1	<b>NEG</b>	NEG	NEG
Particles >4µm		ASTM D7647	>10000	<b>1029</b>	820	1748
Particles >6µm		ASTM D7647	>2500	<b>259</b>	230	458
Particles >14µm		ASTM D7647	>320	<b>14</b>	15	24
Particles >21µm		ASTM D7647	>80	<b>4</b>	5	6
Particles >38µm		ASTM D7647	>20	<b>0</b>	0	0
Particles >71µm		ASTM D7647	>4	<b>0</b>	0	0
Oil Cleanliness		ISO 4406 (c)	>20/18/15	<b>17/15/11</b>	17/15/11	18/16/12
Silt	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Debris	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Appearance	scalar	*Visual	NORML	<b>NORML</b>	NORML	NORML
Odor	scalar	*Visual	NORML	<b>NORML</b>	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	<b>NEG</b>	NEG	NEG

**FLUID CONDITION**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

Sodium	ppm	ASTM D5185m		<b>&lt;1</b>	0	<1
Boron	ppm	ASTM D5185m		<b>0</b>	0	0
Barium	ppm	ASTM D5185m		<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m		<b>0</b>	0	0
Manganese	ppm	ASTM D5185m		<b>0</b>	0	0
Magnesium	ppm	ASTM D5185m		<b>0</b>	<1	1
Calcium	ppm	ASTM D5185m		<b>4</b>	2	4
Phosphorus	ppm	ASTM D5185m		<b>165</b>	186	173
Zinc	ppm	ASTM D5185m		<b>24</b>	8	23
Sulfur	ppm	ASTM D5185m		<b>0</b>	0	0
Acid Number (AN)	mg KOH/g	ASTM D8045	0.25	<b>1.09</b>	1.05	1.23
Visc @ 40°C	cSt	ASTM D445	37	<b>41.8</b>	41.6	41.2

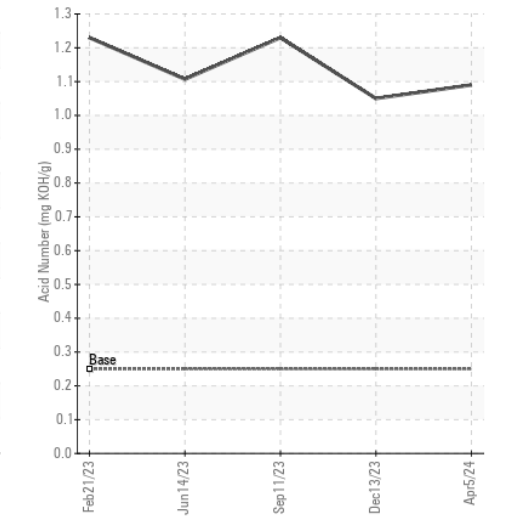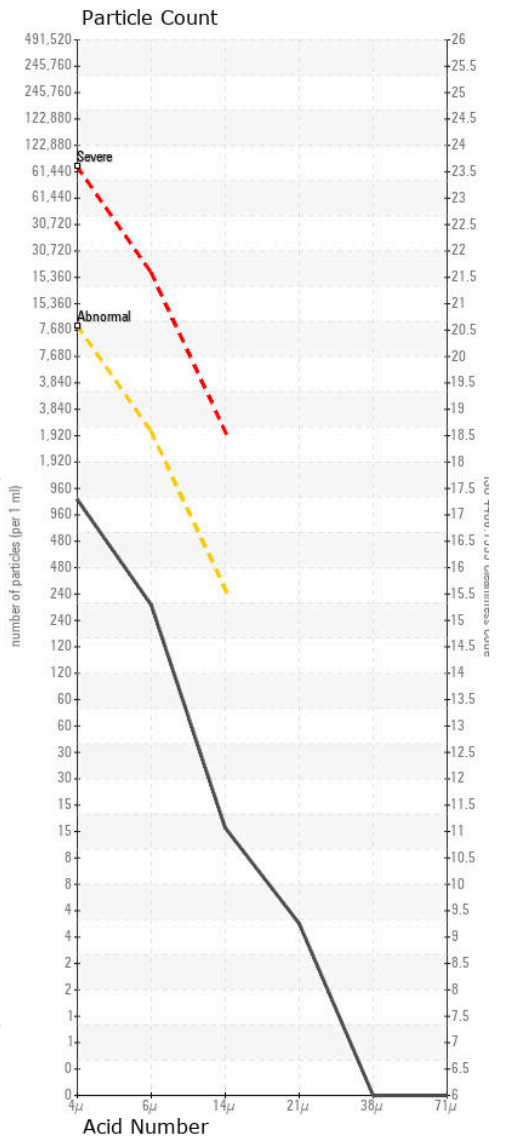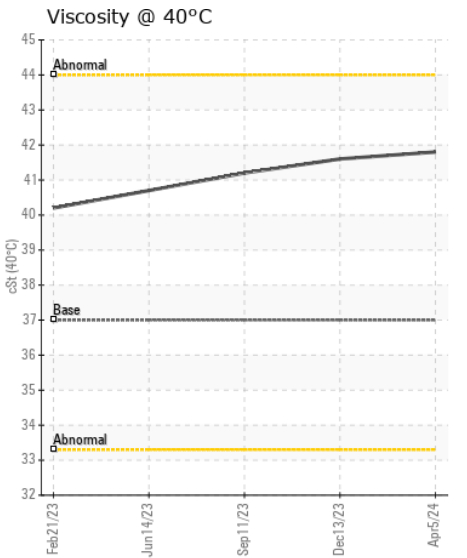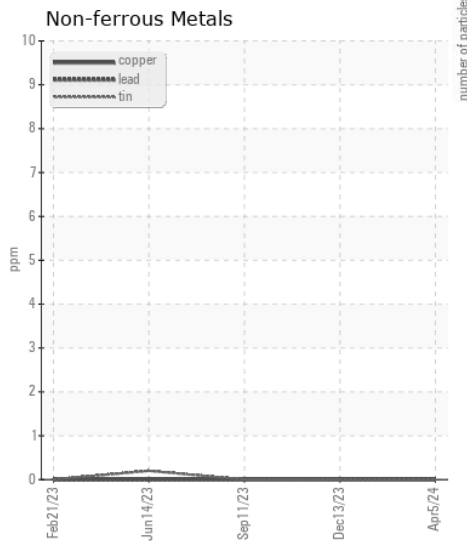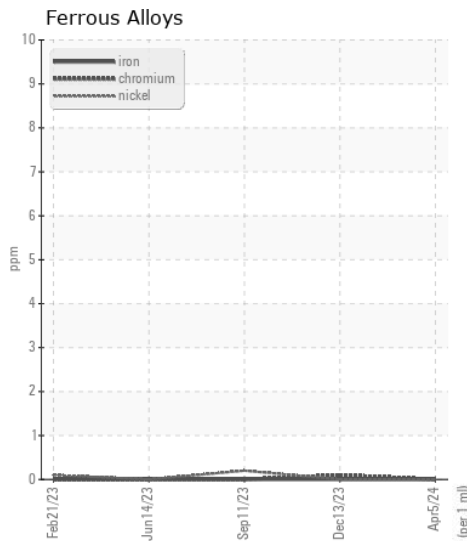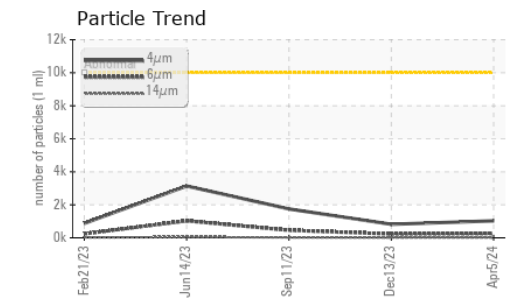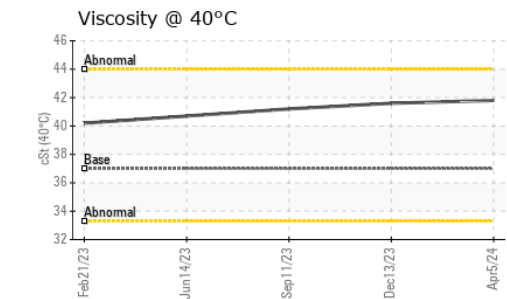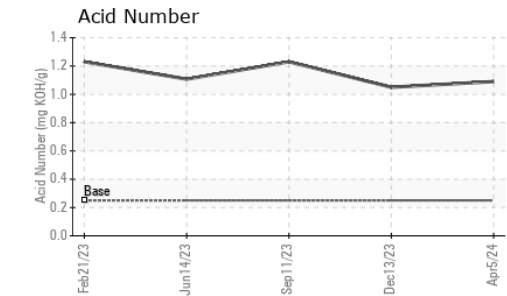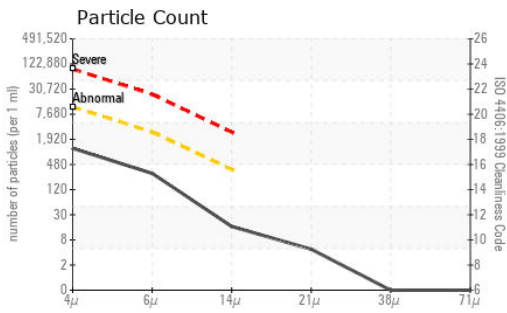

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : CCSI2014509 **Received** : 17 Apr 2024  
**Lab Number** : 06151956 **Tested** : 18 Apr 2024  
**Unique Number** : 10982034 **Diagnosed** : 19 Apr 2024 - Don Baldrige  
**Test Package** : IND 2 ( Additional Tests: PrtCount )

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

**PRIMIANT**  
 198 BLAIR BEND DR  
 LENOIR CITY, TN  
 US 37774

Contact: CHRIS SAYLOR  
 chris.saylor@primiant.com

T: (865)408-0594

F: