



WEAR	<b>NORMAL</b>
CONTAMINATION	<b>NORMAL</b>
FLUID CONDITION	<b>NORMAL</b>

Area

**PALEXTRA 44**

Machine Id

**SULLIVAN PALATEK 1506180018 - AKRON ARIEL**

Component

**Compressor**

### RECOMMENDATION

Resample at the next service interval to monitor.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		<b>UCS06152130</b>	UCS03991391	---
Sample Date		Client Info		<b>05 Apr 2024</b>	19 May 2016	---
Machine Age	hrs	Client Info		<b>34859</b>	4444	---
Oil Age	hrs	Client Info		<b>1337</b>	4444	---
Filter Age	hrs	Client Info		<b>1337</b>	1674	---
Oil Changed		Client Info		<b>Not Changed</b>	Not Changed	---
Filter Changed		Client Info		<b>Changed</b>	Changed	---
Sample Status				<b>NORMAL</b>	NORMAL	---

### WEAR

All component wear rates are normal.

Iron	ppm	ASTM D5185m	>50	<b>0</b>	0	---
Chromium	ppm	ASTM D5185m	>10	<b>0</b>	0	---
Nickel	ppm	ASTM D5185m		<b>0</b>	<1	---
Titanium	ppm	ASTM D5185m		<b>0</b>	0	---
Silver	ppm	ASTM D5185m		<b>0</b>	0	---
Aluminum	ppm	ASTM D5185m	>25	<b>&lt;1</b>	<1	---
Lead	ppm	ASTM D5185m	>25	<b>0</b>	<1	---
Copper	ppm	ASTM D5185m	>50	<b>&lt;1</b>	<1	---
Tin	ppm	ASTM D5185m	>15	<b>&lt;1</b>	0	---
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	---
White Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	---
Yellow Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	---

### CONTAMINATION







There is no indication of any contamination in the oil.

Silicon	ppm	ASTM D5185m	>25	<b>3</b>	10	---
Potassium	ppm	ASTM D5185m	>20	<b>2</b>	2	---
Water		WC Method	>0.1	<b>NEG</b>	NEG	---
Silt	scalar	*Visual	NONE	<b>NONE</b>	NONE	---
Debris	scalar	*Visual	NONE	<b>NONE</b>	NONE	---
Sand/Dirt	scalar	*Visual	NONE	<b>NONE</b>	NONE	---
Appearance	scalar	*Visual	NORML	<b>NORML</b>	NORML	---
Odor	scalar	*Visual	NORML	<b>NORML</b>	NORML	---
Emulsified Water	scalar	*Visual	>0.1	<b>NEG</b>	NEG	---

### FLUID CONDITION

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

Sodium	ppm	ASTM D5185m		<b>1</b>	<1	---
Boron	ppm	ASTM D5185m	0	<b>0</b>	0	---
Barium	ppm	ASTM D5185m	0.3	<b>0</b>	0	---
Molybdenum	ppm	ASTM D5185m	0	<b>0</b>	0	---
Manganese	ppm	ASTM D5185m	0.3	<b>&lt;1</b>	0	---
Magnesium	ppm	ASTM D5185m	0.4	<b>0</b>	<1	---
Calcium	ppm	ASTM D5185m	0	<b>&lt;1</b>	<1	---
Phosphorus	ppm	ASTM D5185m	689	<b>574</b>	632	---
Zinc	ppm	ASTM D5185m	0	<b>0</b>	<1	---
Sulfur	ppm	ASTM D5185m	1237	<b>1135</b>	973	---
Acid Number (AN)	mg KOH/g	ASTM D8045	0.135	<b>0.093</b>	0.189	---
Visc @ 40°C	cSt	ASTM D445	44.62	<b>43.5</b>	47.06	---

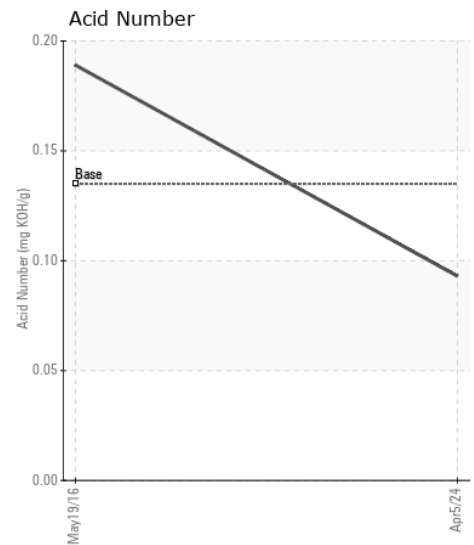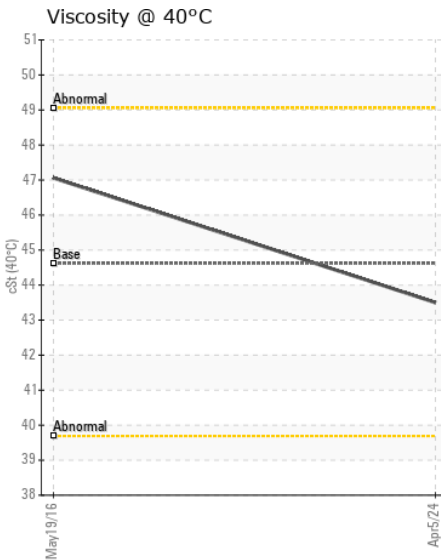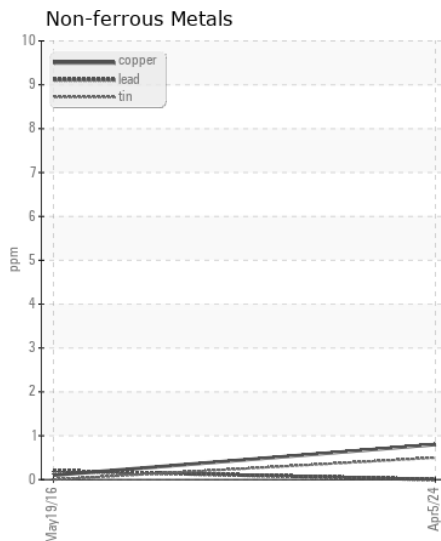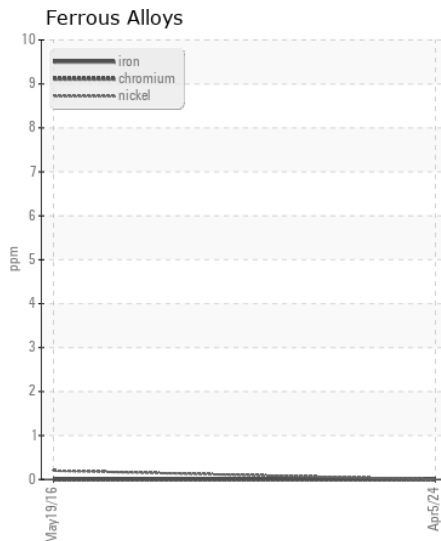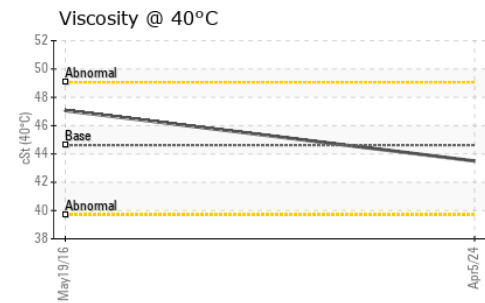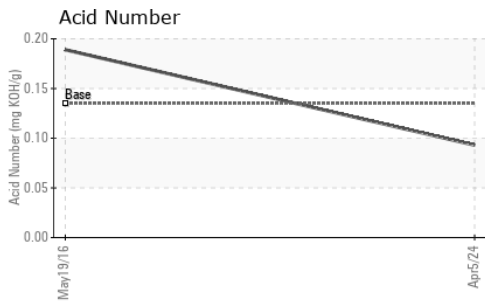

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : UCS06152130      **Received** : 17 Apr 2024  
**Lab Number** : 06152130      **Tested** : 18 Apr 2024  
**Unique Number** : 10982208      **Diagnosed** : 19 Apr 2024 - Sean Felton  
**Test Package** : IND 2

**AKRON AIR PRODUCTS**  
 715 POWELL AVE SE  
 HARTVILLE, OH  
 US 44632

Contact: BRIAN RITENOUR  
 PARTS@AKRONAIR.COM  
 T: (330)877-4376  
 F: (330)877-4902

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)