



OIL ANALYSIS REPORT

WEAR	NORMAL
CONTAMINATION	NORMAL
FLUID CONDITION	NORMAL

Area

[JL]
Machine Id

P-302 (S/N 100098606)

Component
Pump

Fluid
MOBIL DTE ISO VG 46 (--- GAL)

RECOMMENDATION

Resample at the next service interval to monitor.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		WC0861266	WC0749402	WC0749395
Sample Date		Client Info		15 Apr 2024	05 Oct 2023	11 Oct 2022
Machine Age	yrs	Client Info		12	11	10
Oil Age	yrs	Client Info		1	0	0
Filter Age	yrs	Client Info		0	0	0
Oil Changed		Client Info		Changed	Changed	Changed
Filter Changed		Client Info		N/A	N/A	N/A
Sample Status				NORMAL	NORMAL	NORMAL

WEAR

All component wear rates are normal.

Iron	ppm	ASTM D5185m	>75	0	0	0
Chromium	ppm	ASTM D5185m	>5	0	0	0
Nickel	ppm	ASTM D5185m		0	<1	0
Titanium	ppm	ASTM D5185m		0	0	0
Silver	ppm	ASTM D5185m		0	0	0
Aluminum	ppm	ASTM D5185m	>5	<1	0	1
Lead	ppm	ASTM D5185m	>10	0	<1	0
Copper	ppm	ASTM D5185m	>15	<1	0	0
Tin	ppm	ASTM D5185m		<1	0	0
Vanadium	ppm	ASTM D5185m		0	0	<1
White Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE

CONTAMINATION







There is no indication of any contamination in the oil.

Silicon	ppm	ASTM D5185m	>20	<1	0	<1
Potassium	ppm	ASTM D5185m	>20	2	1	0
Water		WC Method	>.1	NEG	NEG	NEG
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	LIGHT	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>.1	NEG	NEG	NEG

FLUID CONDITION

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

Sodium	ppm	ASTM D5185m		1	0	0
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m		0	0	0
Molybdenum	ppm	ASTM D5185m		0	0	<1
Manganese	ppm	ASTM D5185m		<1	0	<1
Magnesium	ppm	ASTM D5185m		0	0	0
Calcium	ppm	ASTM D5185m		<1	0	0
Phosphorus	ppm	ASTM D5185m		117	109	117
Zinc	ppm	ASTM D5185m		75	87	74
Sulfur	ppm	ASTM D5185m		774	650	539
Acid Number (AN)	mg KOH/g	ASTM D8045		0.14	0.11	0.16
Visc @ 40°C	cSt	ASTM D445		46.7	46.4	46.7

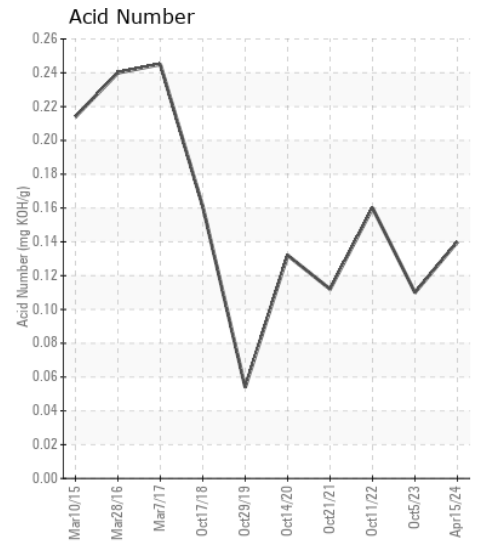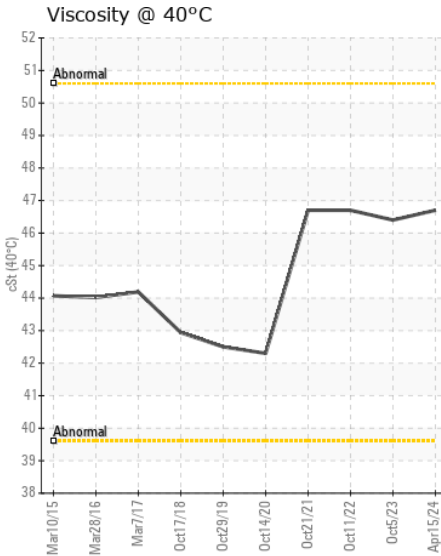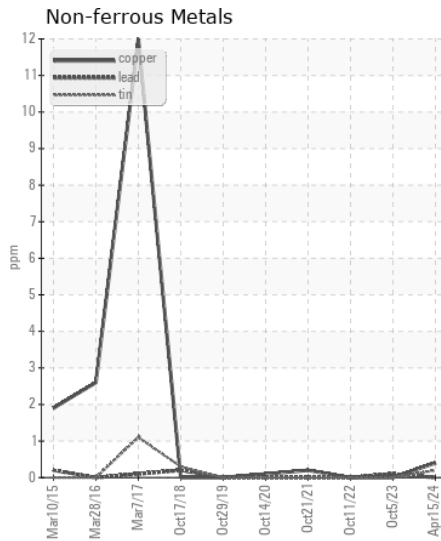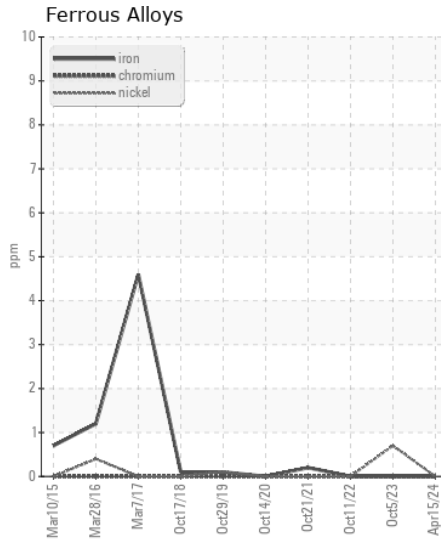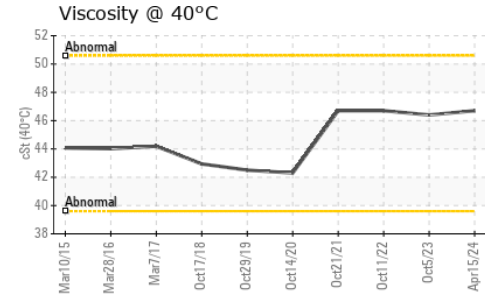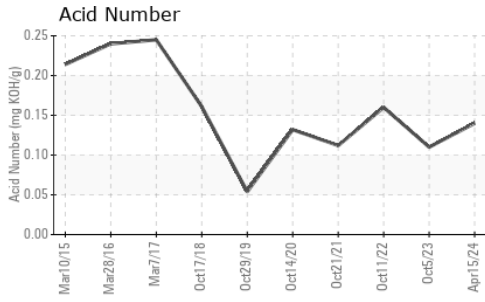

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0861266
Lab Number : 06152136
Unique Number : 10982214
Test Package : IND 2
Received : 17 Apr 2024
Tested : 18 Apr 2024
Diagnosed : 19 Apr 2024 - Sean Felton

PIEDMONT NATURAL GAS
 2256 HARPER HOUSE ROAD
 FOUR OAKS, NC
 US 27524
 Contact: STEVE SMITH
 steve.smith@duke-energy.com
 T: (919)689-3907
 F: (919)689-3360

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)