



# COOLANT REPORT

CORROSION	<b>NORMAL</b>
CONTAMINANTS	<b>NORMAL</b>
COOLANT CONDITION	<b>NORMAL</b>

Area  
**[PMOAS3372589]**  
 Machine Id  
**100DSEJ 2115408**  
 Component  
**Coolant**  
 Fluid  
**CONVENTIONAL COOLANT (--- GAL)**

## RECOMMENDATION

The fluid is suitable for further service.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		<b>DC0034986</b>	DC0026718	DC0020884
Sample Date		Client Info		<b>08 Apr 2024</b>	03 Apr 2023	27 Apr 2022
Machine Age	hrs	Client Info		<b>0</b>	511	478
Oil Age	hrs	Client Info		<b>0</b>	0	0
Oil Changed		Client Info		<b>N/A</b>	Changed	Not Changed
Sample Status				<b>NORMAL</b>	ABNORMAL	NORMAL








## CORROSION

Total Dissolved Solids				<b>375.5</b>	387.5	388.0
Coolant Appearance		*Visual	Clear	<b>normal</b>	▲ sediment	normal

## CONTAMINANTS

There is no indication of any contamination in the coolant.

Boiling Point	°C	WC Method		<b>226</b>	---	---
Specific Gravity		*ASTM D1298		<b>1.069</b>	1.069	1.069
pH	Scale 0-14	ASTM D1287		<b>8.42</b>	8.41	8.47
Nitrites	ppm	AP-053:2009		<b>824</b>	676	676
Reserve Alkalinity	Scale 0-20	*ASTM D1121		<b>---</b>	---	---
Percentage Glycol	%	ASTM D3321		<b>51.1</b>	51.3	51.3
Freezing Point	°F	ASTM D3321		<b>-38</b>	-38	-38
Carboxylate				<b>n/a</b>	n/a	n/a
Coolant Color		*Visual		<b>Yllow</b>	Yllow	Pink

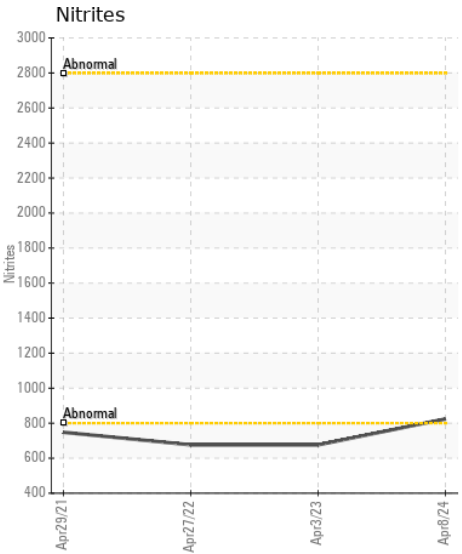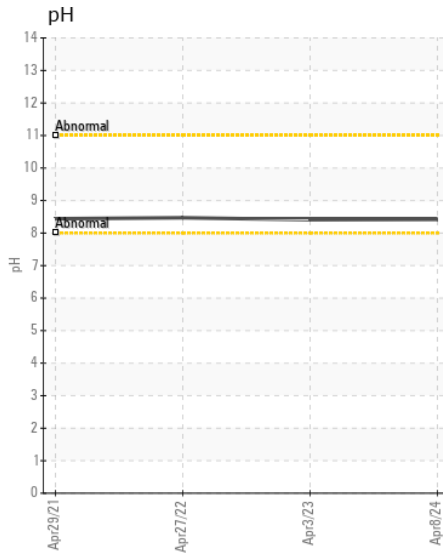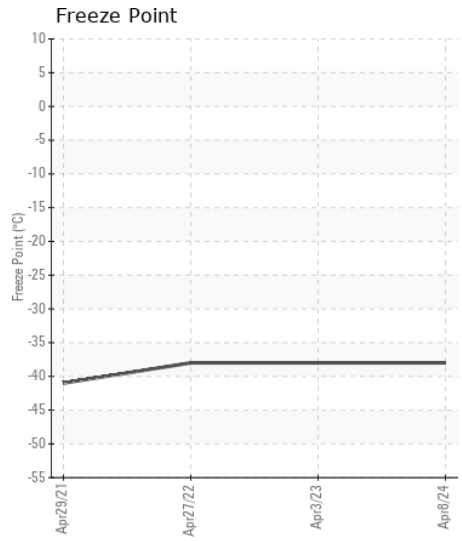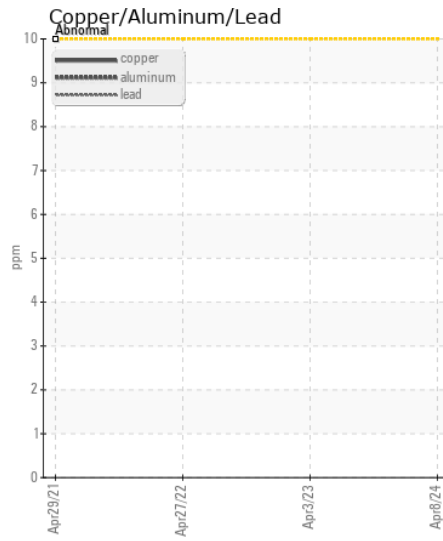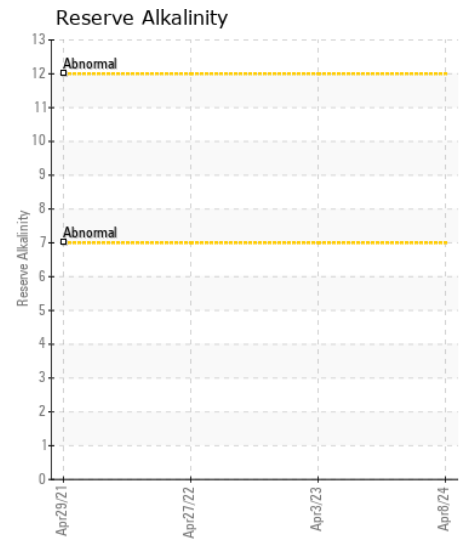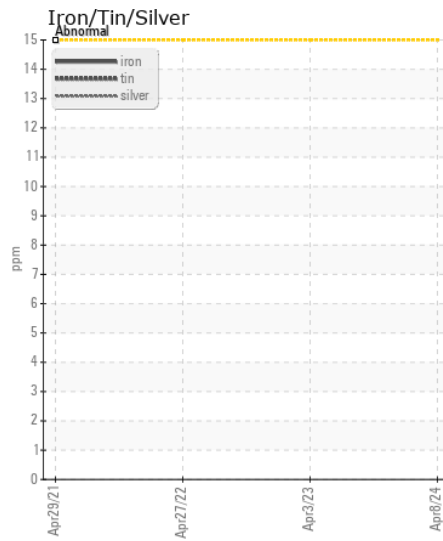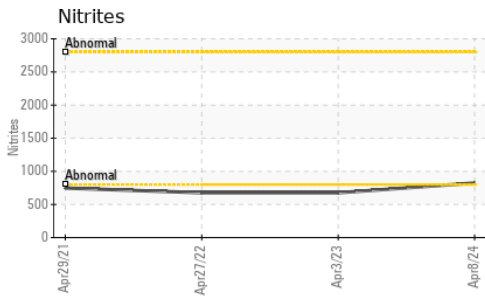

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : DC0034986 **Received** : 17 Apr 2024  
**Lab Number** : 06152491 **Tested** : 18 Apr 2024  
**Unique Number** : 10982569 **Diagnosed** : 22 Apr 2024 - Jonathan Hester  
**Test Package** : COOL- ( Additional Tests: BoilingPoint, COOL, GlycolType )

**KELLY GENERATOR & EQUIPMENT INC**  
 1955 DALE LN  
 OWINGS, MD  
 US 20736  
 Contact: LESLIE SNURR  
 LSNURR@KGE.COM  
 T: (410)257-5225  
 F: (410)257-5227

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)