WEAR CONTAMINATION FLUID CONDITION


NORMAL NORMAL



Machine Id
834022
Component
Natural Gas Engine

PETRO CANADA DURON SHP 15W40 (--- GAL)

RECOMMENDATION	Test	UOM	Method	Limit/Abn	Current	History1	History2
TESSIMIENDATION	Sample Number		Client Info	Limitorion	GFL0114501	GFL0074623	
Resample at the next service interval to monitor.	Sample Date		Client Info		18 Apr 2024	20 Dec 2023	
	Machine Age	hrs	Client Info		1801	1173	
	Oil Age	hrs	Client Info		0	0	
	Filter Age	hrs	Client Info		0	0	
	Oil Changed	1110	Client Info		N/A	Changed	
	Filter Changed		Client Info		N/A	Changed	
	Sample Status		Ollotte little		NORMAL	NORMAL	
WEAR	Iron	ppm	ASTM D5185m	>50	32	59	
All component week rates are normal	Chromium	ppm	ASTM D5185m	>5	1	2	
All component wear rates are normal.	Nickel	ppm	ASTM D5185m	>4	0	1	
	Titanium	ppm	ASTM D5185m	>5	0	0	
	Silver	ppm	ASTM D5185m	>3	0	0	
	Aluminum	ppm	ASTM D5185m	>25	8	26	
	Lead	ppm	ASTM D5185m	>40	1	<1	
	Copper	ppm	ASTM D5185m	>150	4	15	
	Tin	ppm	ASTM D5185m	>4	1	<1	
	Vanadium	ppm	ASTM D5185m		<1	0	
	White Metal	scalar	*Visual	NONE	NONE	NONE	
	Yellow Metal	scalar	*Visual	NONE	NONE	NONE	
CONTABBINIATION			AOTA DE LOS	05	_	05	
CONTAMINATION	Silicon	ppm	ASTM D5185m		7	25	
There is no indication of any contamination in the oil.	Potassium	ppm	ASTM D5185m		16	75 NEO	
·	Water	0/	WC Method	>0.1	NEG	NEG	
	Soot %	%	*ASTM D7844	00	0	0	
	Nitration	Abs/cm	*ASTM D7624	>20	9.2	12.8	
	Sulfation	Abs/.1mm	*ASTM D7415		20.9	25.3	
	Silt	scalar	*Visual	NONE	NONE	NONE	
	Debris	scalar	*Visual	NONE	NONE	NONE	
	Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	
	Appearance Odor	scalar scalar	*Visual	NORML NORML	NORML NORML	NORML NORML	
	Emulsified Water		*Visual	>0.1	NEG	NEG	
<u></u>			v isuai			INLG	
FLUID CONDITION	Sodium	ppm	ASTM D5185m		2	6	
The DNI would be discuss that the section is a like the section is the	Boron	ppm	ASTM D5185m	0	0	2	
The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.	Barium	ppm	ASTM D5185m	0	<1	2	
on. The conduction of the only suitable for futfile Scivice.	Molybdenum	ppm	ASTM D5185m	60	72	54	
	Manganese	ppm	ASTM D5185m	0	3	12	
	Magnesium	ppm	ASTM D5185m	1010	952	833	
	Calcium	ppm	ASTM D5185m	1070	1226	1257	
	Phosphorus	ppm	ASTM D5185m	1150	991	710	
	Zinc	ppm	ASTM D5185m	1270	1208	954	
	Sulfur	ppm	ASTM D5185m	2060	3172	2100	
	Oxidation	Abs/.1mm	*ASTM D7414		15.6	22.9	
	Base Number (BN)	mg KOH/g	ASTM D2896	9.8	4.4	2.9	
	Visc @ 100°C	cSt	ASTM D445	15.4	13.3	13.8	

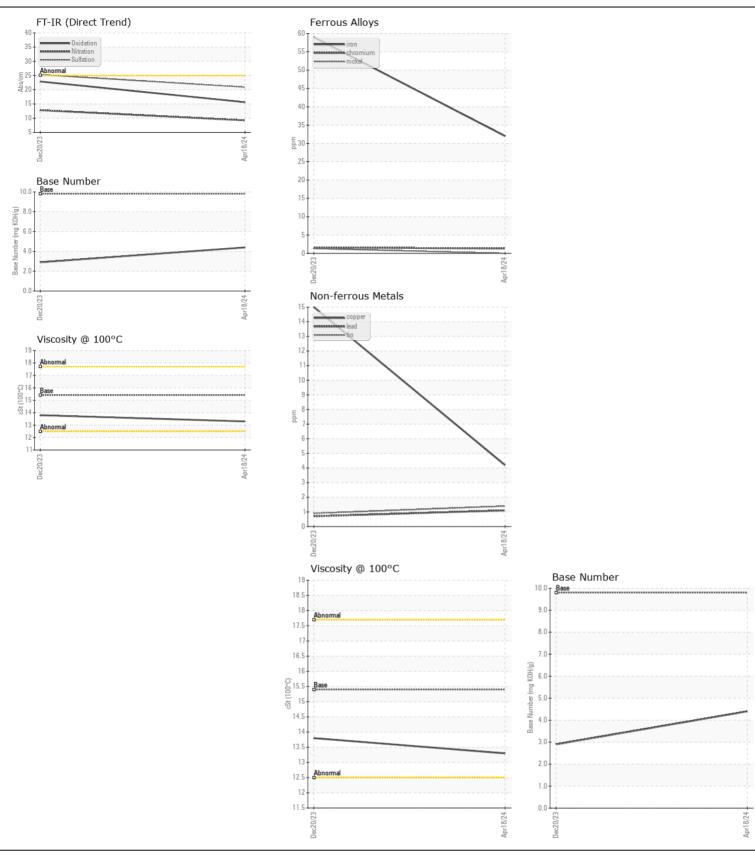





Certificate L2367

Laboratory Sample No.

Lab Number : 06154080 Unique Number: 10989503

: GFL0114501 Test Package : FLEET

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 Received : 19 Apr 2024 **Tested** : 22 Apr 2024

Diagnosed : 22 Apr 2024 - Wes Davis

GFL Environmental - 095 - Atlanta West 2699 Cochran Industrial Blvd

Douglasville, GA US 30127-1332

T: (800)207-6618

Contact: Darrell Welch darrell.welch@gflenv.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)