



OIL ANALYSIS REPORT

WEAR	ABNORMAL
CONTAMINATION	NORMAL
FLUID CONDITION	NORMAL

Area

[20590651]

Machine Id

810-M5060

Component

Gearbox

Fluid

ROYAL PURPLE POLYGUARD FDA 220 (--- GAL)

RECOMMENDATION

No corrective action is recommended at this time. Resample at the next service interval to monitor.

WEAR

The aluminum level is abnormal. All other component wear rates are normal.

CONTAMINATION

There is no indication of any contamination in the oil.

FLUID CONDITION








The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		WC0904637	WC0805837	WC0805847
Sample Date		Client Info		10 Apr 2024	23 Oct 2023	24 Apr 2023
Machine Age	mths	Client Info		0	0	0
Oil Age	mths	Client Info		0	0	0
Filter Age	mths	Client Info		0	0	0
Oil Changed		Client Info		Not Changed	Not Changed	Not Changed
Filter Changed		Client Info		Not Changed	Not Changed	Not Changed
Sample Status				ABNORMAL	NORMAL	NORMAL

Iron	ppm	ASTM D5185m	>200	28	3	21
Chromium	ppm	ASTM D5185m	>15	<1	0	<1
Nickel	ppm	ASTM D5185m	>15	<1	0	<1
Titanium	ppm	ASTM D5185m		<1	<1	0
Silver	ppm	ASTM D5185m		0	0	0
Aluminum	ppm	ASTM D5185m	>25	▲ 28	0	22
Lead	ppm	ASTM D5185m	>100	<1	0	0
Copper	ppm	ASTM D5185m	>200	<1	0	0
Tin	ppm	ASTM D5185m	>25	<1	0	0
Vanadium	ppm	ASTM D5185m		0	0	0
White Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE

Silicon	ppm	ASTM D5185m	>50	20	4	16
Potassium	ppm	ASTM D5185m	>20	2	0	1
Water		WC Method	>0.2	NEG	NEG	NEG
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE	LIGHT
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.2	NEG	NEG	NEG

Sodium	ppm	ASTM D5185m		<1	7	3
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m		0	0	0
Molybdenum	ppm	ASTM D5185m		<1	0	0
Manganese	ppm	ASTM D5185m		<1	0	<1
Magnesium	ppm	ASTM D5185m		<1	0	1
Calcium	ppm	ASTM D5185m		28	0	36
Phosphorus	ppm	ASTM D5185m		453	443	503
Zinc	ppm	ASTM D5185m		104	0	91
Sulfur	ppm	ASTM D5185m		629	980	799
Acid Number (AN)	mg KOH/g	ASTM D8045		1.52	1.37	1.48
Visc @ 40°C	cSt	ASTM D445		219	214	219

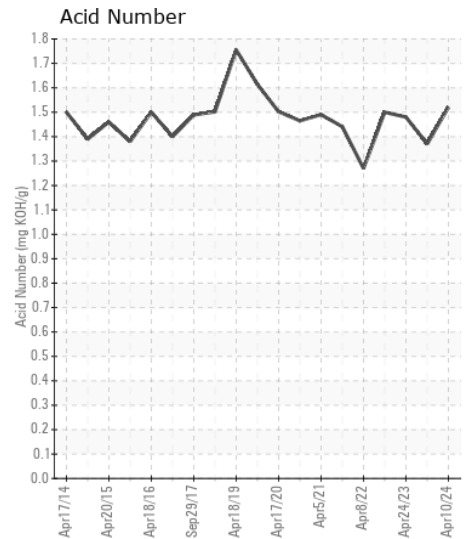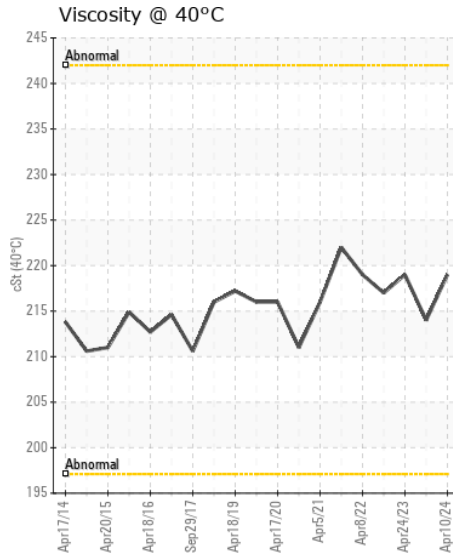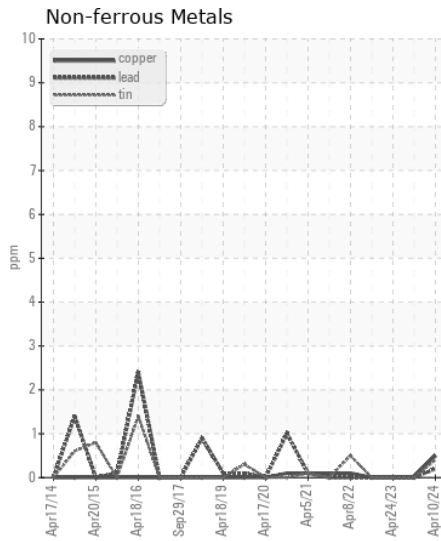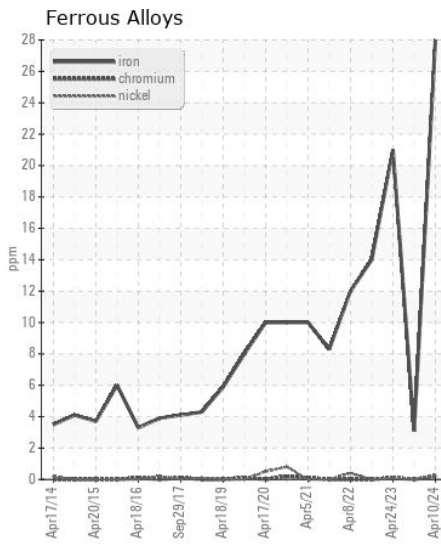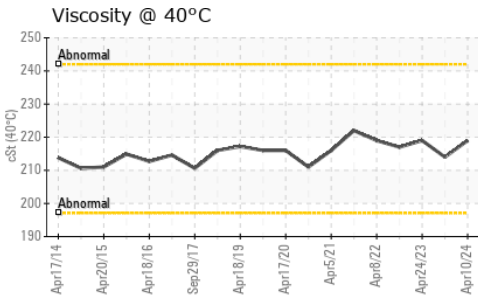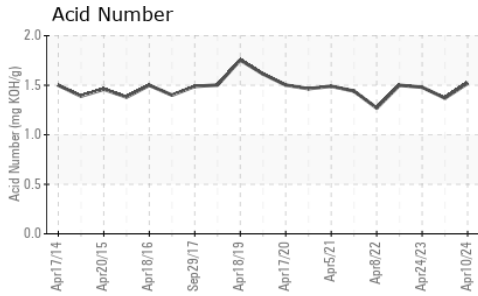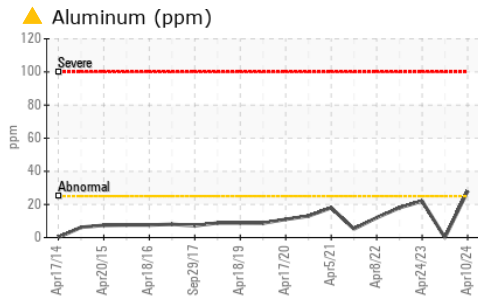

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0904637
Lab Number : 06155221
Unique Number : 10990644
Test Package : IND 2

Received : 19 Apr 2024
Tested : 23 Apr 2024
Diagnosed : 24 Apr 2024 - Don Baldrige

THERMO FISHER
 6173 East Old Marion Highway, Bldg. 806
 Florence, SC
 US 29506

Contact: BARRY OLIVER
 Calvin.Oliver@Roche.com
 T: (843)629-4577
 F: (843)629-4553

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)