



OIL ANALYSIS REPORT

WEAR	NORMAL
CONTAMINATION	ABNORMAL
FLUID CONDITION	NORMAL

Machine Id
5074 NON-DRIVE
Component
Right Bearing
Fluid
SHELL OMALA S2 GX 220 (--- GAL)

RECOMMENDATION

No corrective action is recommended at this time. Resample at the next service interval to monitor.

WEAR

All component wear rates are normal.

CONTAMINATION

Elemental level of silicon (Si) above normal.

FLUID CONDITION











The condition of the oil is acceptable for the time in service.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		WC0826932	WC0757492	WC0826930
Sample Date		Client Info		15 Apr 2024	05 Feb 2024	10 Jan 2024
Machine Age	hrs	Client Info		1694	1056	846
Oil Age	hrs	Client Info		516	182	670
Filter Age	hrs	Client Info		0	0	0
Oil Changed		Client Info		Not Changd	Not Changd	Not Changd
Filter Changed		Client Info		N/A	N/A	N/A
Sample Status				ABNORMAL	MARGINAL	ATTENTION

Iron	ppm	ASTM D5185m	>200	43	34	66
Chromium	ppm	ASTM D5185m	>5	<1	0	<1
Nickel	ppm	ASTM D5185m	>5	0	0	<1
Titanium	ppm	ASTM D5185m	>5	0	0	0
Silver	ppm	ASTM D5185m		0	0	0
Aluminum	ppm	ASTM D5185m	>25	6	4	7
Lead	ppm	ASTM D5185m	>50	0	0	0
Copper	ppm	ASTM D5185m	>150	0	0	<1
Tin	ppm	ASTM D5185m	>10	0	1	0
Vanadium	ppm	ASTM D5185m		0	0	0
White Metal	scalar	*Visual	NONE	NONE	NONE	LIGHT
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE

Silicon	ppm	ASTM D5185m	>25	▲ 37	▲ 29	▲ 46
Potassium	ppm	ASTM D5185m	>20	3	2	6
Water		WC Method	>0.1	NEG	NEG	NEG
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG	NEG

Sodium	ppm	ASTM D5185m		3	1	0
Boron	ppm	ASTM D5185m	6.2	0	0	0
Barium	ppm	ASTM D5185m	0.0	0	0	0
Molybdenum	ppm	ASTM D5185m	0	0	0	0
Manganese	ppm	ASTM D5185m		<1	<1	<1
Magnesium	ppm	ASTM D5185m	0	0	0	<1
Calcium	ppm	ASTM D5185m	0.0	11	0	3
Phosphorus	ppm	ASTM D5185m	290	289	264	322
Zinc	ppm	ASTM D5185m	3.8	5	0	0
Sulfur	ppm	ASTM D5185m	8167	11806	9448	10955
Visc @ 40°C	cSt	ASTM D445	220	214	210	211.7

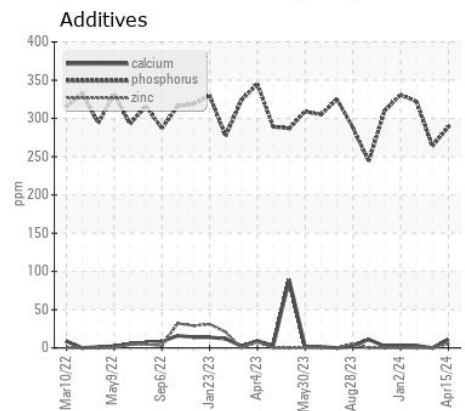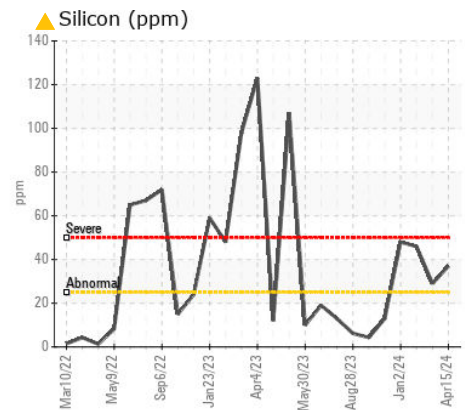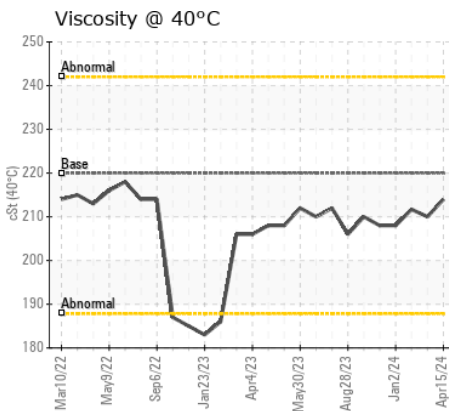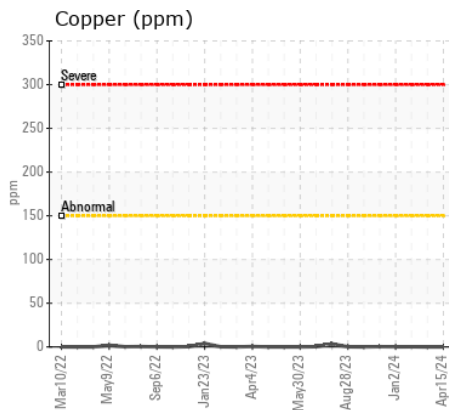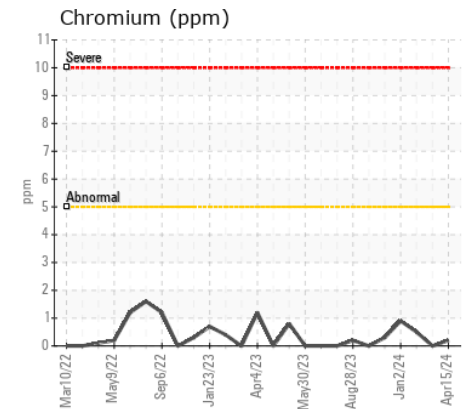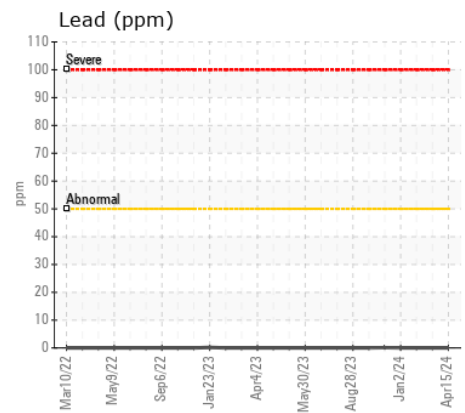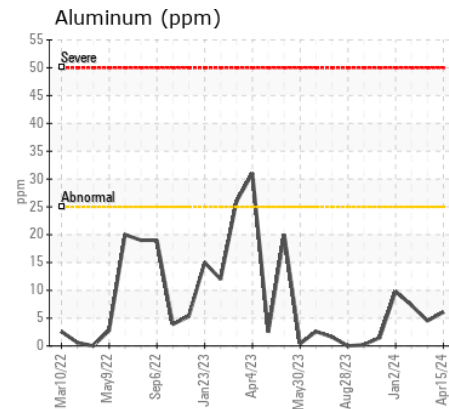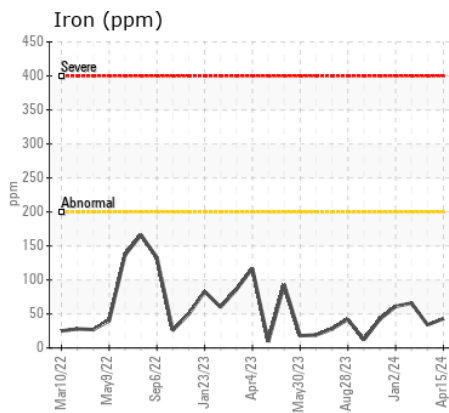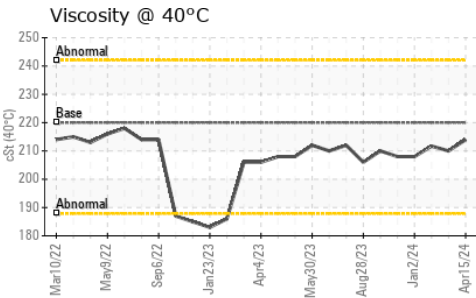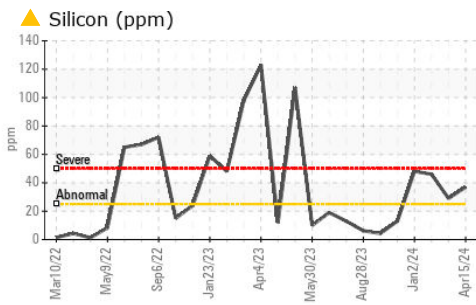

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513

Sample No. : WC0826932

Lab Number : 06155381

Unique Number : 10990804

Test Package : MOB 1

Received : 19 Apr 2024

Tested : 22 Apr 2024

Diagnosed : 24 Apr 2024 - Jonathan Hester

WAKE STONE CORPORATION-KNIGHTDALE

PO BOX 190

KNIGHTDALE, NC

US 27545

Contact: AL PARKER

alparker@wakestonecorp.com

T:

F: (919)266-1149

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)