



OIL ANALYSIS REPORT

WEAR	NORMAL
CONTAMINATION	NORMAL
FLUID CONDITION	NORMAL



Machine Id  
**Coopersville CAT 1 CPVM01BE**  
 Component  
**Biogas Engine**  
 Fluid  
**CHEVRON HDAX 9500 GAS ENGINE OIL 40 (105 GAL)**

**RECOMMENDATION**

Resample at the next service interval to monitor.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		<b>WC0871575</b>	WC0871562	WC0871589
Sample Date		Client Info		<b>18 Apr 2024</b>	09 Apr 2024	29 Mar 2024
Machine Age	hrs	Client Info		<b>17366</b>	17155	16890
Oil Age	hrs	Client Info		<b>1</b>	805	540
Filter Age	hrs	Client Info		<b>1</b>	805	540
Oil Changed		Client Info		<b>Changed</b>	Not Changd	Not Changd
Filter Changed		Client Info		<b>Changed</b>	Not Changd	Not Changd
Sample Status				<b>NORMAL</b>	NORMAL	NORMAL

**WEAR**

All component wear rates are normal.

Iron	ppm	ASTM D5185m	>15	<b>0</b>	0	0
Chromium	ppm	ASTM D5185m	>4	<b>&lt;1</b>	0	0
Nickel	ppm	ASTM D5185m		<b>0</b>	0	0
Titanium	ppm	ASTM D5185m		<b>0</b>	0	<1
Silver	ppm	ASTM D5185m		<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m	>6	<b>&lt;1</b>	2	1
Lead	ppm	ASTM D5185m	>9	<b>0</b>	2	0
Copper	ppm	ASTM D5185m	>6	<b>3</b>	<1	<1
Tin	ppm	ASTM D5185m	>4	<b>1</b>	3	3
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	<1
White Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE

**CONTAMINATION**













There is no indication of any contamination in the oil.

Silicon	ppm	ASTM D5185m	>181	<b>34</b>	109	116
Potassium	ppm	ASTM D5185m	>20	<b>1</b>	4	<1
Fuel		WC Method	>4.0	<b>&lt;1.0</b>	<1.0	<1.0
Water		WC Method	>.11	<b>NEG</b>	NEG	NEG
Glycol		WC Method		<b>NEG</b>	NEG	NEG
Soot %	%	*ASTM D7844		<b>0</b>	0	0.1
Nitration	Abs/cm	*ASTM D7624		<b>5.0</b>	6.7	6.9
Sulfation	Abs/.1mm	*ASTM D7415		<b>15.3</b>	18.0	18.0
Silt	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Debris	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Appearance	scalar	*Visual	NORML	<b>NORML</b>	NORML	NORML
Odor	scalar	*Visual	NORML	<b>NORML</b>	NORML	NORML
Emulsified Water	scalar	*Visual	>.11	<b>NEG</b>	NEG	NEG

**FLUID CONDITION**

The BN result indicates that there is suitable alkalinity remaining in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

Sodium	ppm	ASTM D5185m	>21	<b>2</b>	1	2
Boron	ppm	ASTM D5185m		<b>4</b>	0	2
Barium	ppm	ASTM D5185m		<b>1</b>	0	0
Molybdenum	ppm	ASTM D5185m		<b>4</b>	6	3
Manganese	ppm	ASTM D5185m		<b>1</b>	<1	0
Magnesium	ppm	ASTM D5185m		<b>11</b>	7	6
Calcium	ppm	ASTM D5185m		<b>1695</b>	1969	1742
Phosphorus	ppm	ASTM D5185m		<b>257</b>	285	245
Zinc	ppm	ASTM D5185m		<b>307</b>	336	315
Sulfur	ppm	ASTM D5185m		<b>1994</b>	2371	1974
Oxidation	Abs/.1mm	*ASTM D7414		<b>8.3</b>	12.7	13.4
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	<b>0.59</b>	1.28	1.22
Base Number (BN)	mg KOH/g	ASTM D2896	5.4	<b>4.51</b>	3.75	3.97
Visc @ 100°C	cSt	ASTM D445	13.4	<b>13.2</b>	13.7	13.6

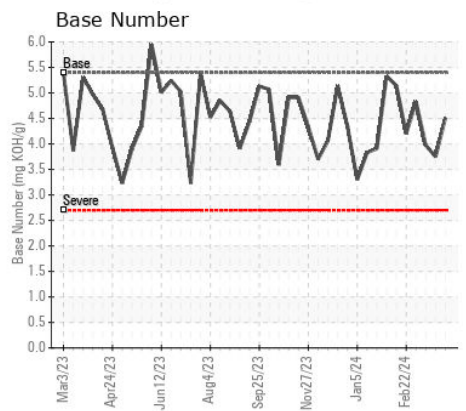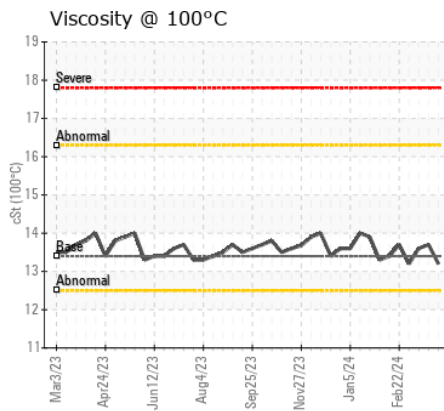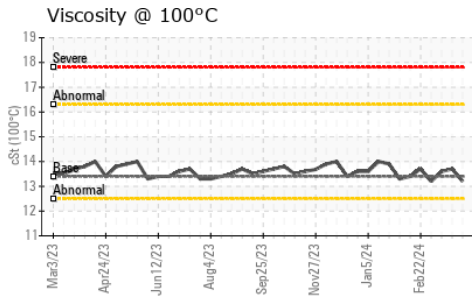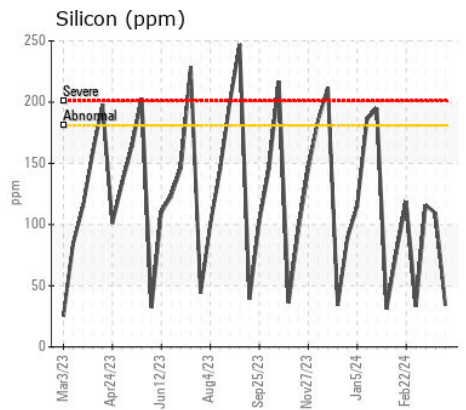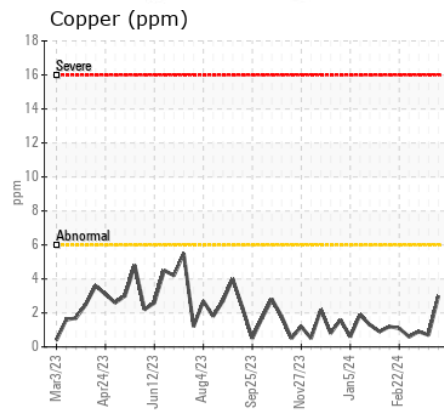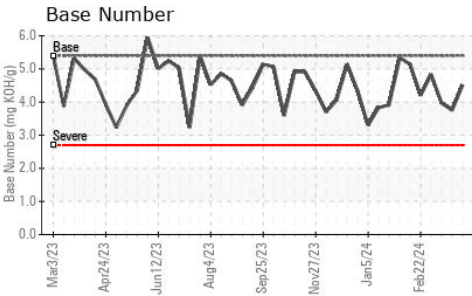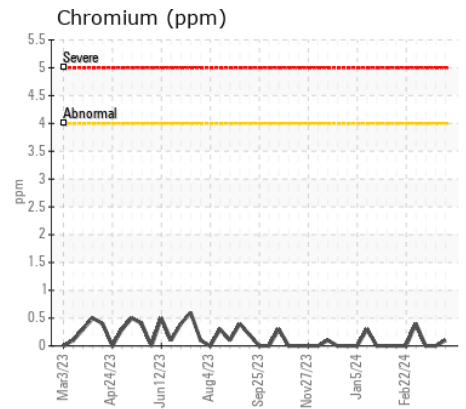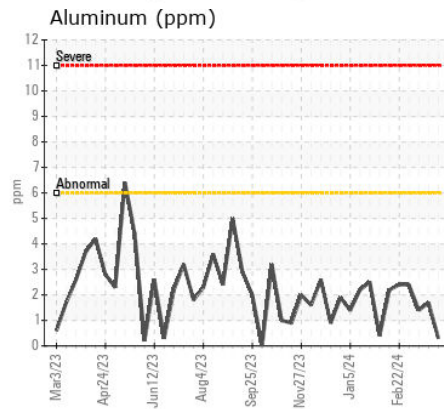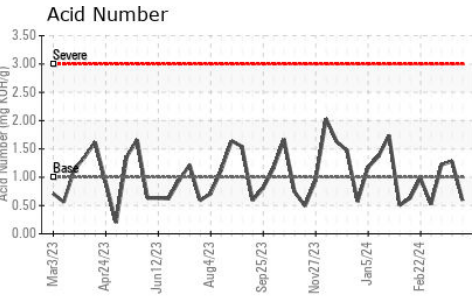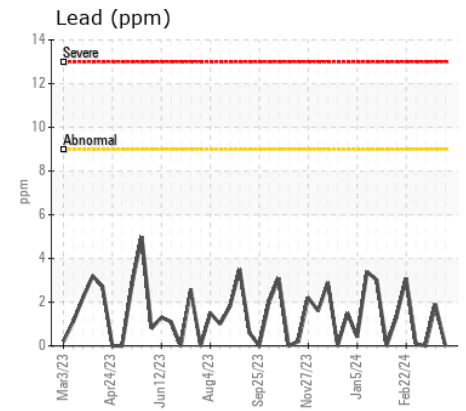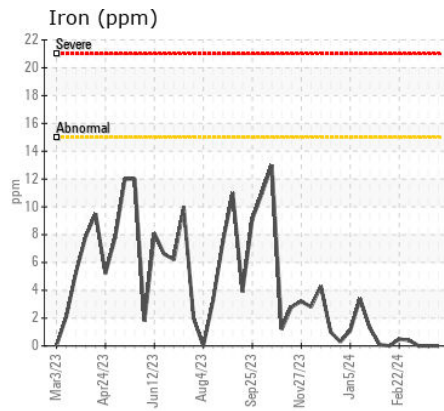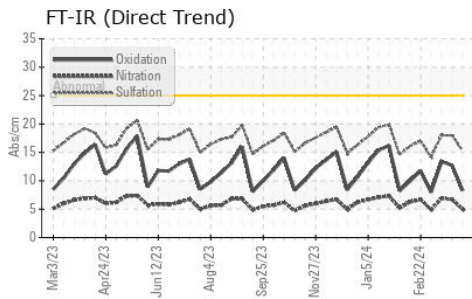

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : WC0871575 **Received** : 22 Apr 2024  
**Lab Number** : 06156197 **Tested** : 23 Apr 2024  
**Unique Number** : 10991620 **Diagnosed** : 24 Apr 2024 - Sean Felton  
**Test Package** : MOB 2

**EDL NA Recips-Coopersville**  
 Coopersville Powerstation, 15362 68th Avenue  
 Coopersville, MI  
 US 49404  
 Contact: Daniel Young  
 daniel.young@edlenergy.com  
 T:  
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)