



OIL ANALYSIS REPORT

WEAR	NORMAL
CONTAMINATION	NORMAL
FLUID CONDITION	NORMAL

Machine Id
24D1001 FGHT-039
 Component
New (Unused) Oil
 Fluid
Air Compressor Oil (--- GAL)

RECOMMENDATION

This is a baseline read-out on the submitted sample.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		HPL006574	HPL006548	---
Sample Date		Client Info		22 Apr 2024	11 Apr 2024	---
Machine Age	hrs	Client Info		0	0	---
Oil Age	hrs	Client Info		0	0	---
Filter Age	hrs	Client Info		0	0	---
Oil Changed		Client Info		N/A	N/A	---
Filter Changed		Client Info		N/A	N/A	---
Sample Status				NORMAL	NORMAL	---

WEAR








Iron	ppm	ASTM D5185m		0	0	---
Chromium	ppm	ASTM D5185m		0	0	---
Nickel	ppm	ASTM D5185m		0	0	---
Titanium	ppm	ASTM D5185m		0	0	---
Silver	ppm	ASTM D5185m		0	0	---
Aluminum	ppm	ASTM D5185m		0	0	---
Lead	ppm	ASTM D5185m		0	0	---
Copper	ppm	ASTM D5185m		0	0	---
Tin	ppm	ASTM D5185m		0	0	---
Vanadium	ppm	ASTM D5185m		<1	0	---
White Metal	scalar	*Visual	NONE	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	---

CONTAMINATION

Silicon	ppm	ASTM D5185m		<1	<1	---
Potassium	ppm	ASTM D5185m	>20	0	5	---
Water		WC Method		NEG	NEG	---
Silt	scalar	*Visual	NONE	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	NORML	---
Emulsified Water	scalar	*Visual		NEG	NEG	---

FLUID CONDITION

Sodium	ppm	ASTM D5185m		<1	1	---
Boron	ppm	ASTM D5185m		<1	0	---
Barium	ppm	ASTM D5185m		0	0	---
Molybdenum	ppm	ASTM D5185m		0	0	---
Manganese	ppm	ASTM D5185m		0	0	---
Magnesium	ppm	ASTM D5185m		0	0	---
Calcium	ppm	ASTM D5185m		0	<1	---
Phosphorus	ppm	ASTM D5185m		334	309	---
Zinc	ppm	ASTM D5185m		0	0	---
Sulfur	ppm	ASTM D5185m		1978	1852	---
Acid Number (AN)	mg KOH/g	ASTM D8045		1.19	1.07	---
Visc @ 40°C	cSt	ASTM D445		476.8	476.3	---
Visc @ 100°C	cSt	ASTM D445		38.11	37.61	---
Viscosity Index (VI)	Scale	ASTM D2270		122	120	---

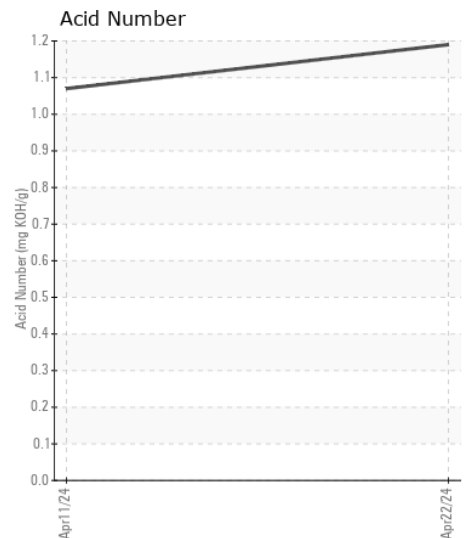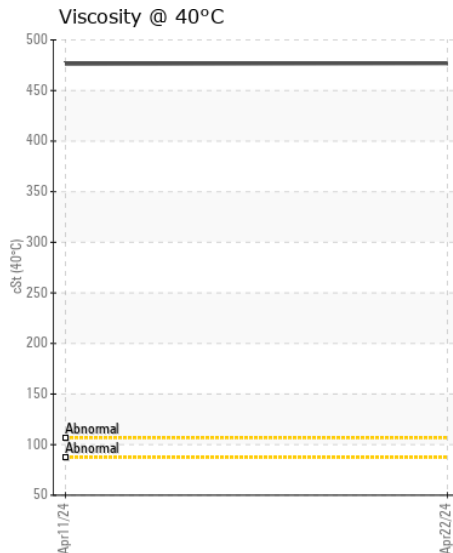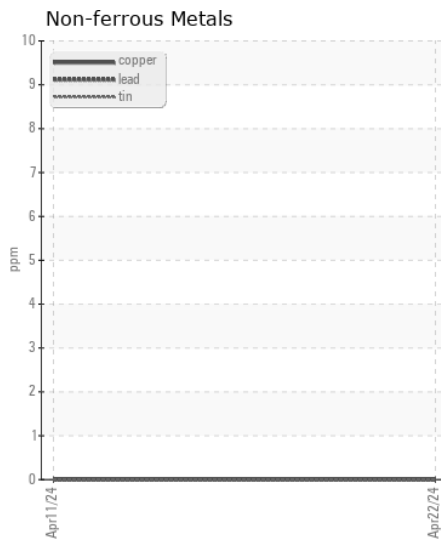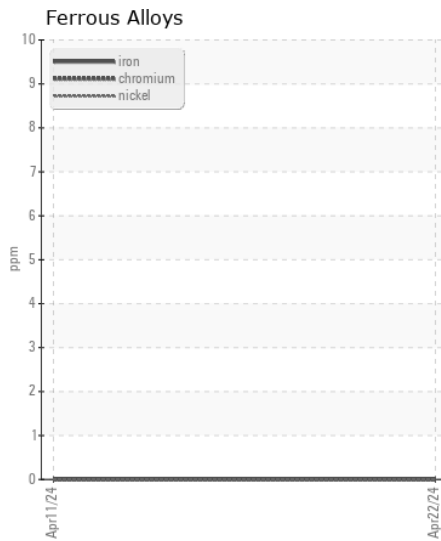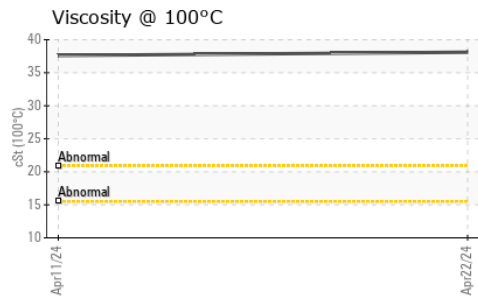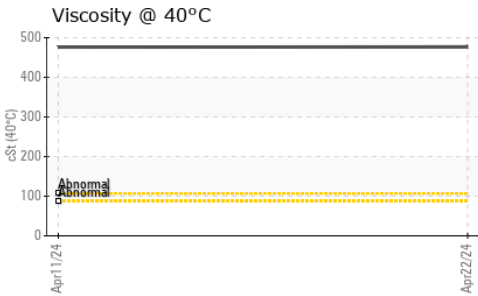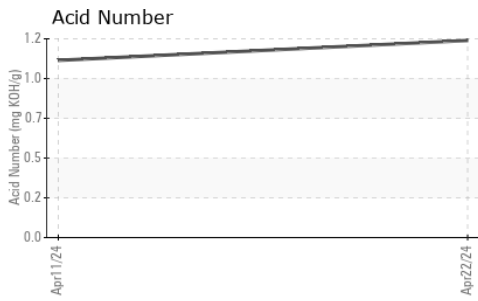

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : HPL006574
Lab Number : 06156526
Unique Number : 10991949
Test Package : MOB 2 (Additional Tests: FT-IR, ICP-NewOil, KV100, PrtCount, VI)

Received : 22 Apr 2024
Tested : 24 Apr 2024
Diagnosed : 24 Apr 2024 - Jonathan Hester

HIGH PERFORMANCE LUBRICANTS LLC
 500 S SPRUCE ST
 MANTENO, IL
 US 60950

Contact: DAVID WARD
 sampledata@hplubricants.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: (815)468-3535

F: x: