



COOLANT REPORT

CORROSION

NORMAL

CONTAMINANTS

NORMAL

COOLANT CONDITION

NORMAL



Machine Id
JENBACHER GM03 (S/N 1144731)
 Component
Coolant
 Fluid
{not provided} (--- GAL)

RECOMMENDATION

The fluid is suitable for further service.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		WC0880432	---	---
Sample Date		Client Info		21 Apr 2024	---	---
Machine Age	hrs	Client Info		0	---	---
Oil Age	hrs	Client Info		0	---	---
Oil Changed		Client Info		N/A	---	---
Sample Status				NORMAL	---	---










CORROSION

Total Dissolved Solids				366.5	---	---
Coolant Appearance		*Visual	Clear	normal	---	---

CONTAMINANTS

There is no indication of any contamination in the coolant.

Boiling Point	°C	WC Method		224	---	---
Specific Gravity		*ASTM D1298		1.065	---	---
pH	Scale 0-14	ASTM D1287		7.11	---	---
Nitrites	ppm	AP-053:2009		488	---	---
Reserve Alkalinity	Scale 0-20	*ASTM D1121		---	---	---
Percentage Glycol	%	ASTM D3321		47.9	---	---
Freezing Point	°F	ASTM D3321		-28	---	---
Carboxylate				n/a	---	---
Coolant Color		*Visual		Pink	---	---

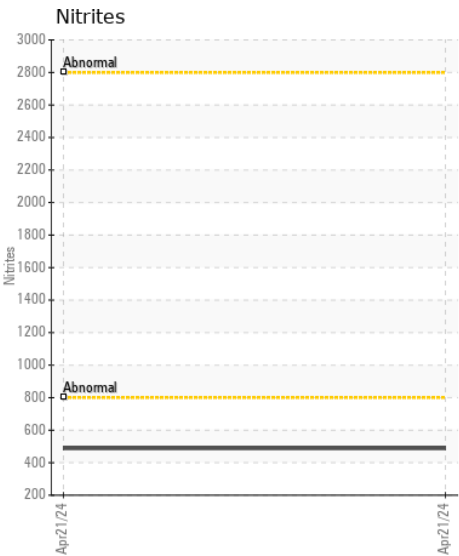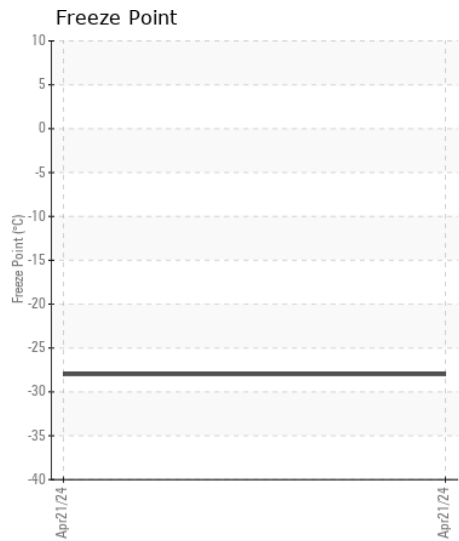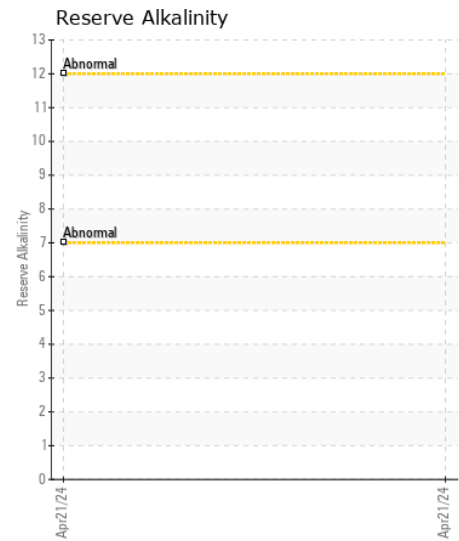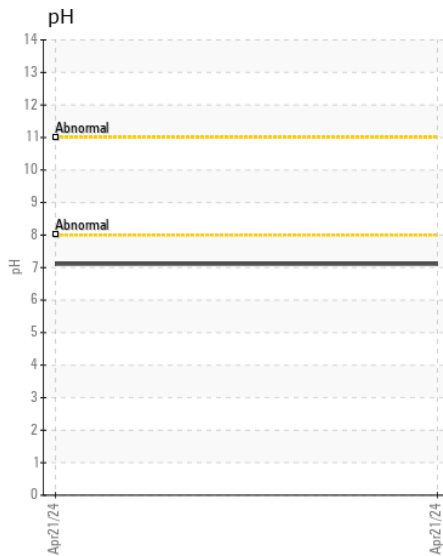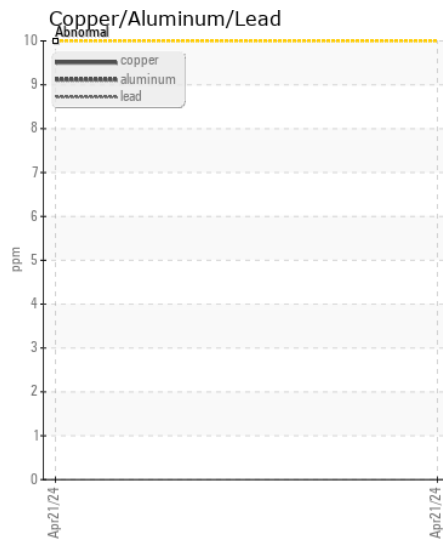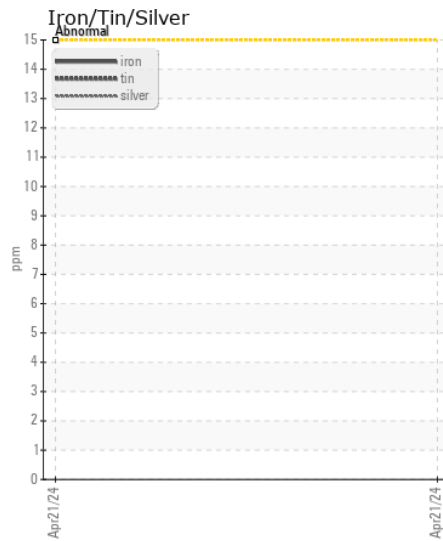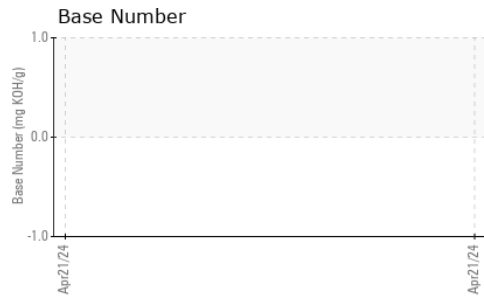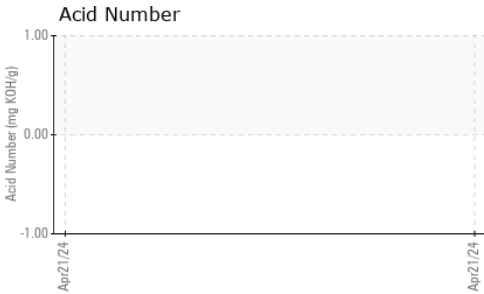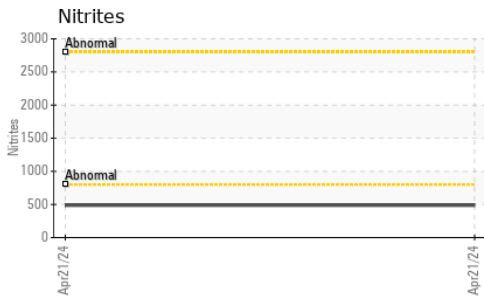

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513

Sample No. : WC0880432

Lab Number : 06157167

Unique Number : 10992590

Test Package : COOL- (Additional Tests: BoilingPoint, COOL, GlycolType, TAN Man, TBN)

Received : 22 Apr 2024

Tested : 25 Apr 2024

Diagnosed : 25 Apr 2024 - Jonathan Hester

PINE RIDGE

105 BAILEY JESTER RD

GRIFFIN, GA

US 30224

Contact: STEPHEN SAVAGE

stephen.savage@cubedistrictenergy.com

T:

F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)