



WEAR	<b>NORMAL</b>
CONTAMINATION	<b>NORMAL</b>
FLUID CONDITION	<b>NORMAL</b>

Machine Id  
**Capt. Carl Page (S/N 60352406)**  
Component  
**Port Genset**  
Fluid  
**CHEVRON DELO 710 LS (7 GAL)**

**RECOMMENDATION**

Resample at the next service interval to monitor.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		<b>MW0047726</b>	MW0047745	MW0047717
Sample Date		Client Info		<b>20 Feb 2024</b>	15 Dec 2023	26 Nov 2023
Machine Age	hrs	Client Info		<b>455</b>	2994	2553
Oil Age	hrs	Client Info		<b>455</b>	441	540
Filter Age	hrs	Client Info		<b>455</b>	441	540
Oil Changed		Client Info		<b>Changed</b>	Changed	Changed
Filter Changed		Client Info		<b>Changed</b>	Changed	Changed
Sample Status				<b>NORMAL</b>	NORMAL	NORMAL

**WEAR**

All component wear rates are normal.

Iron	ppm	ASTM D5185m	>50	<b>15</b>	8	15
Chromium	ppm	ASTM D5185m	>4	<b>&lt;1</b>	<1	<1
Nickel	ppm	ASTM D5185m	>2	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m		<b>0</b>	0	<1
Silver	ppm	ASTM D5185m	>5	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m	>12	<b>1</b>	2	1
Lead	ppm	ASTM D5185m	>17	<b>0</b>	0	0
Copper	ppm	ASTM D5185m	>70	<b>0</b>	<1	<1
Tin	ppm	ASTM D5185m	>15	<b>0</b>	0	0
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	0
White Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE

**CONTAMINATION**

There is no indication of any contamination in the oil.


Silicon	ppm	ASTM D5185m	>25	<b>3</b>	1	2
Potassium	ppm	ASTM D5185m	>20	<b>0</b>	1	3
Fuel		WC Method	>4.0	<b>&lt;1.0</b>	<1.0	<1.0
Water		WC Method	>0.1	<b>NEG</b>	NEG	NEG
Glycol		WC Method		<b>NEG</b>	NEG	NEG
Soot %	%	*ASTM D7844		<b>0.1</b>	0.1	0.1
Nitration	Abs/cm	*ASTM D7624	>20	<b>8.1</b>	8.0	8.1
Sulfation	Abs/.1mm	*ASTM D7415	>30	<b>14.6</b>	14.3	14.6
Silt	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Debris	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Appearance	scalar	*Visual	NORML	<b>NORML</b>	NORML	NORML
Odor	scalar	*Visual	NORML	<b>NORML</b>	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	<b>NEG</b>	NEG	NEG

**FLUID CONDITION**


The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

Sodium	ppm	ASTM D5185m		<b>2</b>	0	0
Boron	ppm	ASTM D5185m		<b>40</b>	28	42
Barium	ppm	ASTM D5185m		<b>&lt;1</b>	<1	0
Molybdenum	ppm	ASTM D5185m		<b>44</b>	27	45
Manganese	ppm	ASTM D5185m		<b>&lt;1</b>	0	0
Magnesium	ppm	ASTM D5185m		<b>19</b>	13	10
Calcium	ppm	ASTM D5185m		<b>3151</b>	1848	3446
Phosphorus	ppm	ASTM D5185m		<b>19</b>	26	22
Zinc	ppm	ASTM D5185m		<b>35</b>	14	0
Sulfur	ppm	ASTM D5185m		<b>2465</b>	1305	2216
Oxidation	Abs/.1mm	*ASTM D7414	>25	<b>9.4</b>	8.7	9.0
Base Number (BN)	mg KOH/g	ASTM D2896	10.5	<b>6.8</b>	6.9	6.7
Visc @ 100°C	cSt	ASTM D445	15.5	<b>13.1</b>	13.1	13.3


**FT-IR (Direct Trend)**

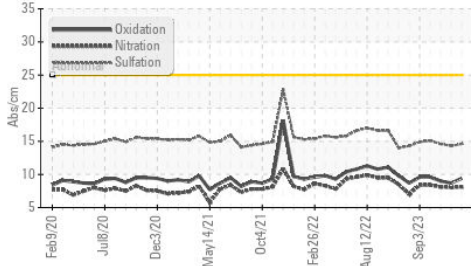


**Base Number**

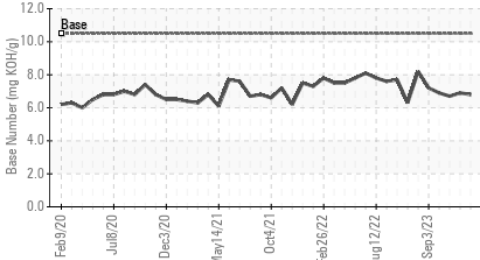


**Viscosity @ 100°C**

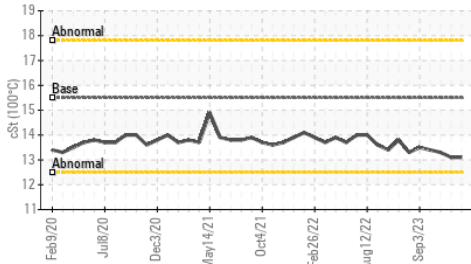


**Ferrous Alloys**

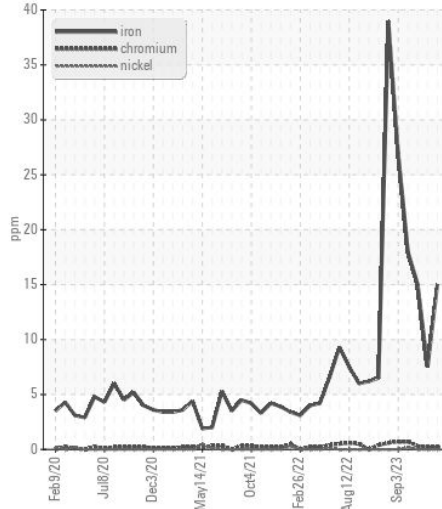


**Non-ferrous Metals**

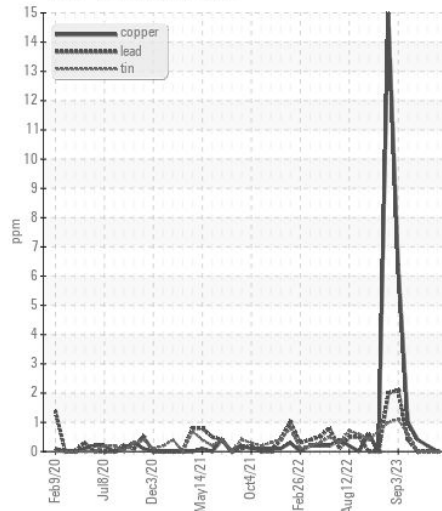

**Viscosity @ 100°C**

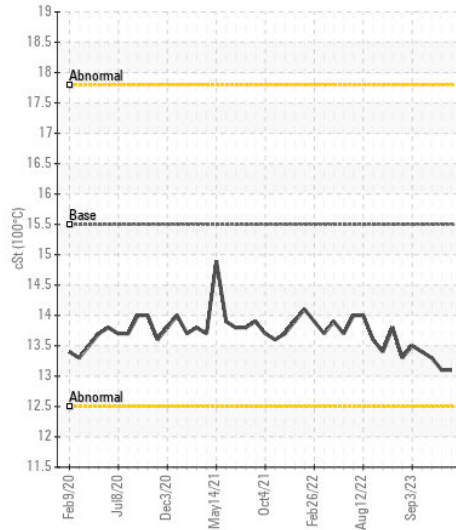

**Base Number**

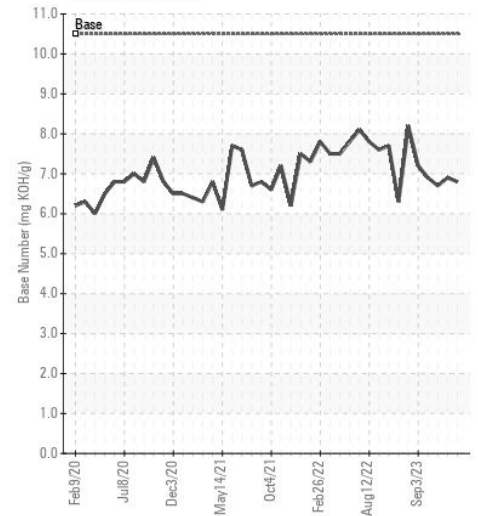

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513

**Sample No.** : MW0047726

**Lab Number** : 06157516

**Unique Number** : 10992939

**Test Package** : MAR 2

**Received** : 23 Apr 2024

**Tested** : 24 Apr 2024

**Diagnosed** : 25 Apr 2024 - Jonathan Hester

**AMERICAN COMMERCIAL LINES**

PO BOX 610, 1701 E. MARKET STREET

JEFFERSONVILLE, IN

US 47130

Contact: RONALD SCHNEIDER

ronald.schneider@bargeacbl.com

T:

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

F: (812)288-1644