

Area FOOD GRADE 15 Machine Id PALATEK 1409220003-2 - CLEMENTS Component Compressor

RECOMMENDATION	Test	UOM	Method	Limit/Abn	Current	History1	History2
The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.	Sample Number		Client Info		UCS06157782	UCS06116004	UCS06053927
	Sample Date		Client Info		18 Apr 2024	05 Mar 2024	09 Dec 2023
	Machine Age	hrs	Client Info		61237	60189	58311
	Oil Age	hrs	Client Info		1800	745	3000
	Filter Age	hrs	Client Info		800	745	1000
	Oil Changed		Client Info		Not Changd	Changed	Not Changd
	Filter Changed		Client Info		Changed	Changed	Changed
	Sample Status				NORMAL	NORMAL	SEVERE
WEAR	Iron	ppm	ASTM D5185m	>50	0	0	0
All component wear rates are normal.	Chromium	ppm	ASTM D5185m	>10	<1	0	0
	Nickel	ppm	ASTM D5185m		0	0	0
	Titanium	ppm	ASTM D5185m		0	0	0
	Silver	ppm	ASTM D5185m		0	0	0
	Aluminum	ppm	ASTM D5185m	>25	<1	0	0
	Lead	ppm	ASTM D5185m	>25	0	0	0
	Copper	ppm	ASTM D5185m	>50	0	<1	<1
	Tin	ppm	ASTM D5185m	>15	<1	0	0
	Vanadium	ppm	ASTM D5185m		0	0	0
	White Metal	scalar	*Visual	NONE	NONE	NONE	LIGHT
	Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE
CONTAMINATION High concentration of visible dirt/debris present in the oil.	Silicon	ppm	ASTM D5185m	>25	0	0	0
	Potassium	ppm	ASTM D5185m	>20	1	0	0
	Water		WC Method	>0.1	NEG	NEG	NEG
	Silt	scalar	*Visual	NONE	NONE	NONE	NONE
	Debris	scalar	*Visual	NONE	HEAVY	NONE	NONE
	Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
	Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
	Odor	scalar	*Visual	NORML	NORML	NORML	NORML
	Emulsified Water	scalar	*Visual	>0.1	NEG	NEG	NEG
FLUID CONDITION	Sodium	ppm	ASTM D5185m		<1	<1	0
The AN level is acceptable for this fluid. The condition of the oil is	Boron	ppm	ASTM D5185m		0	0	0
suitable for further service.	Barium	ppm	ASTM D5185m		0	0	0
	Molybdenum	ppm	ASTM D5185m		0	0	0
	Manganese	ppm	ASTM D5185m		0	0	<1
	Magnesium	ppm	ASTM D5185m		<1	0	<1
	Calcium	ppm	ASTM D5185m		0	0	0
	Phosphorus	ppm	ASTM D5185m		331	383	222
	Zinc	ppm	ASTM D5185m		0	3	0

Sulfur

Visc @ 40°C cSt

ppm ASTM D5185m

ASTM D445

Acid Number (AN) mg KOH/g ASTM D8045

42.1 41.2 46.6 Contact/Location: JOHN ? - UCJASNEW

1126


0.38

925

0.49

346

2.41

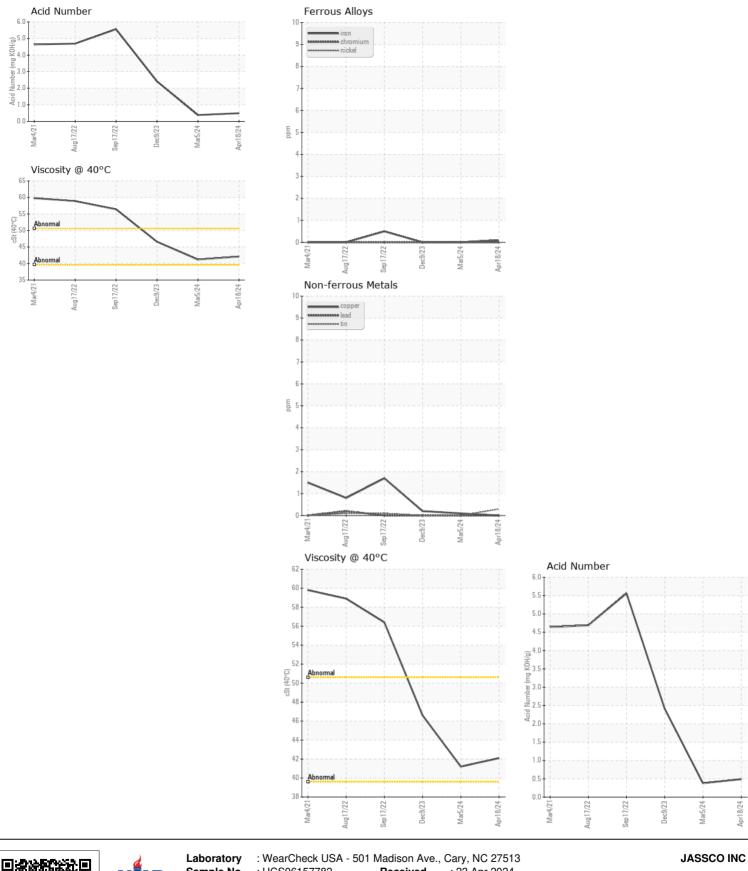

Sample No. : UCS06157782 Received : 23 Apr 2024 Ň Lab Number : 06157782 Tested : 24 Apr 2024 NEWALLA, OK Unique Number : 10993205 Diagnosed : 25 Apr 2024 - Jonathan Hester US 74857 Test Package : IND 2 Contact: JOHN Certificate L2367 To discuss this sample report, contact Customer Service at 1-800-237-1369. jasscoinc@proton.me * - Denotes test methods that are outside of the ISO 17025 scope of accreditation. T: (405)391-5492 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012) F:

Contact/Location: JOHN ? - UCJASNEW Page 2 of 2