



OIL ANALYSIS REPORT

WEAR	NORMAL
CONTAMINATION	NORMAL
FLUID CONDITION	NORMAL

Area

SYN OIL 8K

Machine Id

ATLAS COPCO GA 37 HOX020595 - SERIGRAPH

Component

Compressor

RECOMMENDATION

Resample at the next service interval to monitor.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		UCZ06157791	---	---
Sample Date		Client Info		16 Apr 2024	---	---
Machine Age	hrs	Client Info		90872	---	---
Oil Age	hrs	Client Info		1900	---	---
Filter Age	hrs	Client Info		0	---	---
Oil Changed		Client Info		Not Changd	---	---
Filter Changed		Client Info		Changed	---	---
Sample Status				NORMAL	---	---

WEAR

All component wear rates are normal.

Iron	ppm	ASTM D5185m	>50	0	---	---
Chromium	ppm	ASTM D5185m	>5	<1	---	---
Nickel	ppm	ASTM D5185m		0	---	---
Titanium	ppm	ASTM D5185m		0	---	---
Silver	ppm	ASTM D5185m		0	---	---
Aluminum	ppm	ASTM D5185m	>15	0	---	---
Lead	ppm	ASTM D5185m	>65	0	---	---
Copper	ppm	ASTM D5185m	>65	0	---	---
Tin	ppm	ASTM D5185m	>10	<1	---	---
Vanadium	ppm	ASTM D5185m		0	---	---
White Metal	scalar	*Visual	NONE	NONE	---	---
Yellow Metal	scalar	*Visual	NONE	NONE	---	---

CONTAMINATION







There is no indication of any contamination in the oil.

Silicon	ppm	ASTM D5185m	>35	<1	---	---
Potassium	ppm	ASTM D5185m	>20	<1	---	---
Water		WC Method	>0.1	NEG	---	---
Silt	scalar	*Visual	NONE	NONE	---	---
Debris	scalar	*Visual	NONE	NONE	---	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---	---
Appearance	scalar	*Visual	NORML	NORML	---	---
Odor	scalar	*Visual	NORML	NORML	---	---
Emulsified Water	scalar	*Visual	>0.1	NEG	---	---

FLUID CONDITION

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

Sodium	ppm	ASTM D5185m		<1	---	---
Boron	ppm	ASTM D5185m	0.3	0	---	---
Barium	ppm	ASTM D5185m	0.3	18	---	---
Molybdenum	ppm	ASTM D5185m	0	0	---	---
Manganese	ppm	ASTM D5185m	0.9	0	---	---
Magnesium	ppm	ASTM D5185m	0.2	<1	---	---
Calcium	ppm	ASTM D5185m	0.1	0	---	---
Phosphorus	ppm	ASTM D5185m	429	252	---	---
Zinc	ppm	ASTM D5185m	0.3	4	---	---
Sulfur	ppm	ASTM D5185m	1336	675	---	---
Acid Number (AN)	mg KOH/g	ASTM D8045	0.622	0.70	---	---
Visc @ 40°C	cSt	ASTM D445	44.32	55.9	---	---

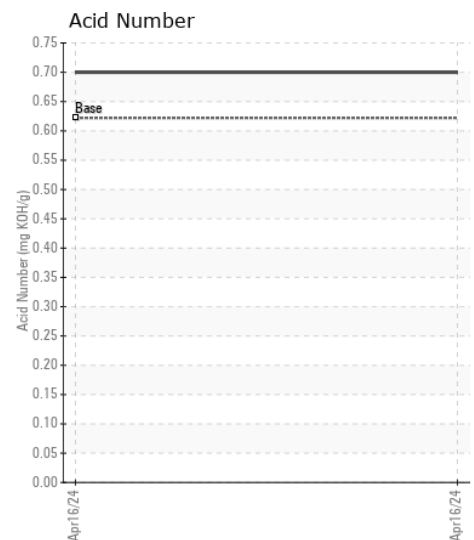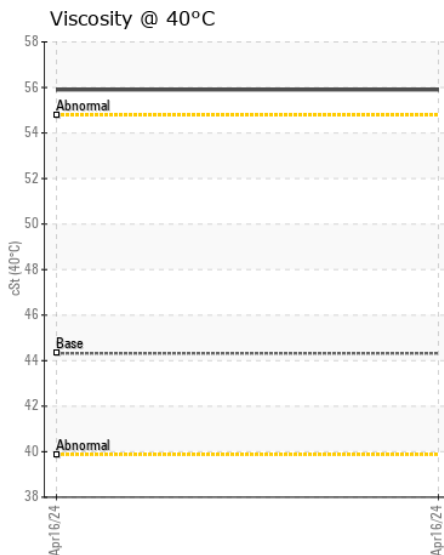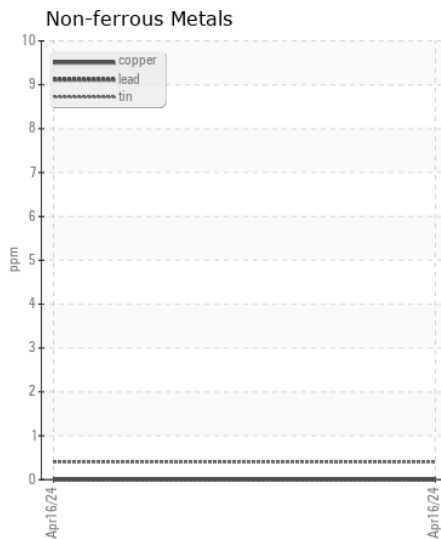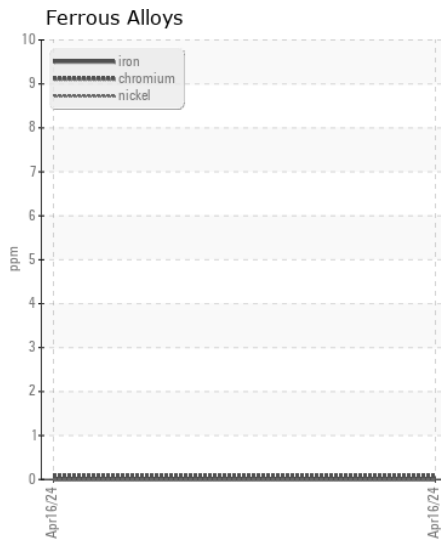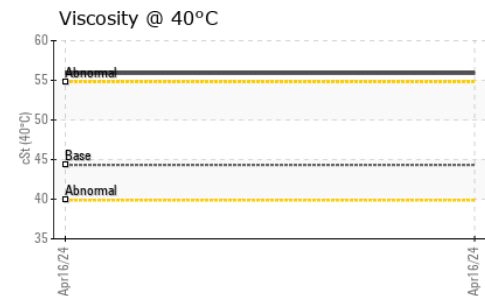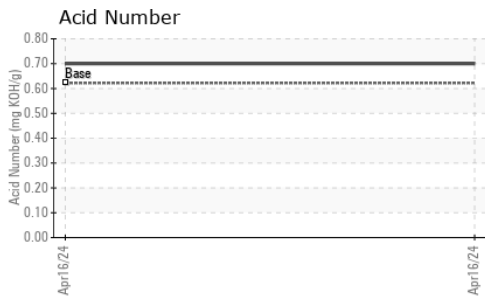

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : UCZ06157791
Lab Number : 06157791
Unique Number : 10993214
Test Package : IND 2

Received : 23 Apr 2024
Tested : 24 Apr 2024
Diagnosed : 25 Apr 2024 - Sean Felton

ZORN COMP & EQUIPMENT INC - MAIN
 1335 E WISCONSIN AVE
 PEWAUKEE, WI
 US 53072
 Contact: AARON LANE
 aaron.lane@zornair.com
 T: (800)476-4637
 F: (262)695-7017

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)