



COOLANT REPORT

CORROSION	NORMAL
CONTAMINANTS	NORMAL
COOLANT CONDITION	NORMAL

Area
[PMOAS3340836]
 Machine Id
CUMMINS 1500DFMB D940540212
 Component
Coolant
 Fluid
FLEETCHARGE (--- QTS)

RECOMMENDATION

The fluid is suitable for further service.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		DC0035285	DC0020426	DC0010966
Sample Date		Client Info		05 Apr 2024	07 Apr 2022	13 Apr 2021
Machine Age	hrs	Client Info		0	846	816
Oil Age	hrs	Client Info		0	0	0
Oil Changed		Client Info		Changed	Not Changd	N/A
Sample Status				NORMAL	NORMAL	NORMAL








CORROSION

Total Dissolved Solids				202.0	196.5	202.5
Coolant Appearance		*Visual	Clear	normal	normal	normal

CONTAMINANTS

There is no indication of any contamination in the coolant.

Boiling Point	°C	WC Method		225	---	---
Specific Gravity		*ASTM D1298		1.067	1.067	---
pH	Scale 0-14	ASTM D1287		9.76	9.89	8.80
Nitrites	ppm	AP-053:2009		1388	1500	1312
Reserve Alkalinity	Scale 0-20	*ASTM D1121		---	---	---
Percentage Glycol	%	ASTM D3321		49.3	49.2	49
Freezing Point	°F	ASTM D3321		-33	-33	-35
Carboxylate				n/a	n/a	n/a
Coolant Color		*Visual		Purpl	Pink	Red

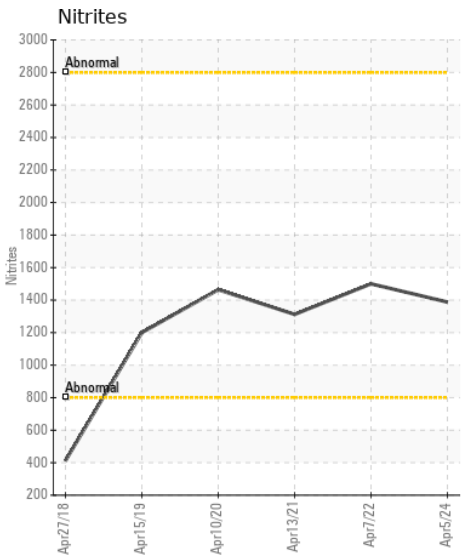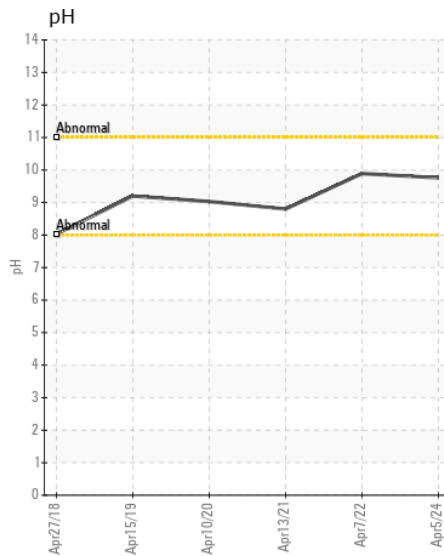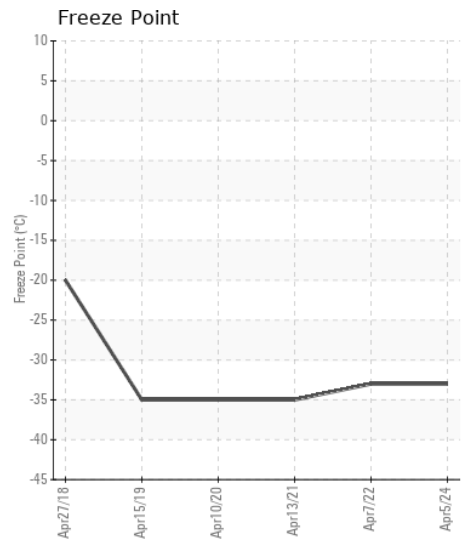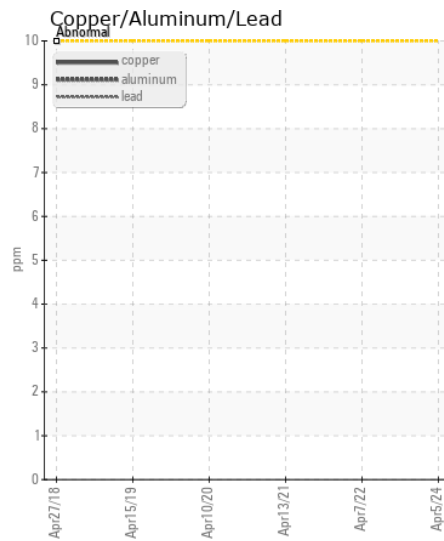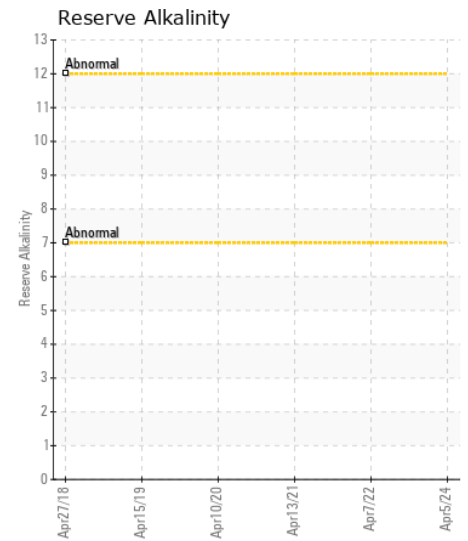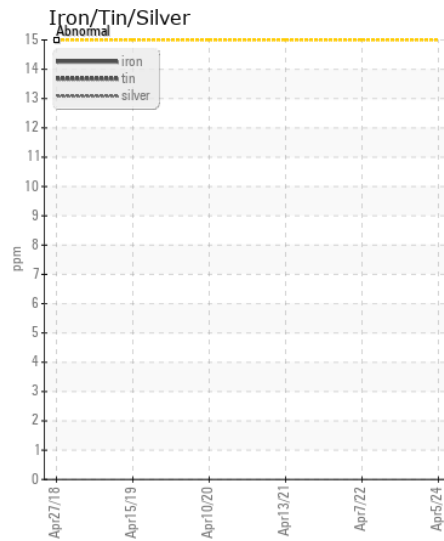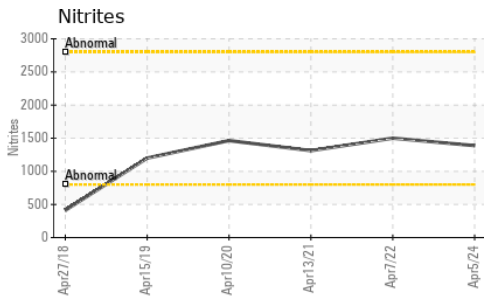

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : DC0035285 **Received** : 23 Apr 2024
Lab Number : 06158231 **Tested** : 25 Apr 2024
Unique Number : 10993654 **Diagnosed** : 25 Apr 2024 - Jonathan Hester
Test Package : COOL- (Additional Tests: BoilingPoint, COOL, GlycolType)

KELLY GENERATOR & EQUIPMENT INC
 1955 DALE LN
 OWINGS, MD
 US 20736
 Contact: LESLIE SNURR
 LSNURR@KGE.COM
 T: (410)257-5225
 F: (410)257-5227

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)