



COOLANT REPORT

CORROSION	NORMAL
CONTAMINANTS	NORMAL
COOLANT CONDITION	NORMAL

Area
[PMOAS3340829]
 Machine Id
CUMMINS DSKAB H110238811
 Component
Coolant
 Fluid
FLEET CHARGE (--- QTS)

RECOMMENDATION

The fluid is suitable for further service.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		DC0035375	DC0025312	DC0020405
Sample Date		Client Info		11 Apr 2024	14 Apr 2023	04 Apr 2022
Machine Age	mths	Client Info		226	0	211
Oil Age	mths	Client Info		0	12	0
Oil Changed		Client Info		Not Changd	Not Changd	N/A
Sample Status				NORMAL	NORMAL	NORMAL








CORROSION

Total Dissolved Solids				193.0	205.0	218.5
Coolant Appearance		*Visual	Clear	normal	normal	normal

CONTAMINANTS

There is no indication of any contamination in the coolant.

Boiling Point	°C	WC Method		226	---	---
Specific Gravity		*ASTM D1298		1.071	1.069	1.072
pH	Scale 0-14	ASTM D1287		9.07	9.46	8.82
Nitrites	ppm	AP-053:2009		1540	1688	1688
Reserve Alkalinity	Scale 0-20	*ASTM D1121		---	---	---
Percentage Glycol	%	ASTM D3321		53.4	51.6	53.5
Freezing Point	°F	ASTM D3321		-43	-38	-43
Carboxylate				n/a	n/a	n/a
Coolant Color		*Visual		Purpl	Pink	Pink

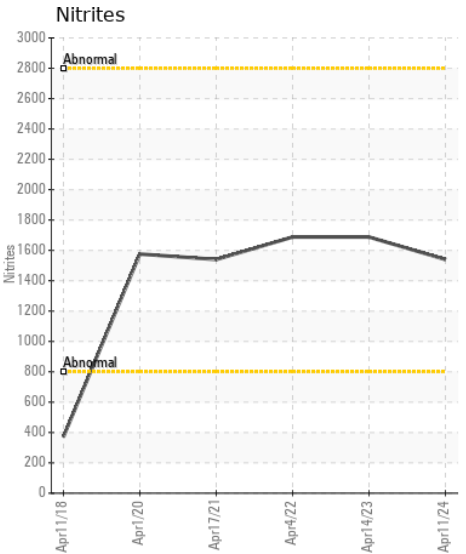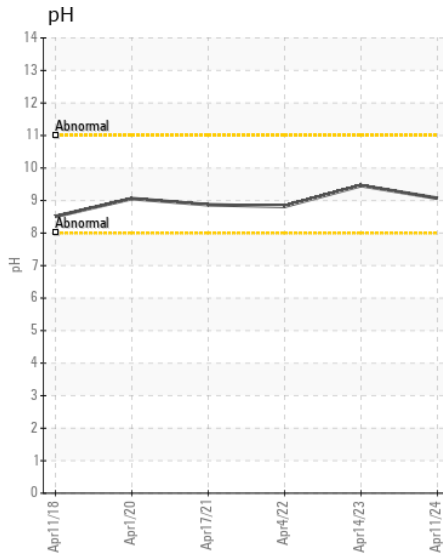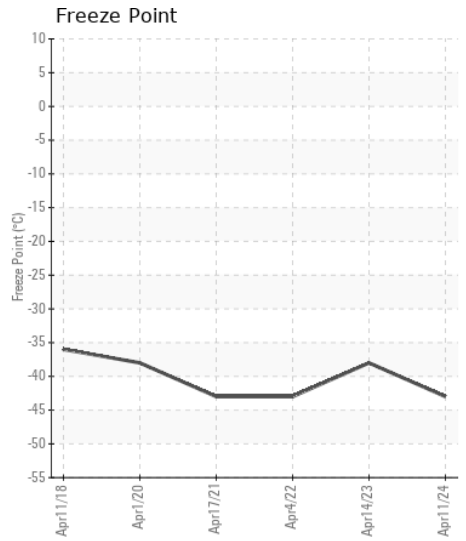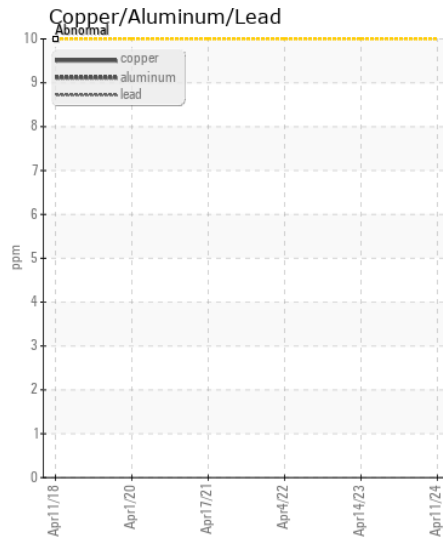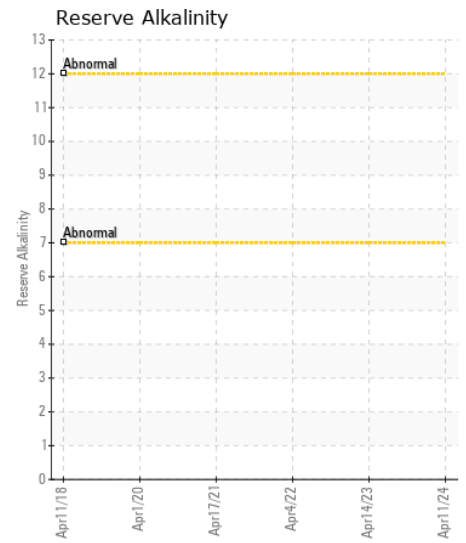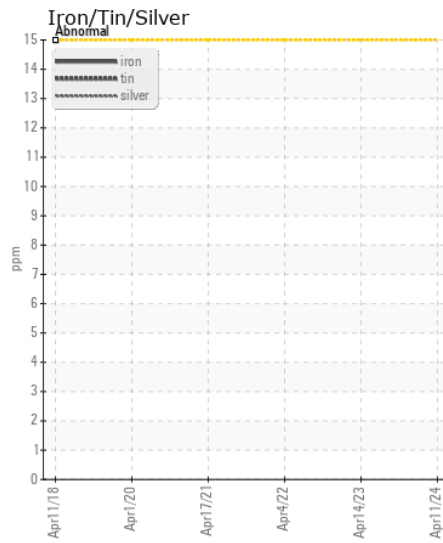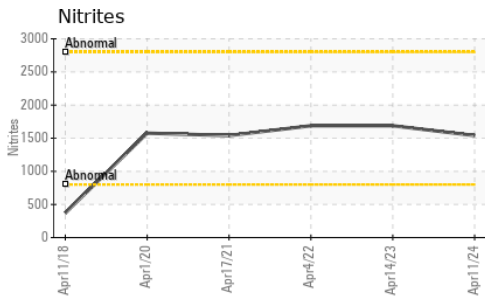

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : DC0035375
Lab Number : 06158234
Unique Number : 10993657
Test Package : COOL- (Additional Tests: BoilingPoint, COOL, GlycolType)

KELLY GENERATOR & EQUIPMENT INC
 1955 DALE LN
 OWINGS, MD
 US 20736
 Contact: LESLIE SNURR
 LSNURR@KGE.COM
 T: (410)257-5225
 F: (410)257-5227

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)