



WEAR	<b>NORMAL</b>
CONTAMINATION	<b>NORMAL</b>
FLUID CONDITION	<b>NORMAL</b>

Machine Id  
**CAPT RICKIE JOHNSON (S/N PE6068G838012)**  
Component  
**Port Genset**  
Fluid  
**CHEVRON DELO 710 LE (8 GAL)**

**RECOMMENDATION**

Resample at the next service interval to monitor.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		<b>MWM731168</b>	MWM727715	MWM727685
Sample Date		Client Info		<b>18 Mar 2024</b>	27 Dec 2023	08 Nov 2023
Machine Age	hrs	Client Info		<b>5797</b>	42895	4380
Oil Age	hrs	Client Info		<b>301</b>	282	320
Filter Age	hrs	Client Info		<b>0</b>	0	0
Oil Changed		Client Info		<b>Changed</b>	Changed	Changed
Filter Changed		Client Info		<b>Changed</b>	Changed	Changed
Sample Status				<b>NORMAL</b>	NORMAL	NORMAL

**WEAR**

All component wear rates are normal.

Iron	ppm	ASTM D5185m	>50	<b>6</b>	6	11
Chromium	ppm	ASTM D5185m	>4	<b>0</b>	<1	<1
Nickel	ppm	ASTM D5185m	>2	<b>0</b>	0	<1
Titanium	ppm	ASTM D5185m		<b>0</b>	0	<1
Silver	ppm	ASTM D5185m	>5	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m	>12	<b>&lt;1</b>	2	2
Lead	ppm	ASTM D5185m	>17	<b>&lt;1</b>	0	4
Copper	ppm	ASTM D5185m	>70	<b>0</b>	1	2
Tin	ppm	ASTM D5185m	>15	<b>0</b>	0	<1
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	0
White Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE

**CONTAMINATION**







There is no indication of any contamination in the oil.

Silicon	ppm	ASTM D5185m	>25	<b>2</b>	3	4
Potassium	ppm	ASTM D5185m	>20	<b>4</b>	2	4
Fuel		WC Method	>4.0	<b>&lt;1.0</b>	<1.0	<1.0
Water		WC Method	>0.1	<b>NEG</b>	NEG	NEG
Glycol		WC Method		<b>NEG</b>	NEG	NEG
Soot %	%	*ASTM D7844		<b>0.1</b>	0.2	0.1
Nitration	Abs/cm	*ASTM D7624	>20	<b>9.2</b>	7.2	9.7
Sulfation	Abs/.1mm	*ASTM D7415	>30	<b>15.6</b>	15.1	16.0
Silt	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Debris	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Appearance	scalar	*Visual	NORML	<b>NORML</b>	NORML	NORML
Odor	scalar	*Visual	NORML	<b>NORML</b>	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	<b>NEG</b>	NEG	NEG

**FLUID CONDITION**

The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

Sodium	ppm	ASTM D5185m		<b>2</b>	1	0
Boron	ppm	ASTM D5185m		<b>32</b>	45	37
Barium	ppm	ASTM D5185m		<b>0</b>	0	8
Molybdenum	ppm	ASTM D5185m		<b>39</b>	41	45
Manganese	ppm	ASTM D5185m		<b>0</b>	0	<1
Magnesium	ppm	ASTM D5185m		<b>11</b>	11	14
Calcium	ppm	ASTM D5185m		<b>3554</b>	3576	3830
Phosphorus	ppm	ASTM D5185m		<b>13</b>	45	11
Zinc	ppm	ASTM D5185m	10	<b>11</b>	0	3
Sulfur	ppm	ASTM D5185m		<b>3271</b>	3234	3081
Oxidation	Abs/.1mm	*ASTM D7414	>25	<b>10.1</b>	8.1	11.5
Base Number (BN)	mg KOH/g	ASTM D2896	9.2	<b>7.5</b>	7.0	7.1
Visc @ 100°C	cSt	ASTM D445	15.5	<b>14.3</b>	14.1	14.7

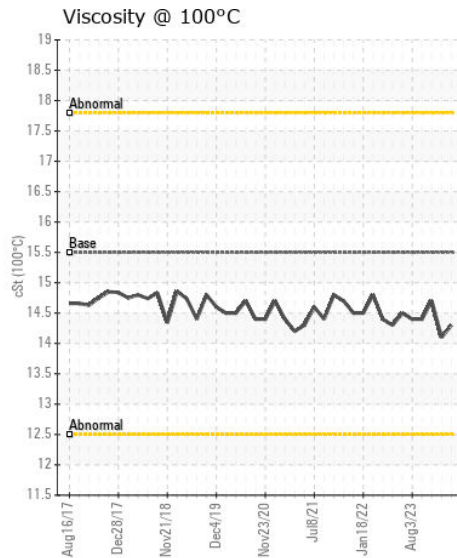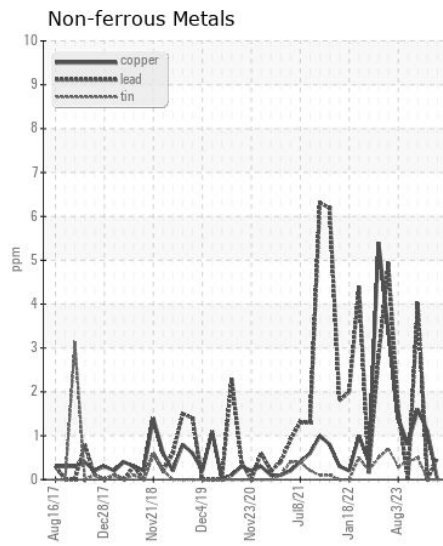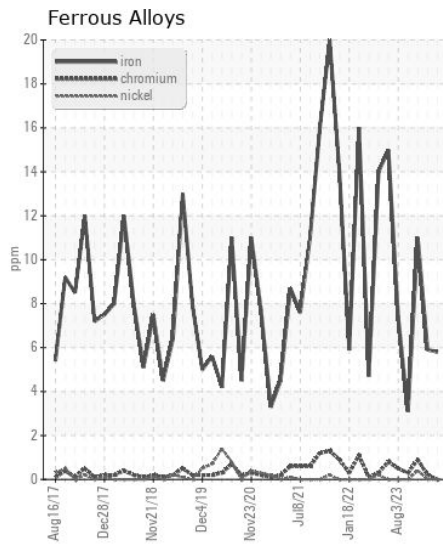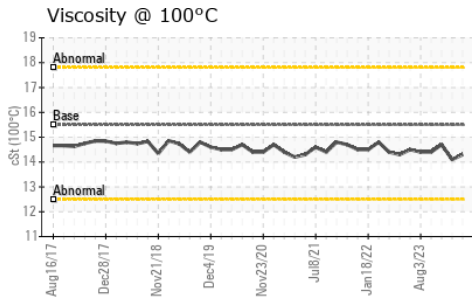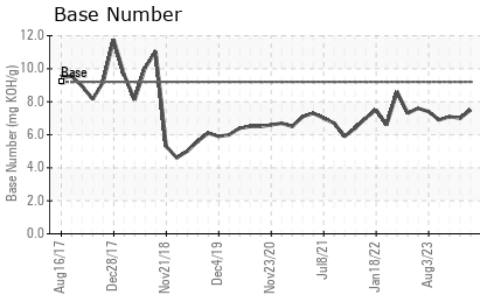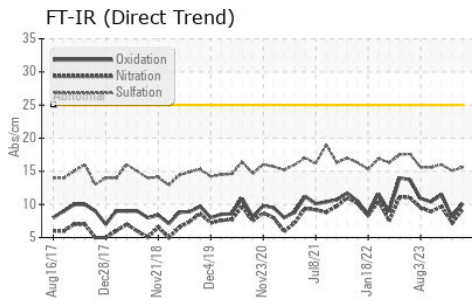

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : MWM731168  
**Lab Number** : 06158709  
**Unique Number** : 10994132  
**Test Package** : MAR 2

**Received** : 24 Apr 2024  
**Tested** : 25 Apr 2024  
**Diagnosed** : 25 Apr 2024 - Wes Davis

**AMERICAN COMMERCIAL LINES**  
 PO BOX 610, 1701 E. MARKET STREET  
 JEFFERSONVILLE, IN  
 US 47130  
 Contact: RONALD SCHNEIDER  
 ronald.schneider@bargeacbl.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:  
 F: (812)288-1644